

# LENNOX MODEL LX-IDS INDOOR SENSOR INSTALLATION DIAGRAMS

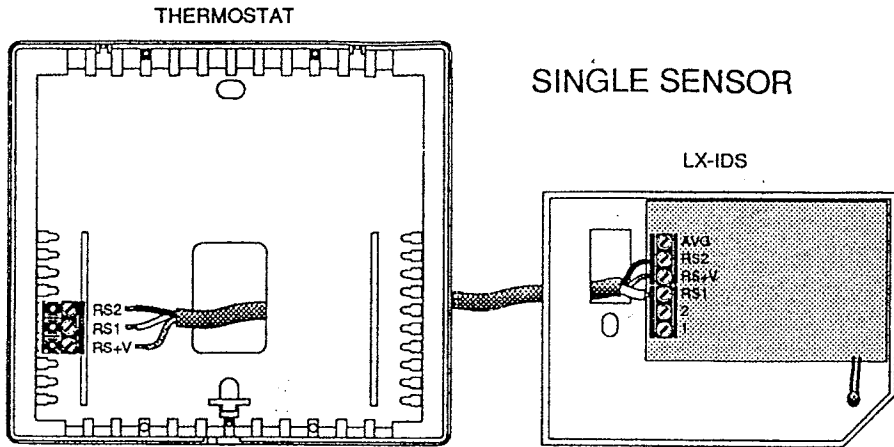


FIG. 1

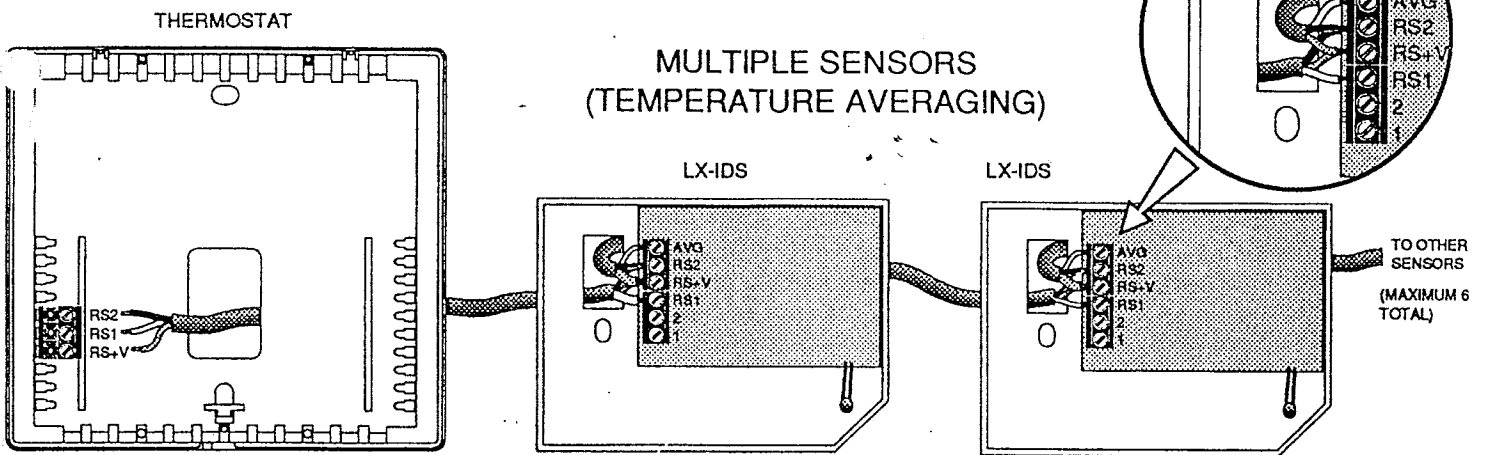


FIG. 2

## RETROFIT TO MULTIPLE L2S-RS SENSORS or INSTALLING AN RDS-10K DUCT SENSOR

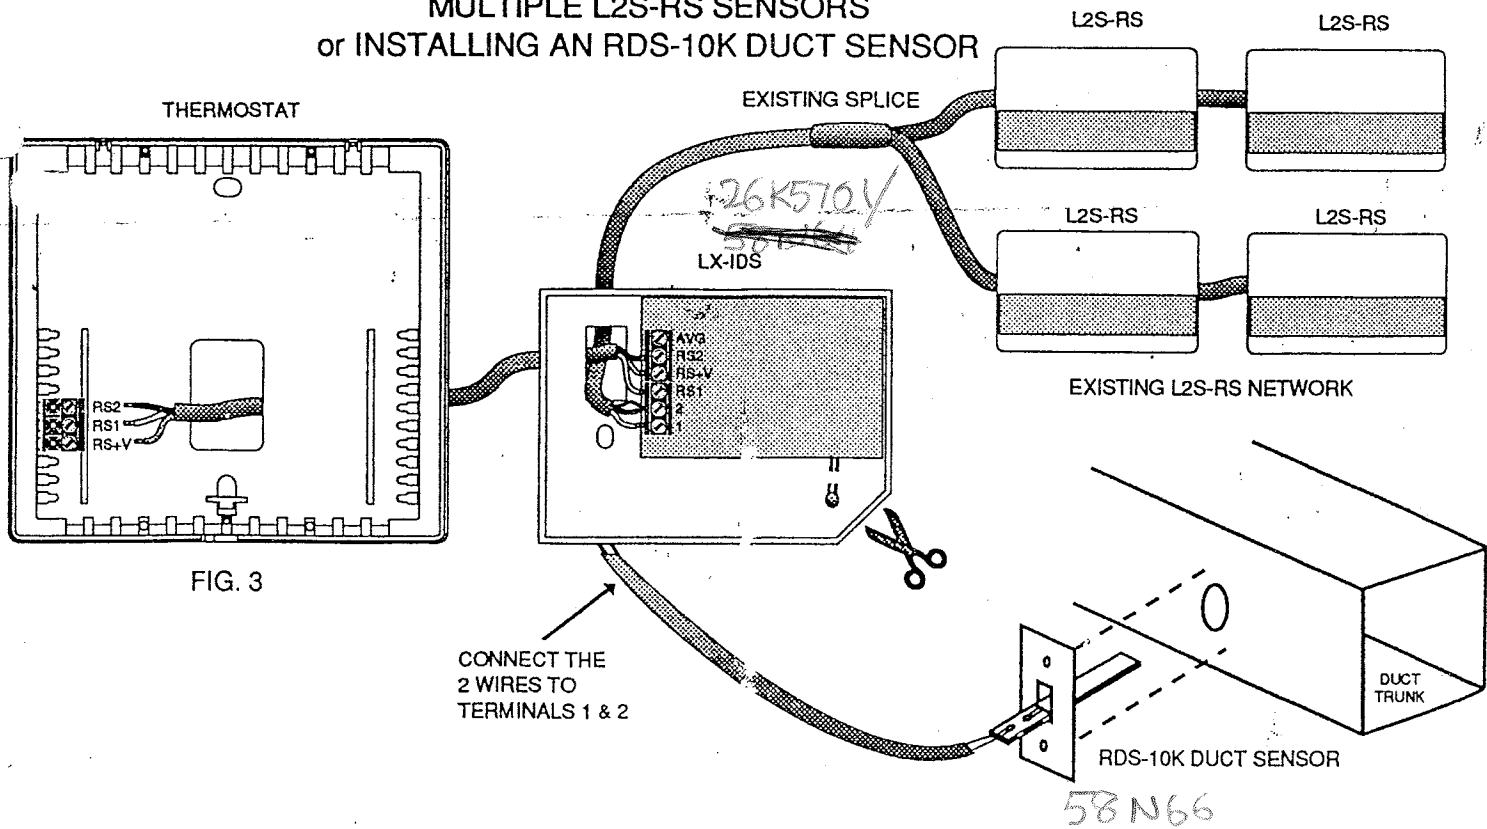


FIG. 3