


Nota1: Eliminar puente cuando se instale el opcional
 Note1: Remove jumper when installing the optional
 Note1: Enlevez le pont en cas d'installer optional
 Notiz1: Entfernen sie die jumper falls optional angeschlossen ist

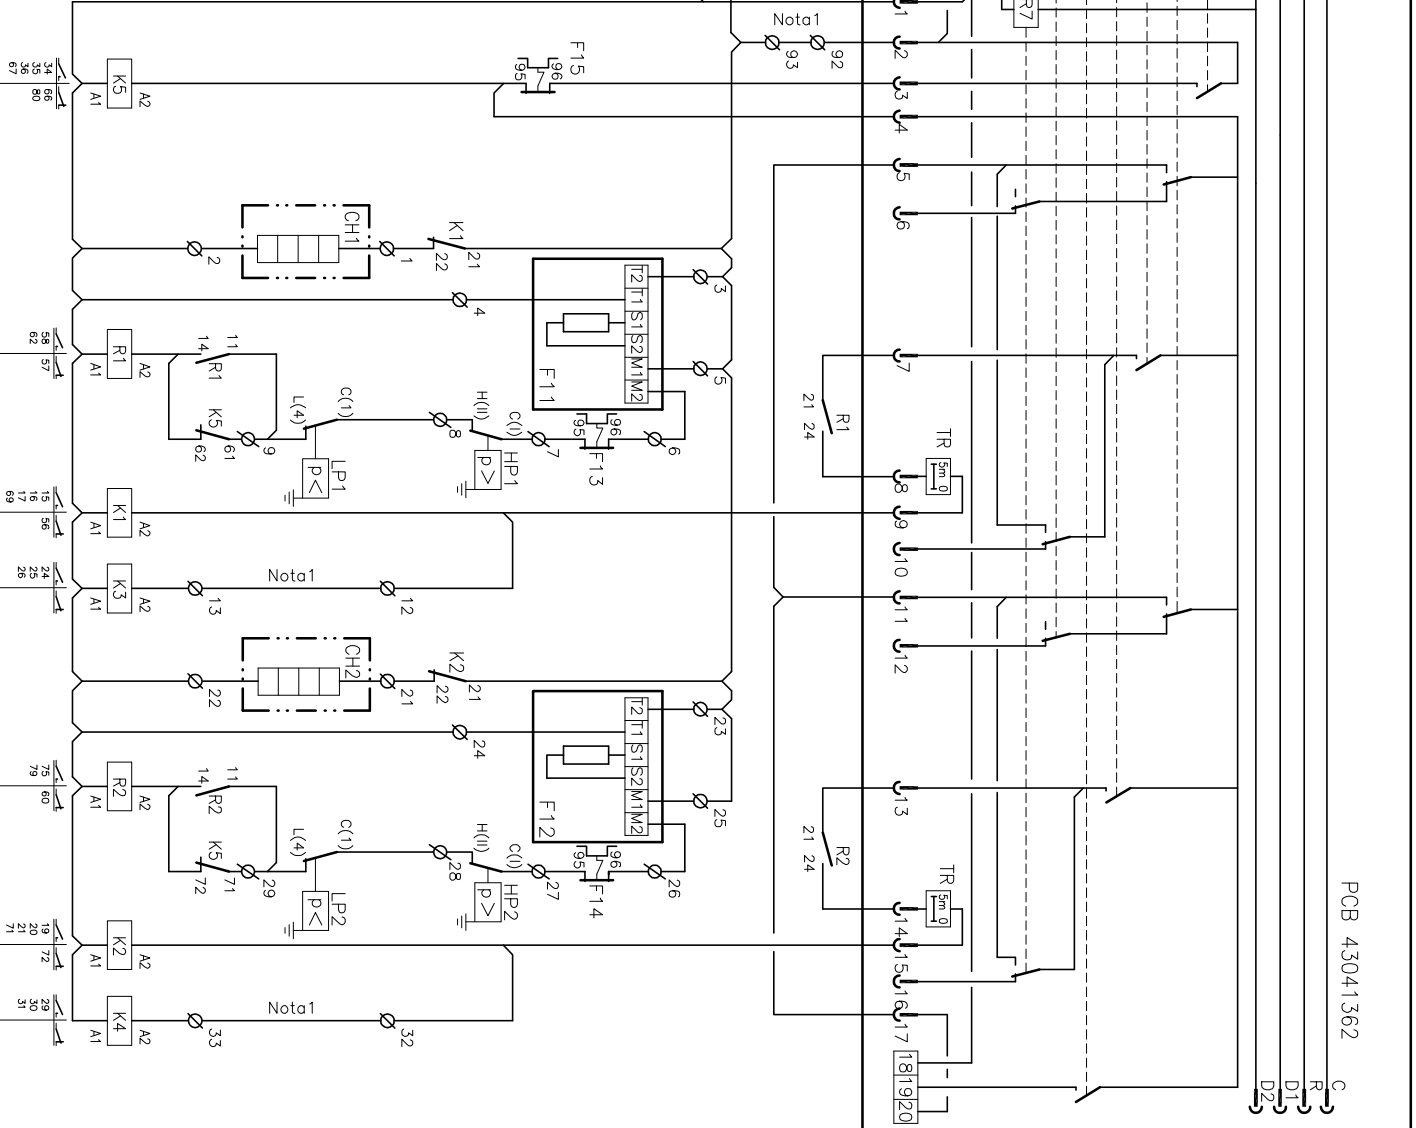

Elemento Opcional
 Optional Element
 A Realizar por el Instalador
 To Wire by the Installer

Fusibles	F1 - F2	F3-F4-F5
Fuses size	LVCK 64D LVCK 76D	
	230/3/50 2x 3 x 50A 2x 3 x 63A 3x 3 x 16A	
	400/3/50 2x 3 x 25A 2x 3 x 32A 3x 3 x 10A	

Lemnox Refoc S.A.
 ESQUEMA ELECTRICO
 ELECTRIC DIAGRAM

VERSION VFC / VFC VERSION
 LVCK (LECK+KVCK) 64D-76D
 32-33-898-754 08E
 3N 400V 50HZ + PE
 3 ~ 230V 50HZ + PE