



Aspen Standard Pump

Installation example

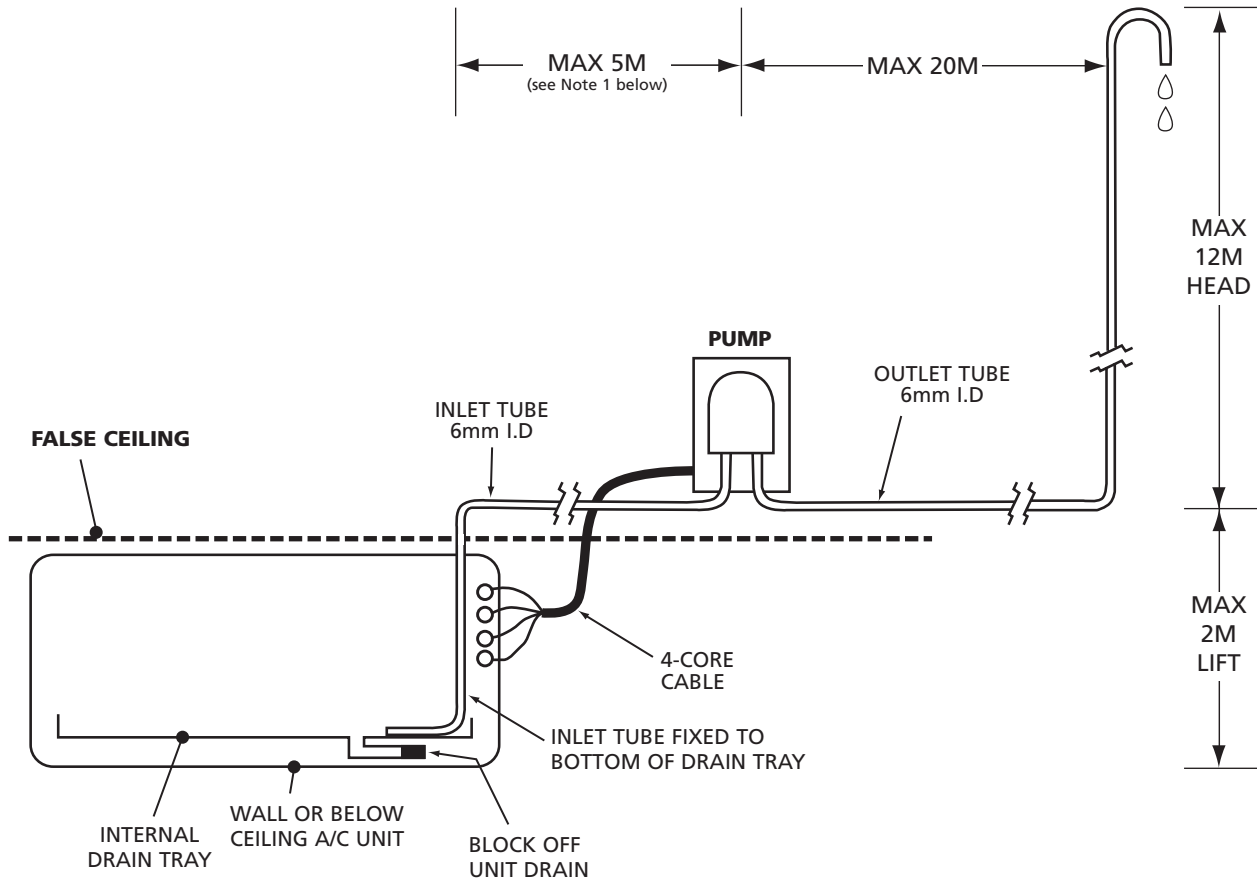

Alternative Position for inlet tube

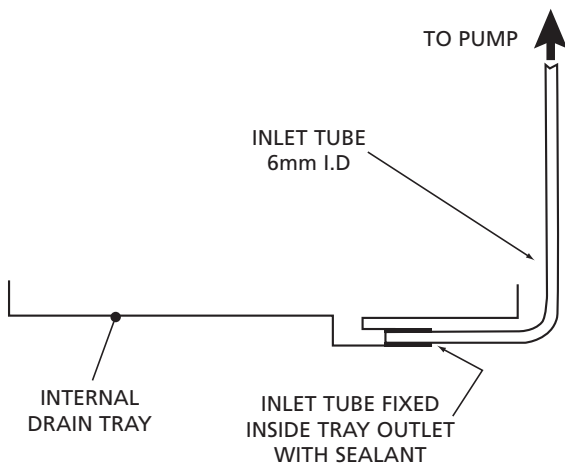

Electrical Connections

(to aircon unit power supply)

Brown	Live
Blue	Neutral
Green/yellow	Earth (Ground)
Black	220-240V Cooling signal

Control Method

220-240V cooling signal required to make the pump run.

Note 1

A non-return valve may be required for units with low capacity drain trays.

NOTE: DIAGRAMS ARE NOT TO SCALE