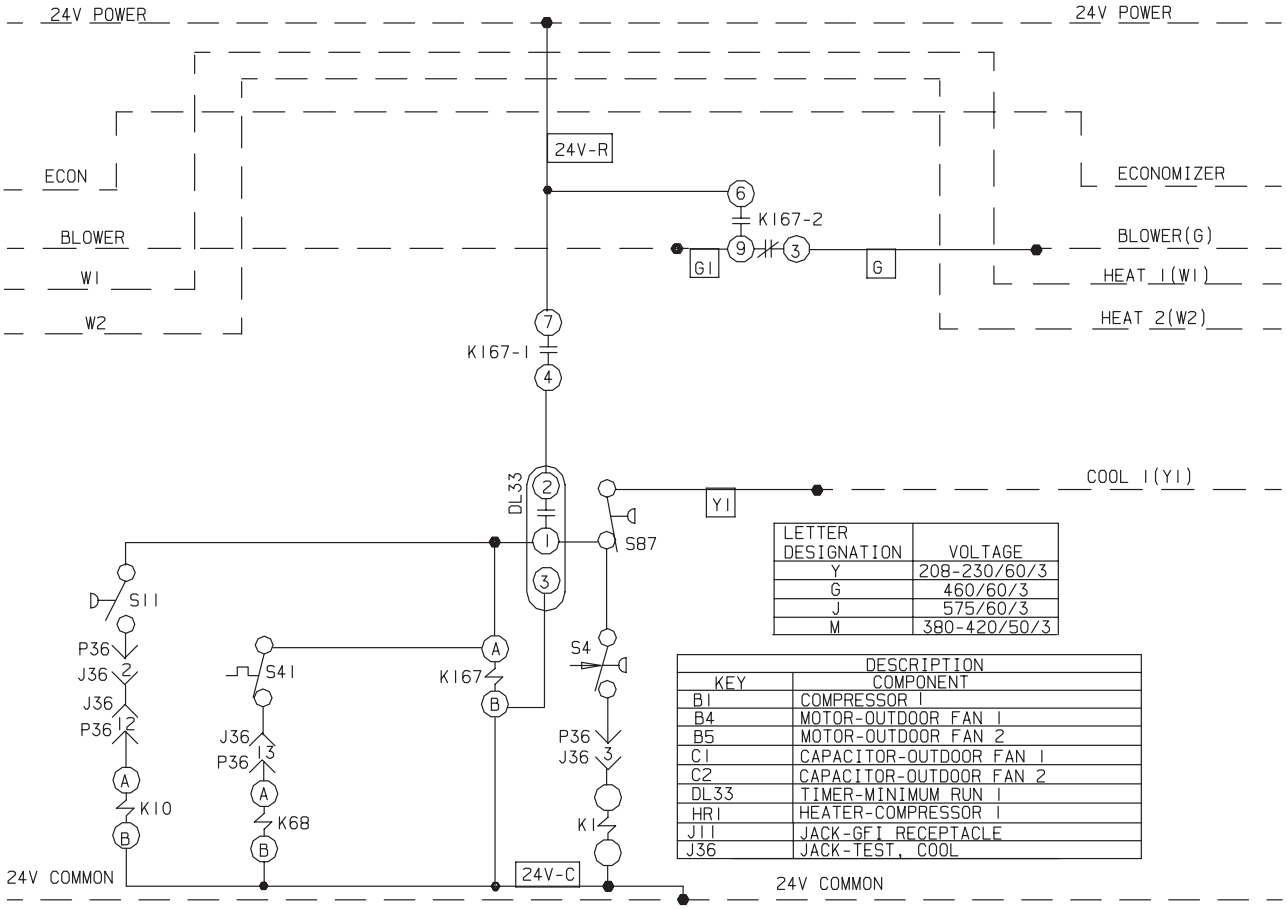

LETTER DESIGNATION	VOLTAGE
Y	208-230/60/3
G	460/60/3
J	575/60/3
M	380-420/50/3

KEY	DESCRIPTION COMPONENT
B1	COMPRESSOR 1
B4	MOTOR-OUTDOOR FAN 1
B5	MOTOR-OUTDOOR FAN 2
C1	CAPACITOR-OUTDOOR FAN 1
C2	CAPACITOR-OUTDOOR FAN 2
DL33	TIMER-MINIMUM RUN 1
HR1	HEATER-COMPRESSOR 1
J11	JACK-GFI RECEPTACLE
J36	JACK-TEST, COOL

DENOTES OPTIONAL COMPONENT CONNECTIONS

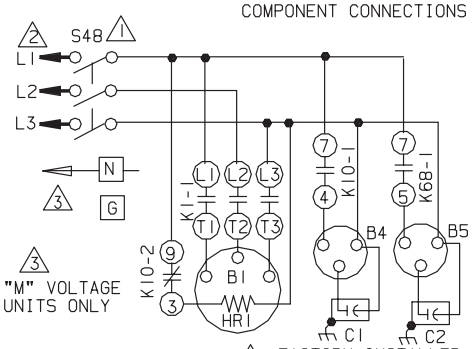

K1,-1	CONTACTOR-COMPRESSOR 1
K10,-1,2	RELAY-OUTDOOR FAN 1
K68,-1	RELAY-OUTDOOR FAN 2
K167,-1,2	RELAY-LATCHING 1
P36	PLUG-TEST, COOL
S4	SWITCH-LIMIT,HI PRESS COMP 1
S11	SWITCH-LOW PRESS,LOW AMB KIT
S41	THERMOSTAT-LOW AMBIENT KIT
S48	SWITCH-DISCONNECT
S87	SWITCH-LOW PRESS,COMP 1

WARNING-ELECTRIC SHOCK HAZARD,CAN CAUSE INJURY OR DEATH. UNIT MUST BE GROUNDED IN ACCORDANCE WITH NATIONAL AND LOCAL CODES

DISCONNECT ALL POWER BEFORE SERVICING



1 FACTORY INSTALLED OPTION

2 REFER TO UNIT RATING PLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.

IF ANY WIRE IN THIS APPLIANCE IS REPLACED,IT MUST BE REPLACED WITH WIRE OF LIKE SIZE,RATING AND INSULATION THICKNESS

FOR USE WITH COPPER CONDUCTORS ONLY

WIRING DIAGRAM	0200
COOLING UNITS-CONDENSING UNITS	
LSA-120C-Y,G,J,M	
COOLING SECTION-B41	
Supersedes Form No. 531,674W	New Form No. 533,413W

© 2000 Lennox Industries Inc

Litho U.S.A.