



- | | | |
|----|--------------------------|----|
| 90 | Condenser Fan Motor | 95 |
| 85 | Compressor Motor | |
| 80 | Electric Heater | |
| 75 | Thermal Protection | |
| 70 | Circuit Breaker | |
| 65 | Internal Fan Motor | |
| 60 | High Pressure Pressostat | |
| 55 | Indicators Plate | |
| 50 | Contactor | |
| 45 | Low Pressure Pressostat | |
| 40 | Security Thermostat | |
| 35 | Printed Circuit Board | |
| 30 | Remote Control | |
| 25 | Reverse Valve | |
| 20 | Secuence Change | |
| 15 | Timer Defrost | |
| 10 | Timer Delay | |
-
- | | | |
|----|-----------------------------|----|
| 90 | Motor Ventilador Exterior | 95 |
| 85 | Calculador de Críter | |
| 80 | Motor del Compresor | |
| 75 | Batería Eléctrica | |
| 70 | Protección Térmica | |
| 65 | Magneto Térmico | |
| 60 | Motor Ventilador Interior | |
| 55 | Presostato de Alta | |
| 50 | Placa Indicadores | |
| 45 | Contactor | |
| 40 | Presostato de Bajo | |
| 35 | Termostato de Seguridad | |
| 30 | Placa Circuito Impreso | |
| 25 | Control Remoto | |
| 20 | Válvula Inversora | |
| 15 | Cambio de Secuencia | |
| 10 | Temporizador de Desescarche | |
| 5 | Temporizador | |

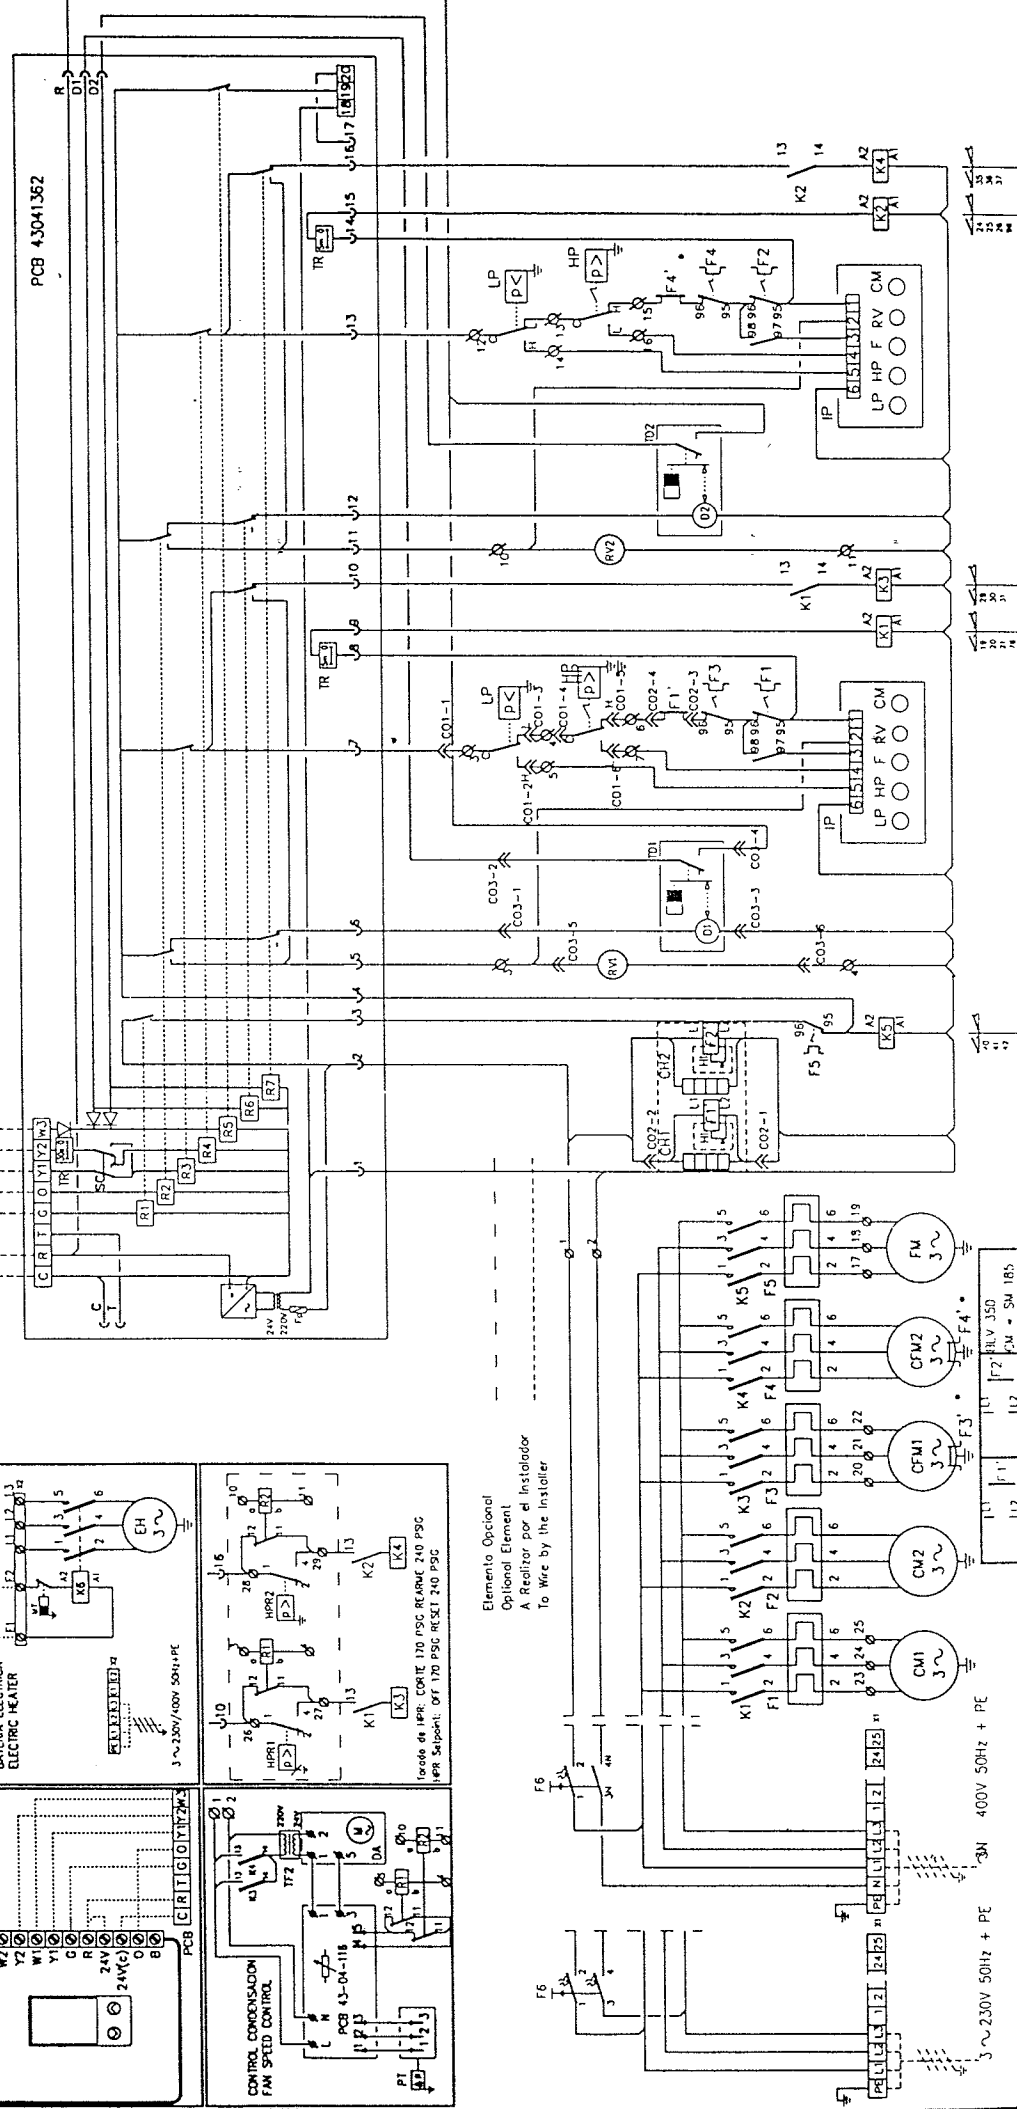

ELEMENTOS OPCIONALES / OPTIONAL ELEMENTS

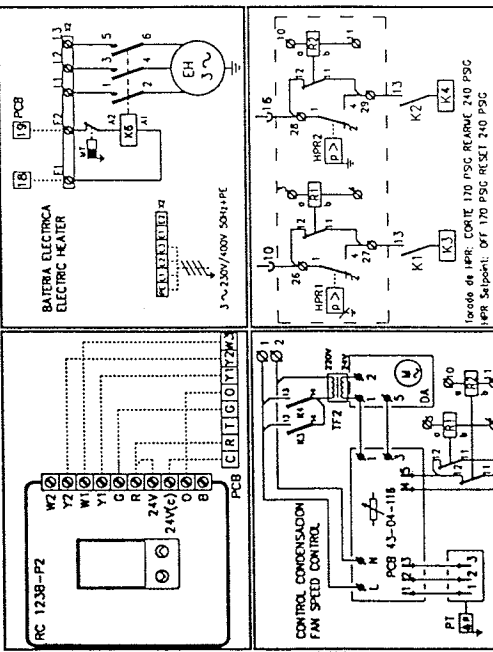

Elemento Opcional
Optional Element
A Realizar por el Instalador
To Wire by the Installer