

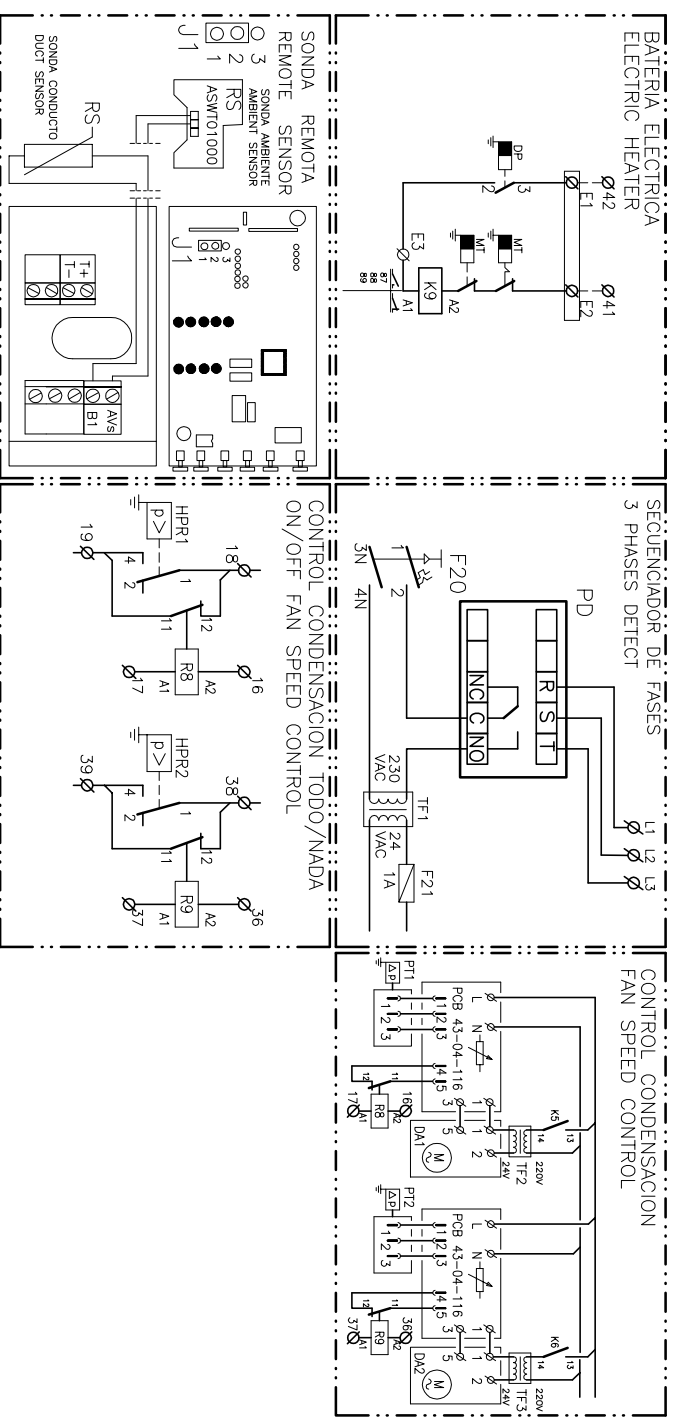
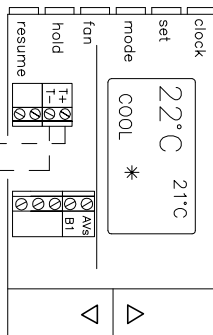


ELEMENTOS OPCIONALES / OPTIONAL ELEMENTS

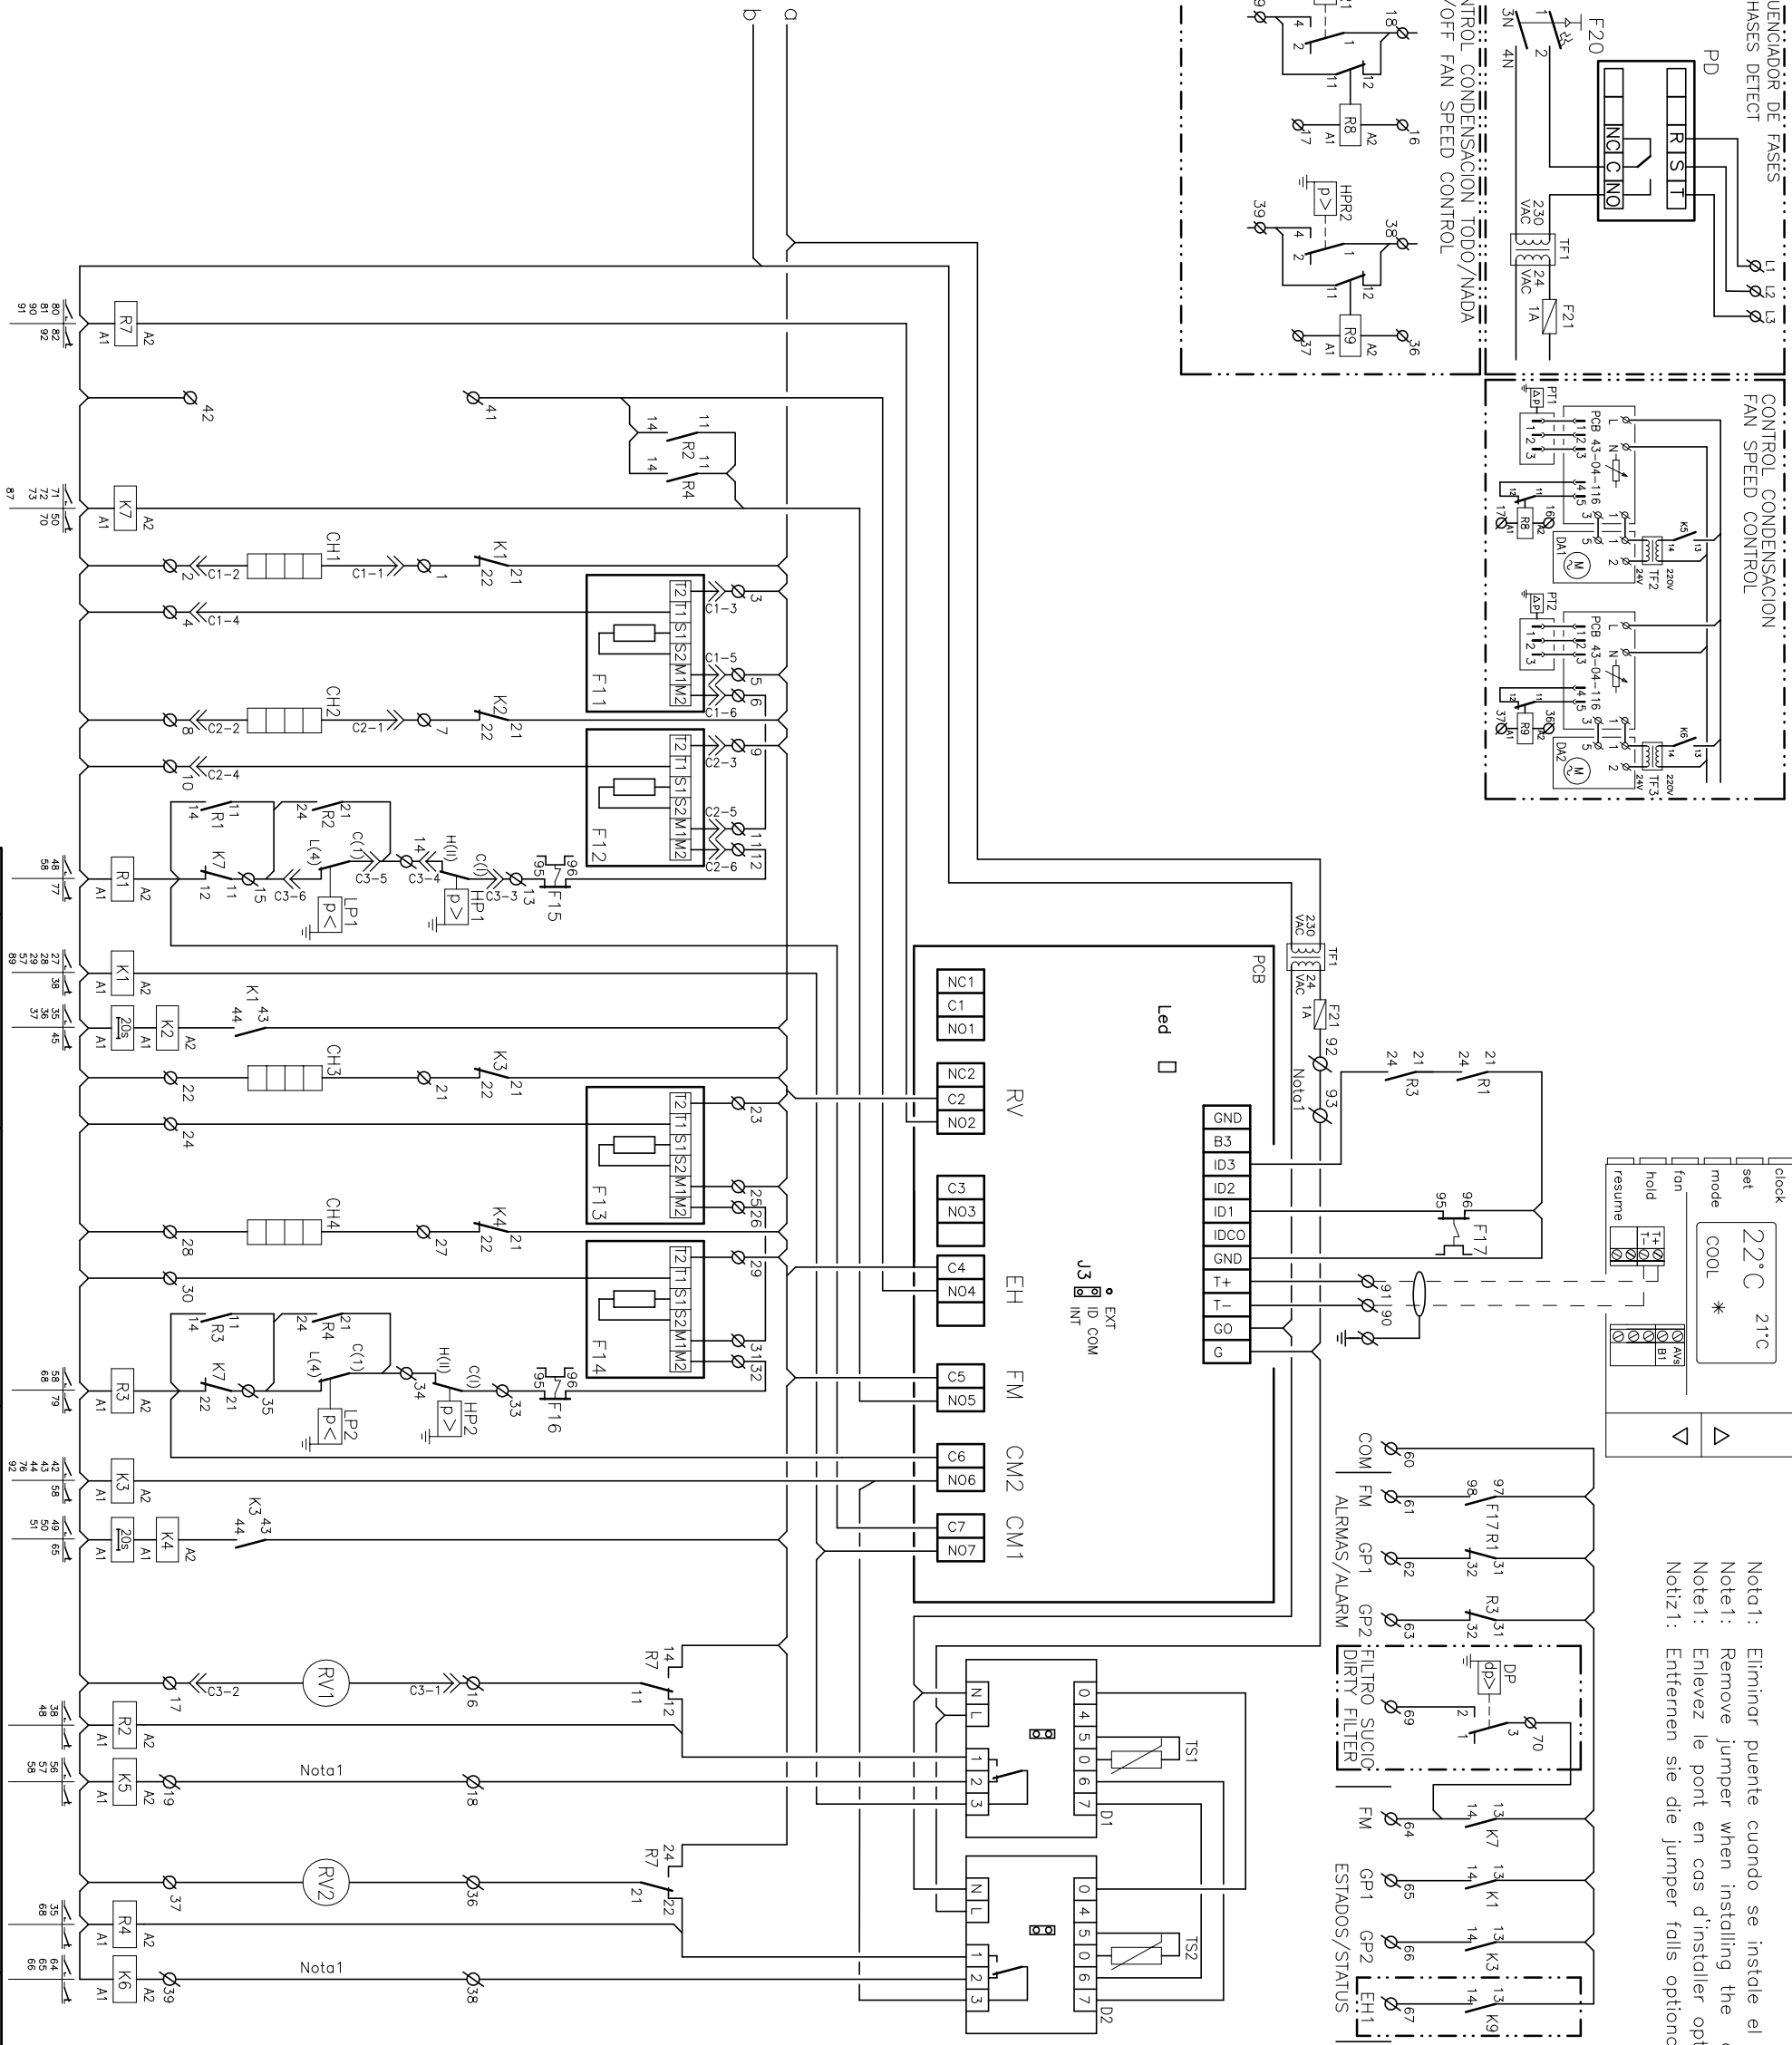


CONEXIONES ELECTRICAS / ELECTRICAL CONNECTIONS

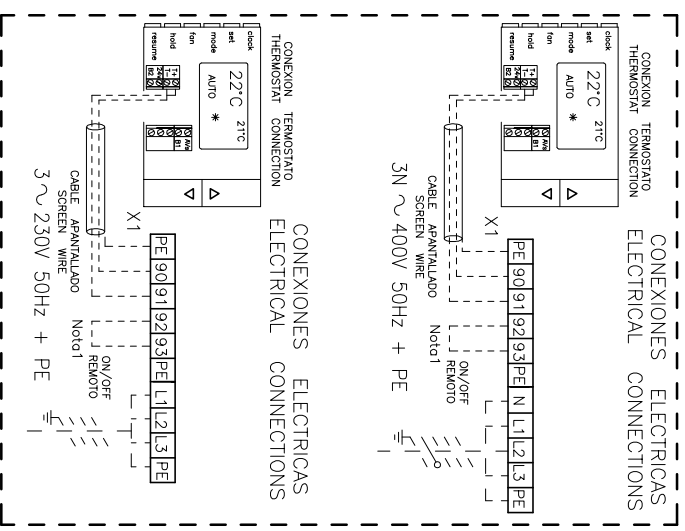

Nota1: Eliminar puente cuando se instale el opcional  
 Note1: Remove jumper when installing the optional  
 Note1: Enlevez le pont en cas d'installer optional  
 Notiz1: Entfernen sie die jumper falls optional angebrochen ist

0 5 10 15 20 25 30 35 40 45 50 55 60 65 70 75 80 85 90 95

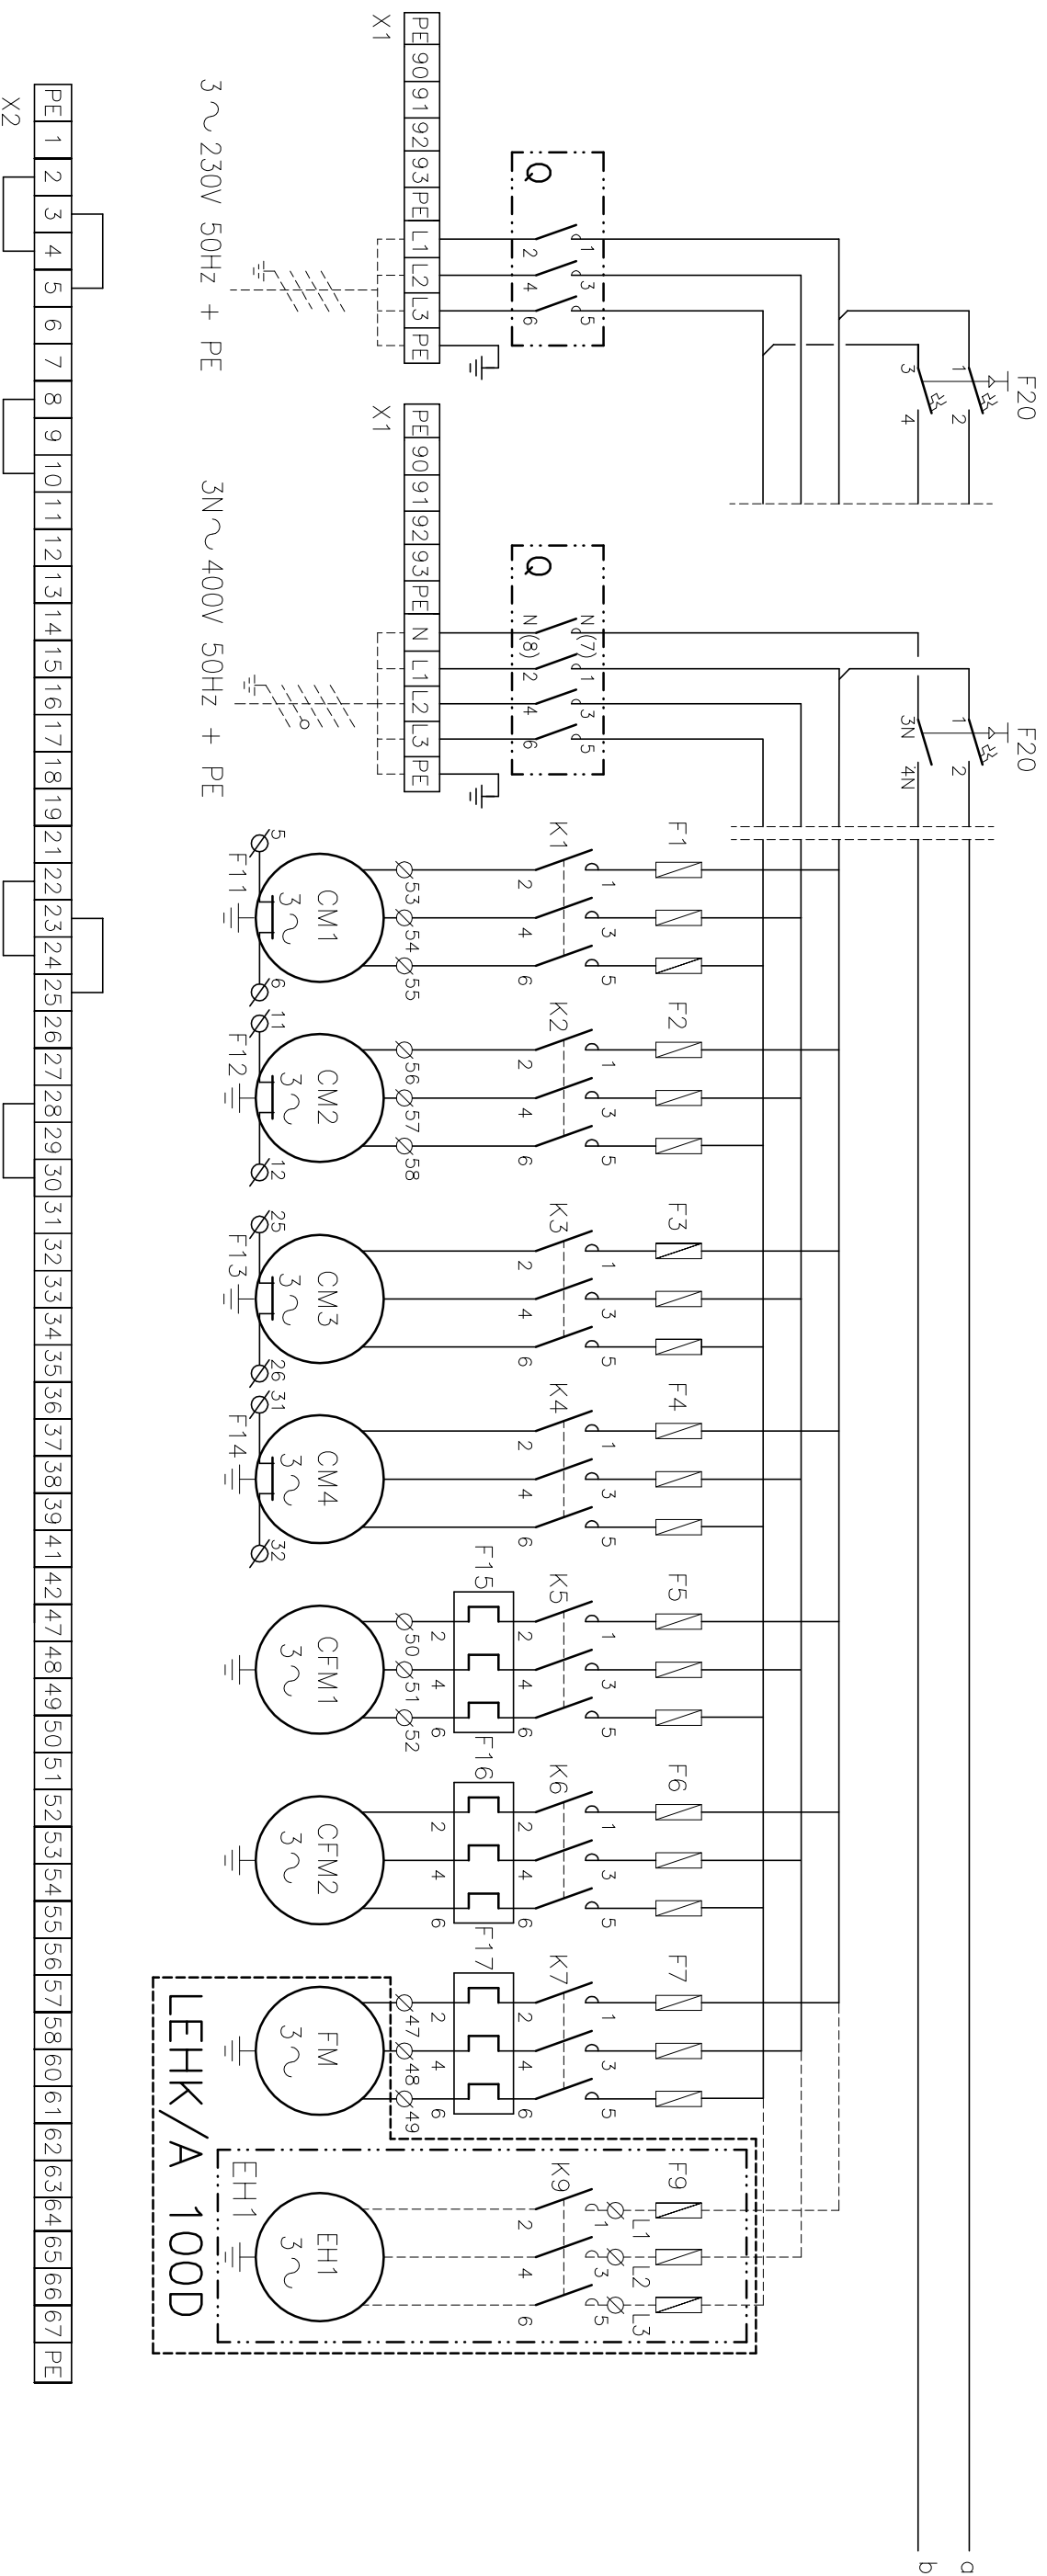

Elemento Opcional  
 Optional Element  
 A Realizor por el Instalador  
 To Wire by the Installer

Fusibles	F1-F2-F3-F4	F5-F6-F7
Fuses size	LHK/A 1000	
	230/3/50 4x 3 x 40A 3x 3 x 25A	
	400/3/50 4x 3 x 25A 3x 3 x 16A	

2/2

Lennox Refrac S.A.

ESQUEMA ELECTRICO  
 ELECTRIC DIAGRAM

LCHK (LEHK+KVHK) 100D  
 LVHA (LEHA+KVHA) 100D

32-33-453-811 28E  
 3N 400V 50HZ + PE  
 3 ~ 220V 50HZ + PE