
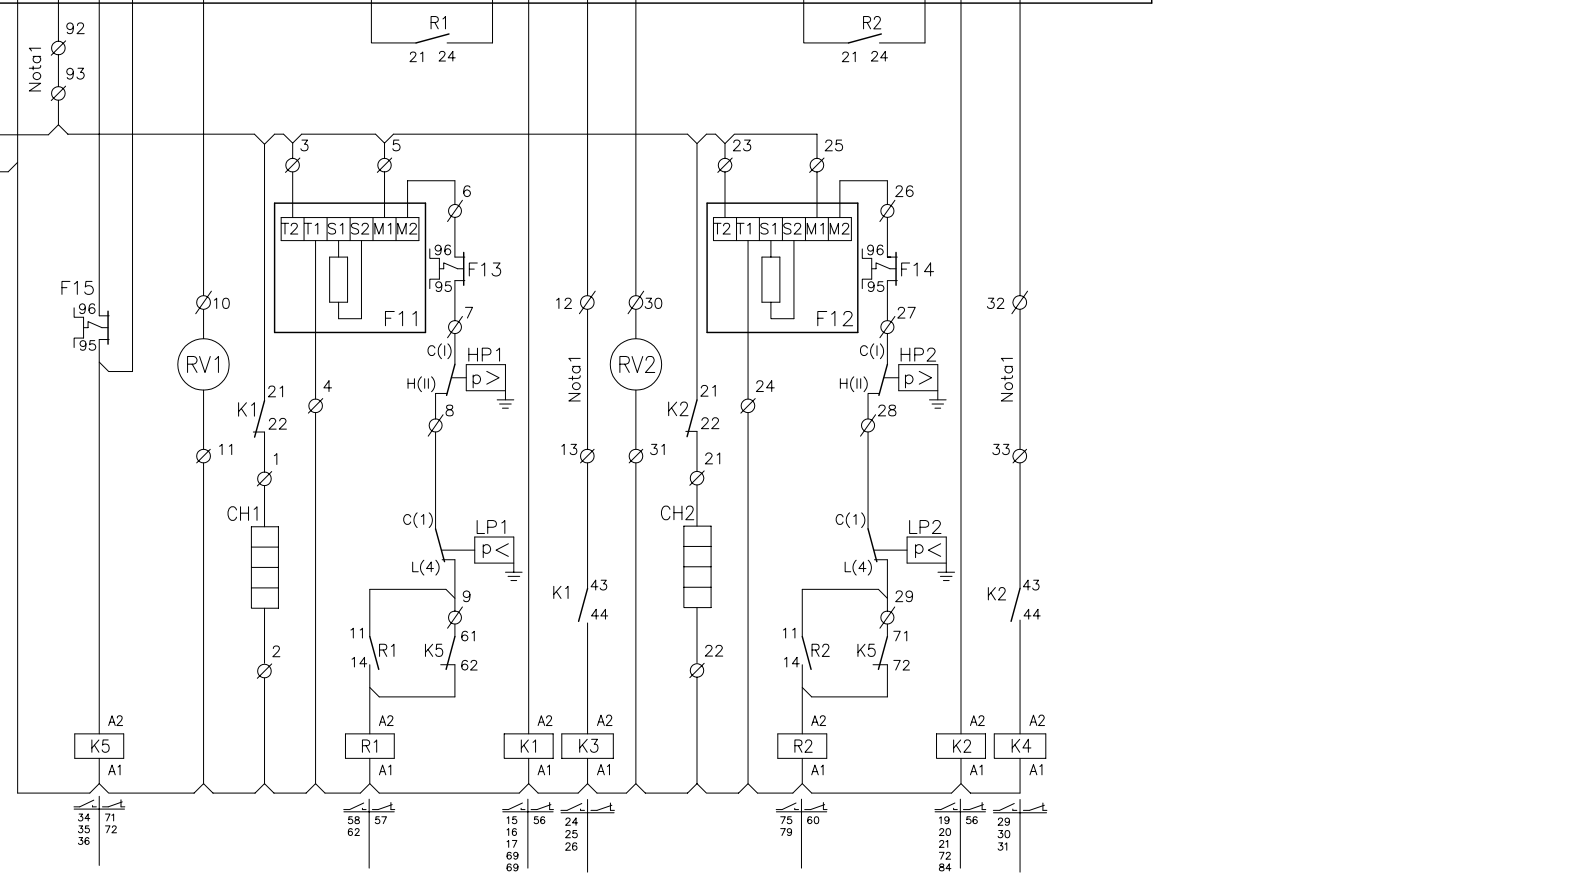


Elemento Opcional / Optional Element
 A Realizar por el Instalador / To Wire by the Installer

Fusibles / Fuses size	F1 - F2		F3-F4-F5
	LVHA/K 64D	LVHA/K 76D	
230/3/50	2x 3 x 50A	2x 3 x 63A	3x 3 x 16A
400/3/50	2x 3 x 25A	2x 3 x 32A	3x 3 x 10A

Nota1: Eliminar puente cuando se instale el opcional
 Note1: Remove jumper when installing the optional
 Note1: Enlevez le pont en cas d'installer optional
 Notiz1: Entfernen sie die jumper falls optional angebrochen ist

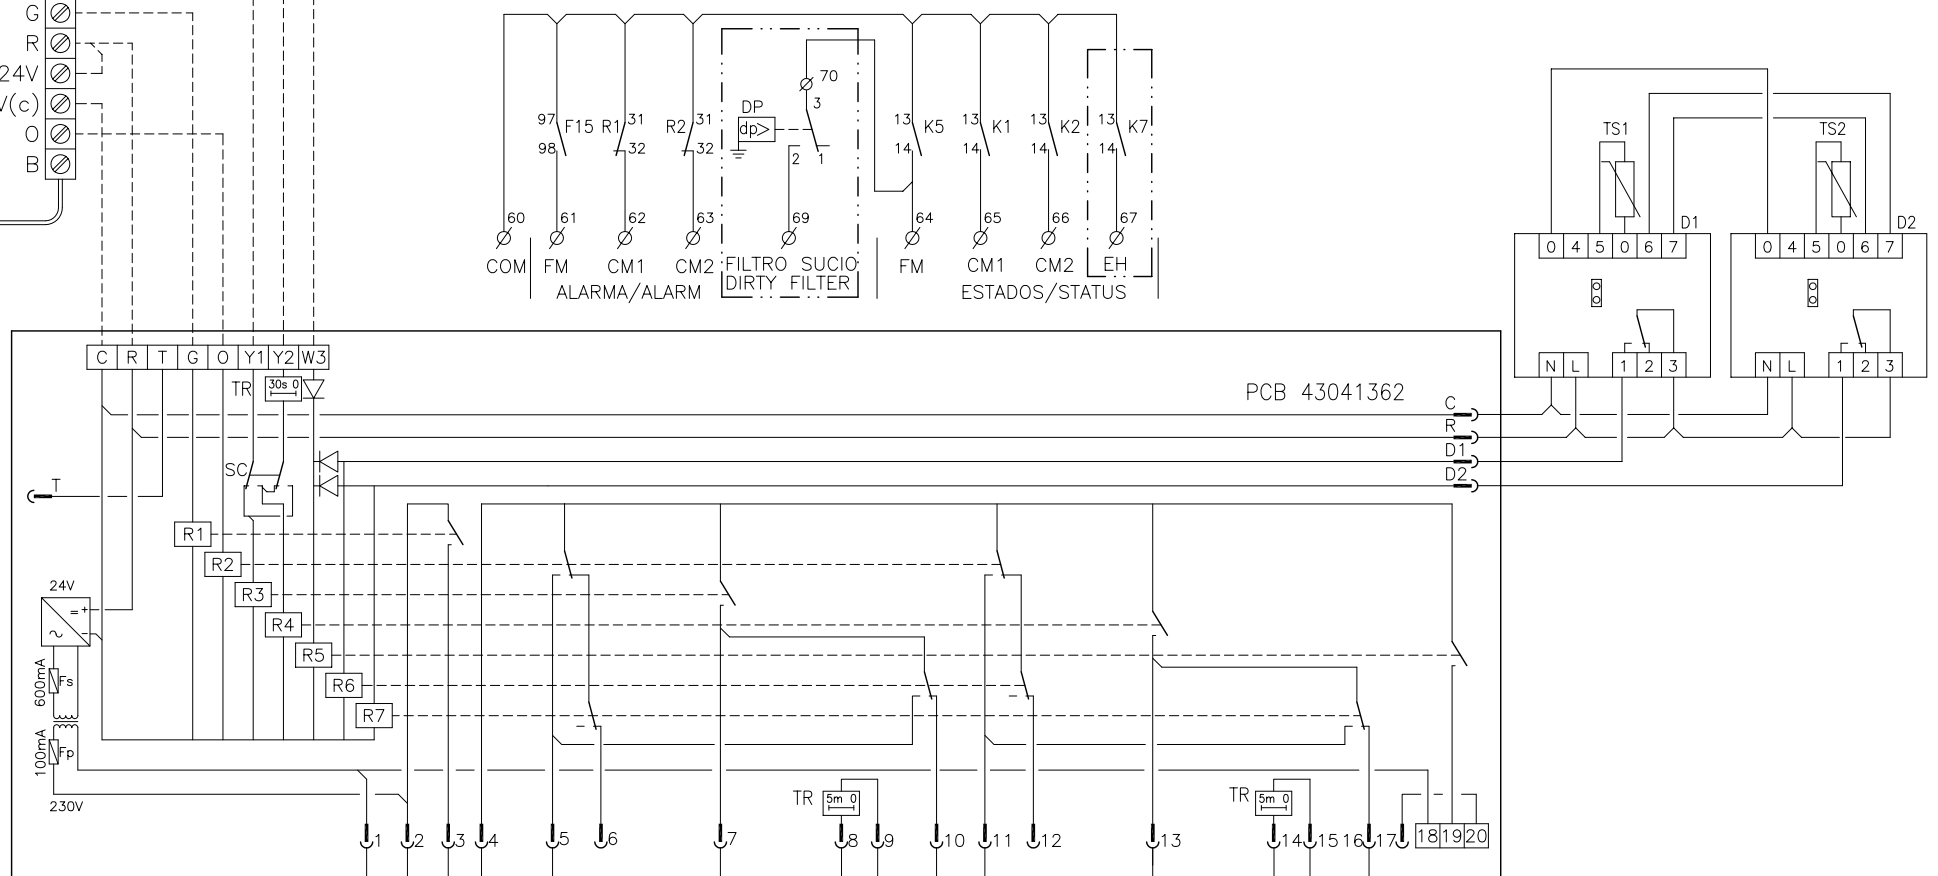

VERSION VFC / VFC VERSION

Lennox Refac S.A.	ESQUEMA ELECTRICO / ELECTRIC DIAGRAM	LVHK (LEHK+KVHK) 64D-76D	3Z-33-500-154 03C
		LVHA (LEHA+KVHA) 64D-76D	3N 400V 50HZ + PE 3 ~ 220V 50HZ + PE