
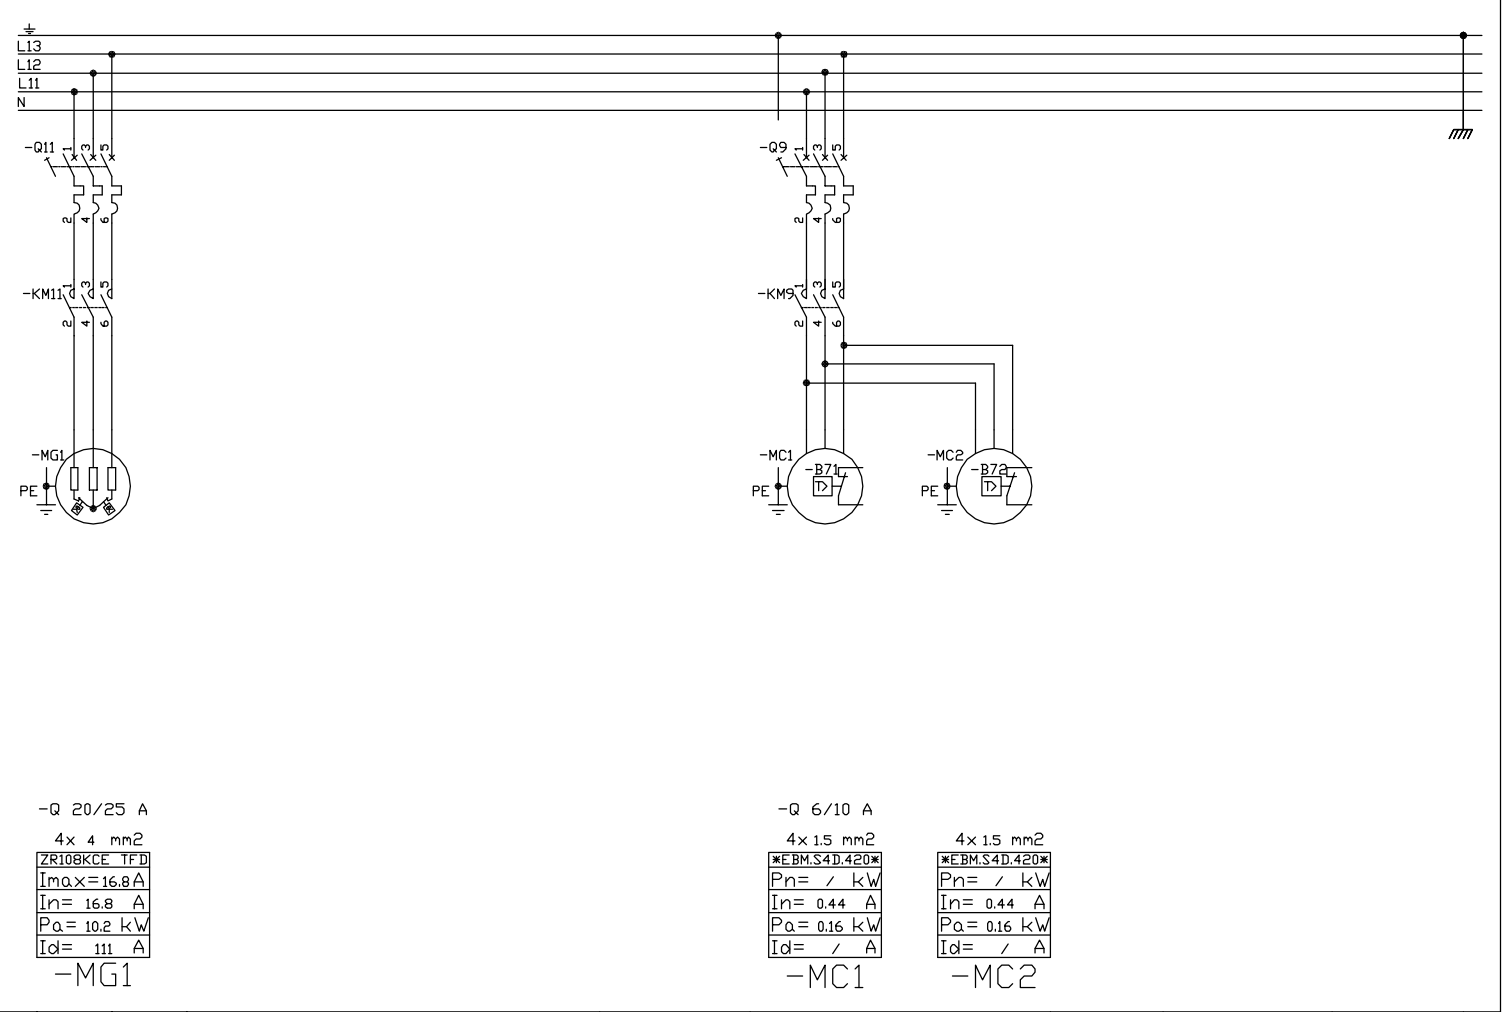
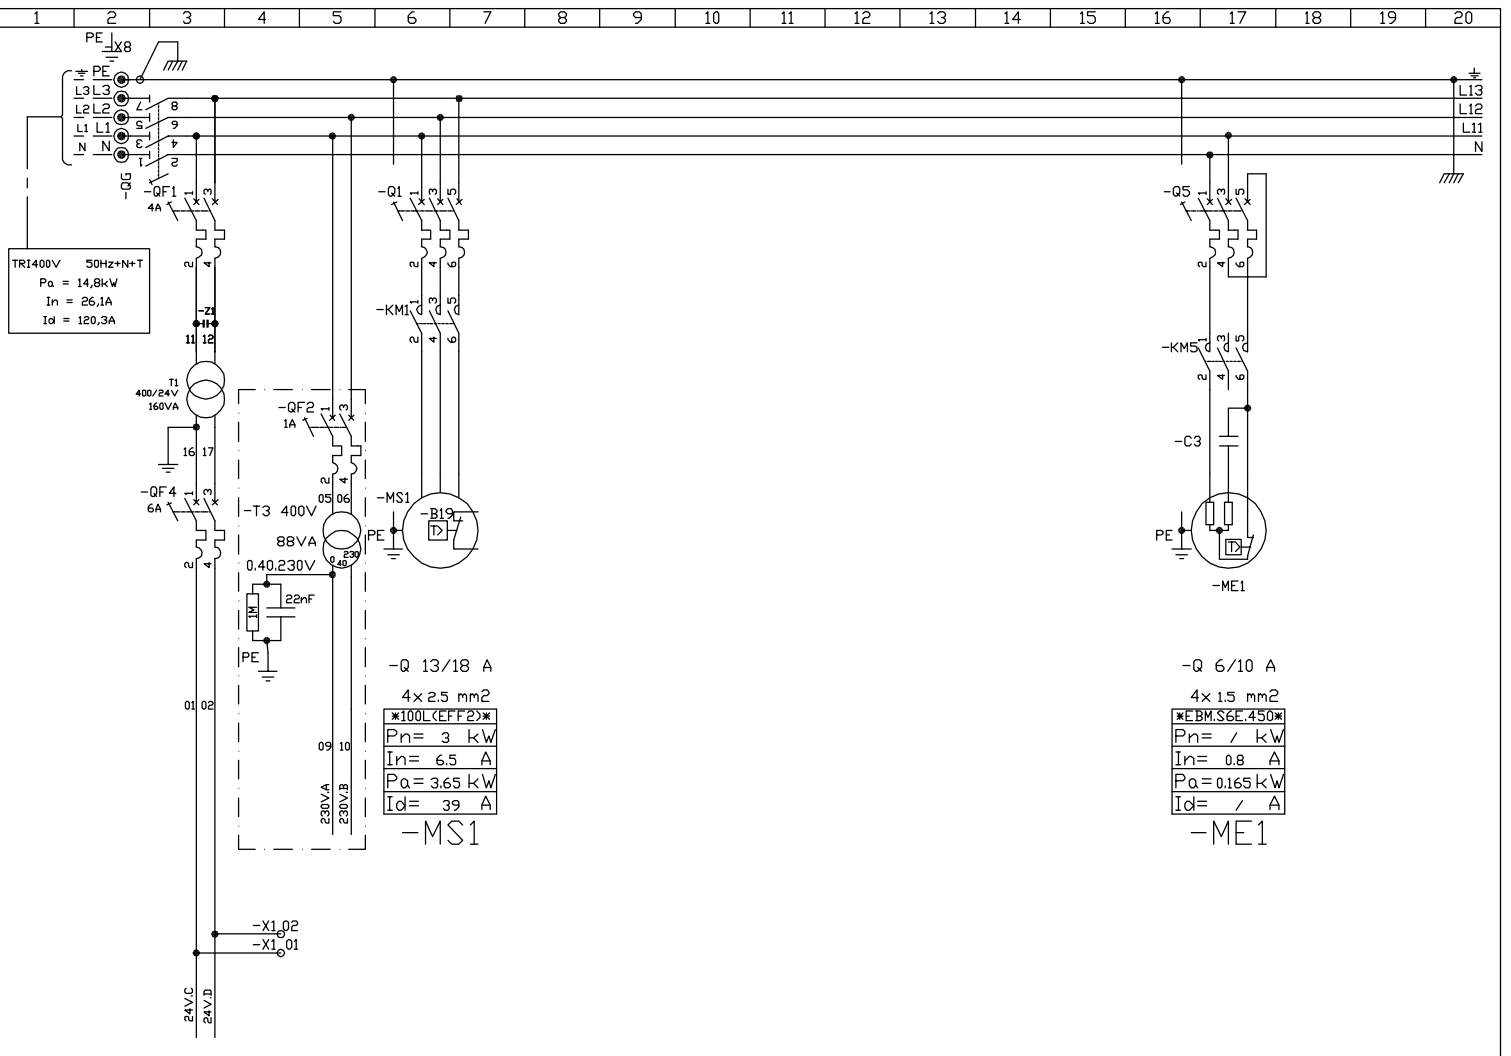
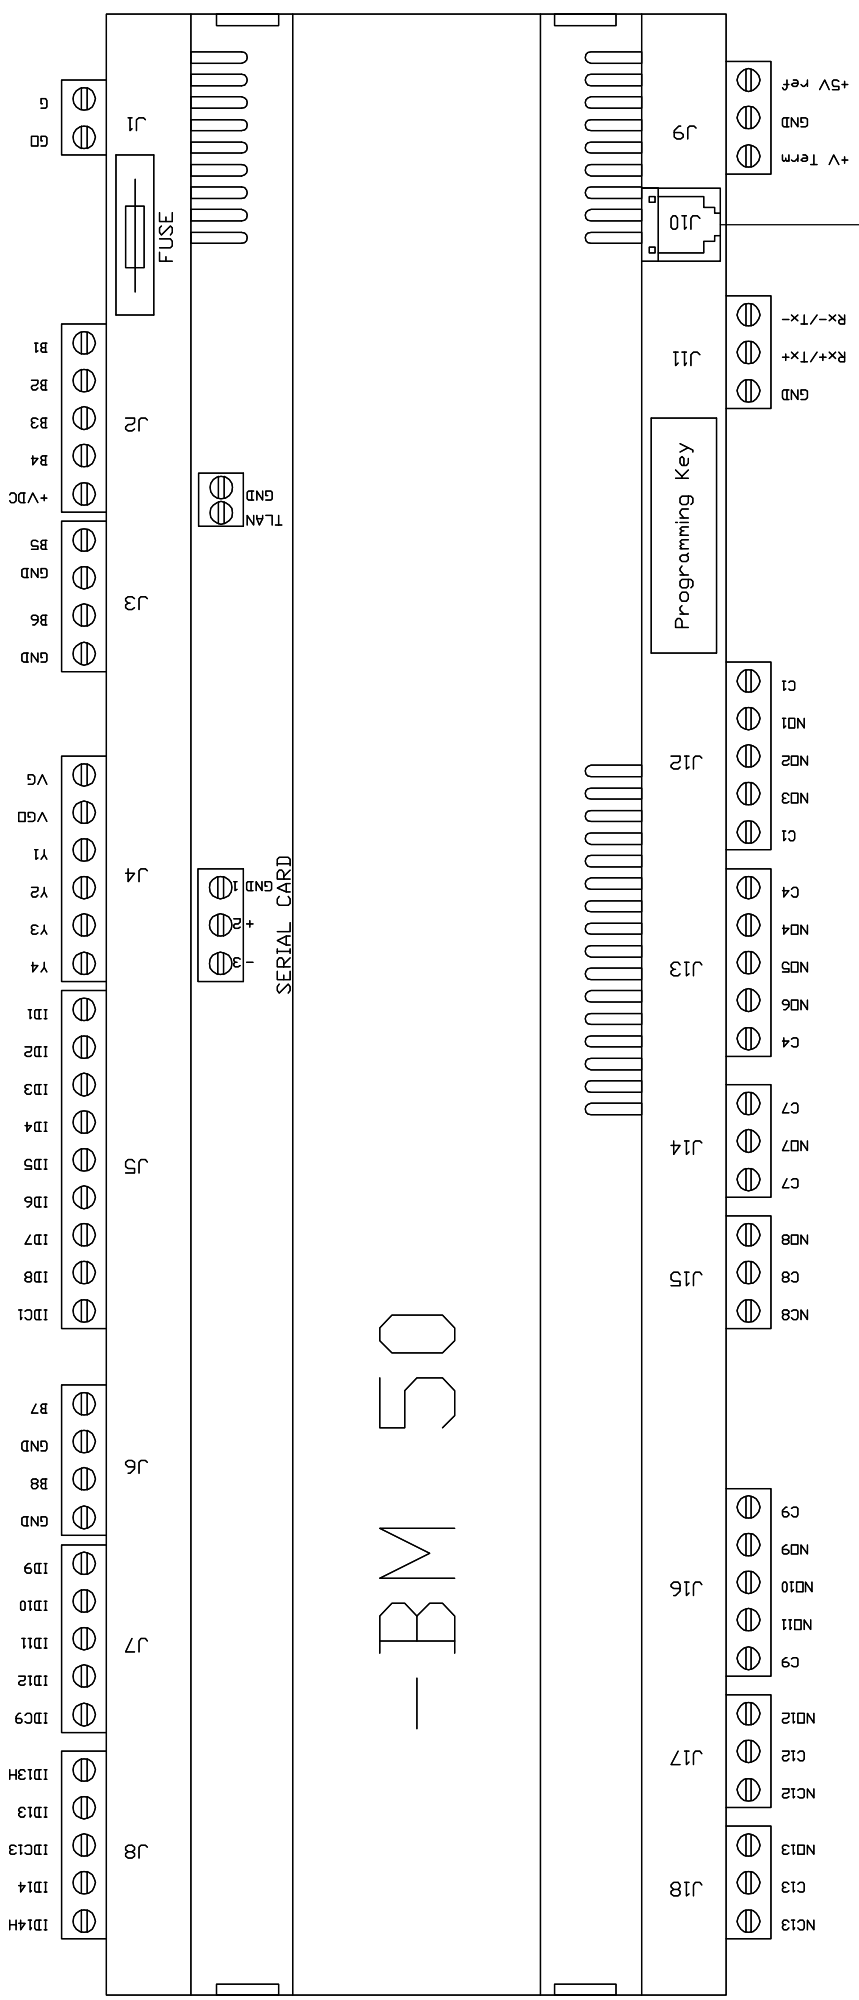
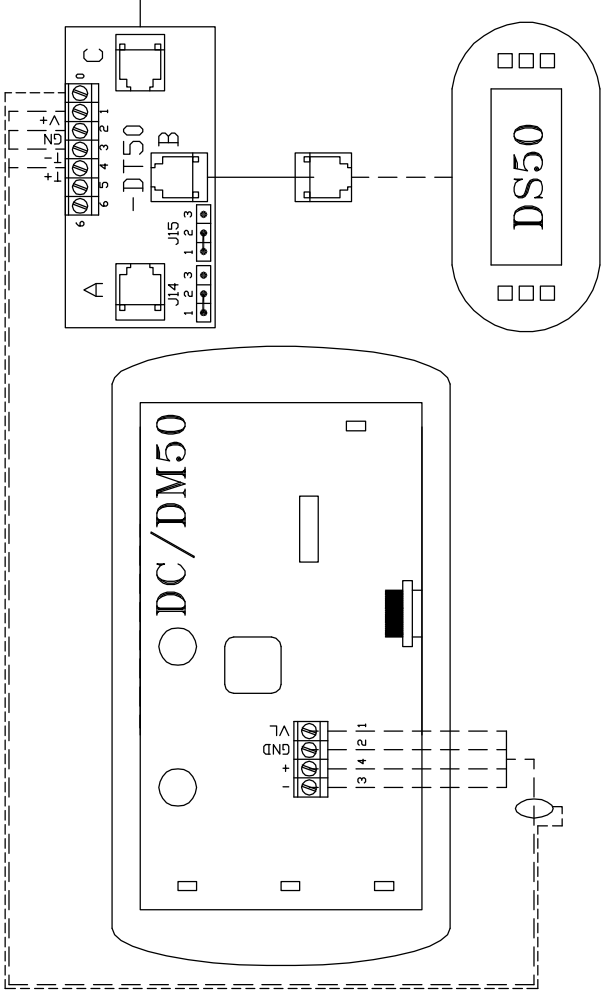


Indice	DATE	NOM	MODIFICATIONS		
					
<i>10th Pizza Hut Stock Order</i>					
(4) BDK 025 HS <b>LENNOX UK</b>		Dessine: CTO Date: 18.01.07	PAGE DE GARDE <table border="1" style="float: right;"> <tr> <td>252725</td> <td>0 / 11</td> </tr> </table>	252725	0 / 11
252725	0 / 11				





# - BM 50



**Input B1-B2-B3-B4**

	1	2	3	Input
OFF	OFF	OFF	OFF	0/1V
DN	OFF	OFF	DN	NTC
	OFF	DN	OFF	0/20mA
	DN	OFF	DN	0/5V

**Input B5-B6**

Input	digital input	NTC
DN	OFF	OFF


**Input B1-B2-B3-B4**

	1	2	3	Input
OFF	OFF	OFF	OFF	0/1V
DN	OFF	DN	OFF	NTC
	OFF	DN	OFF	0/20mA
	DN	OFF	DN	0/5V

**Input B5-B6**

Input	digital input	NTC
DN	OFF	OFF

AVEC TCB SANS CARTE EXTENSION  
WITHOUT EXTENSIONBOARD BE50

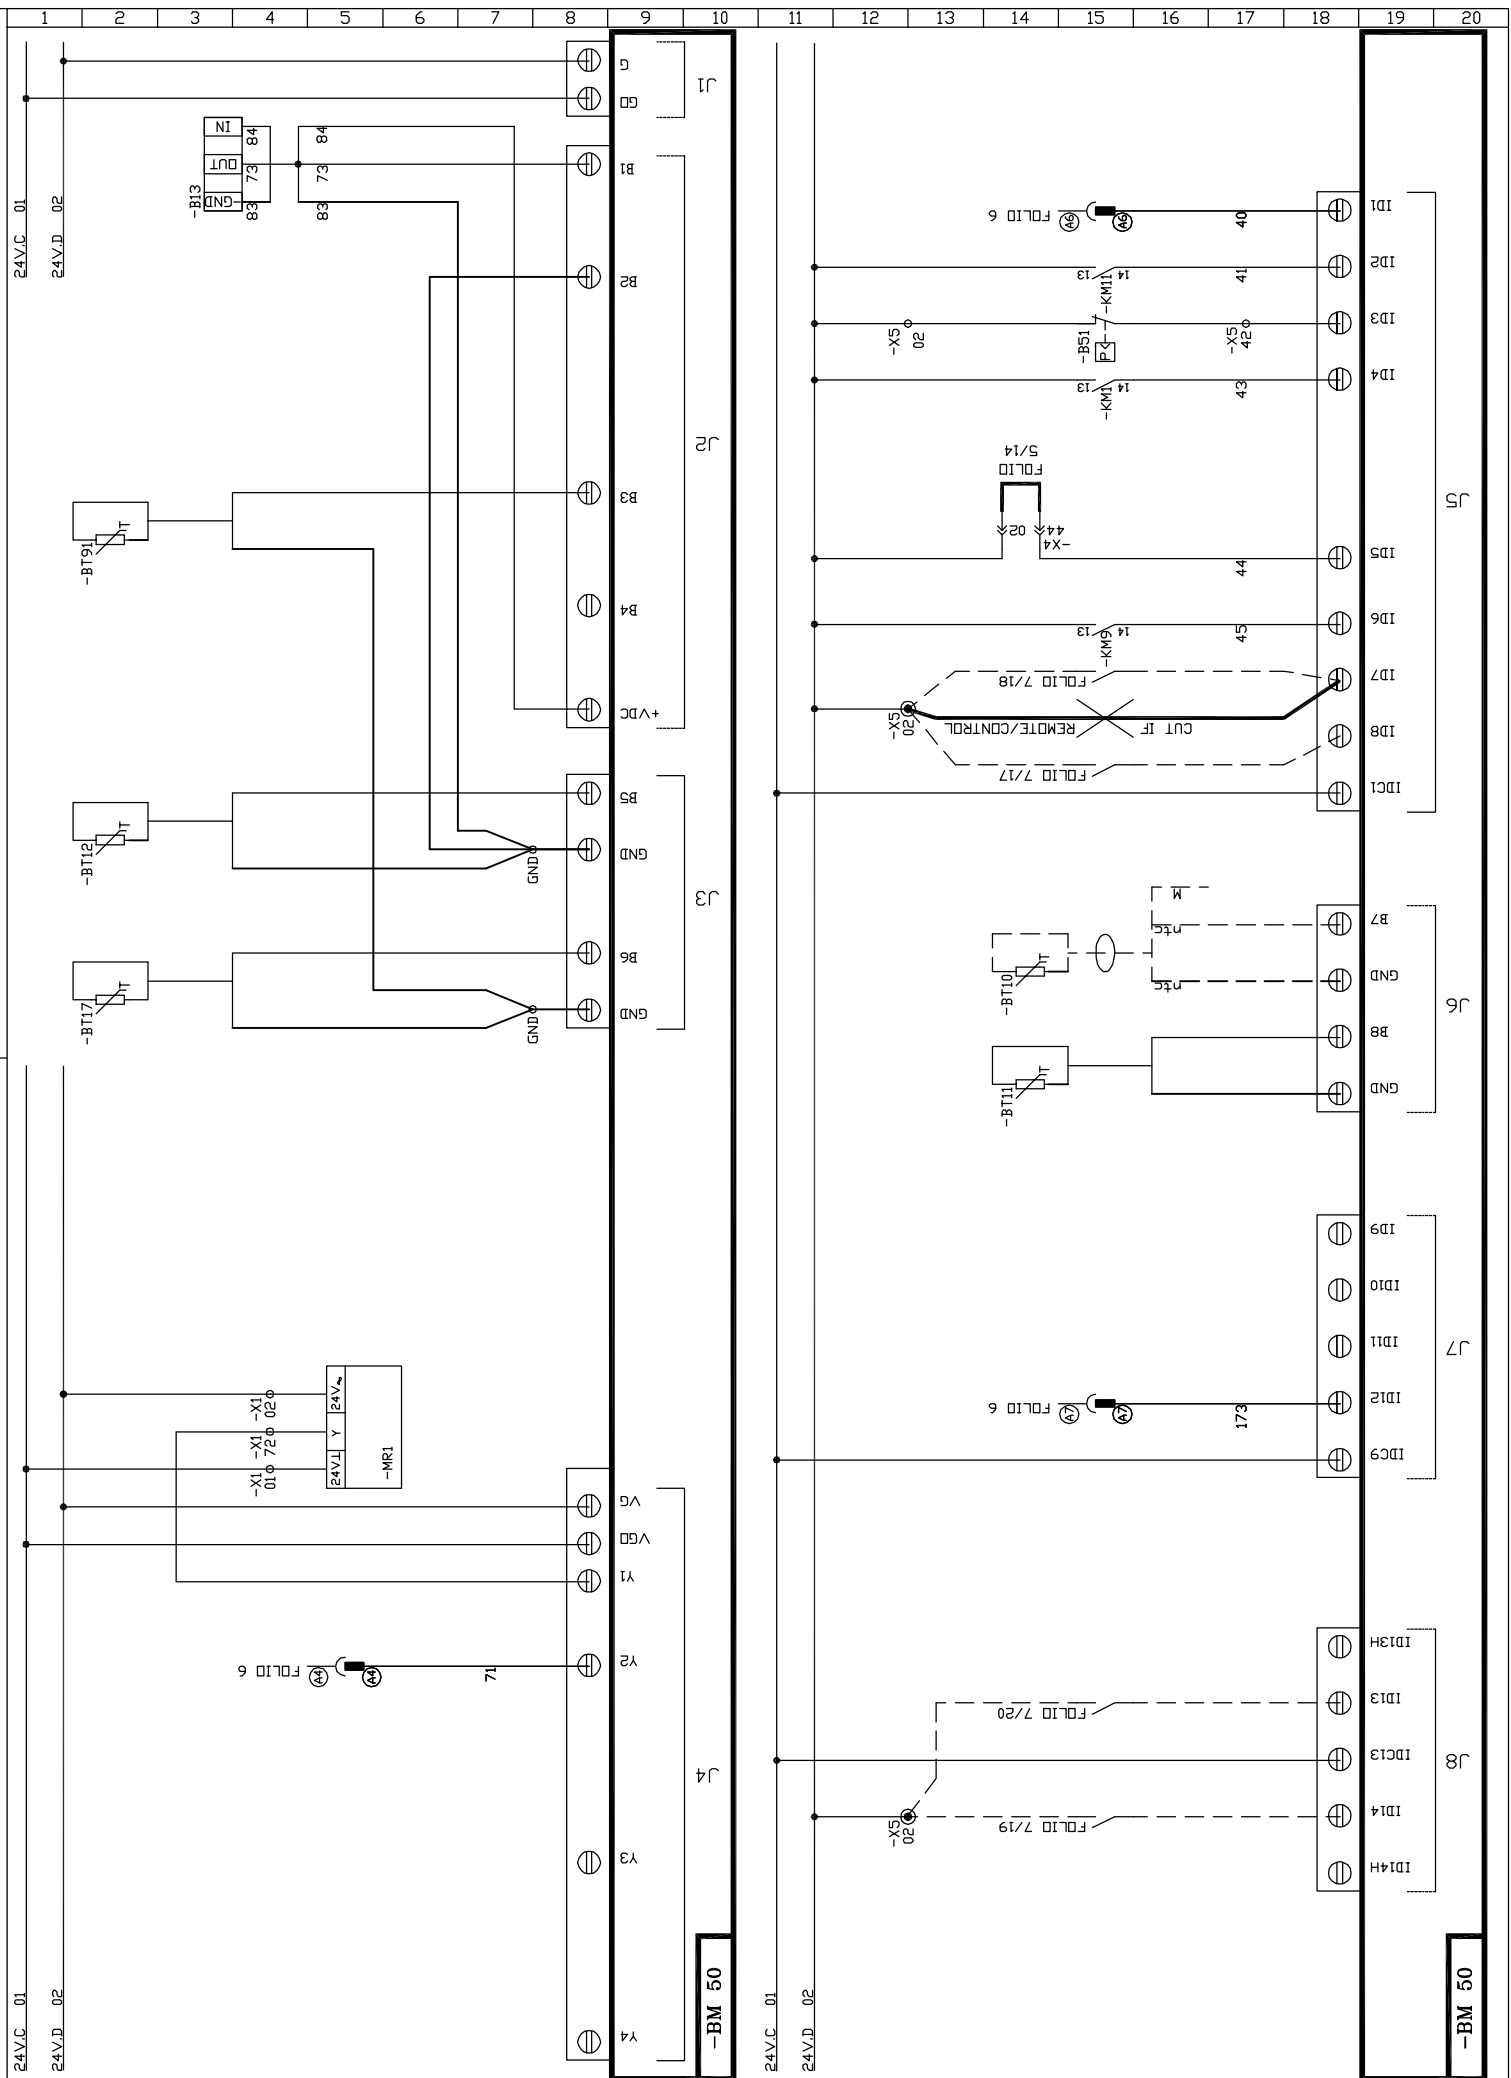


Indice	DATE	NOM	MODIFICATIONS


(4) BDK 025 HS  
Entrées Automate CLIMATIC 50  
Climatic 50 Controller Input

Dessine: CTO  
Date: 18.01.07




252725 3/11

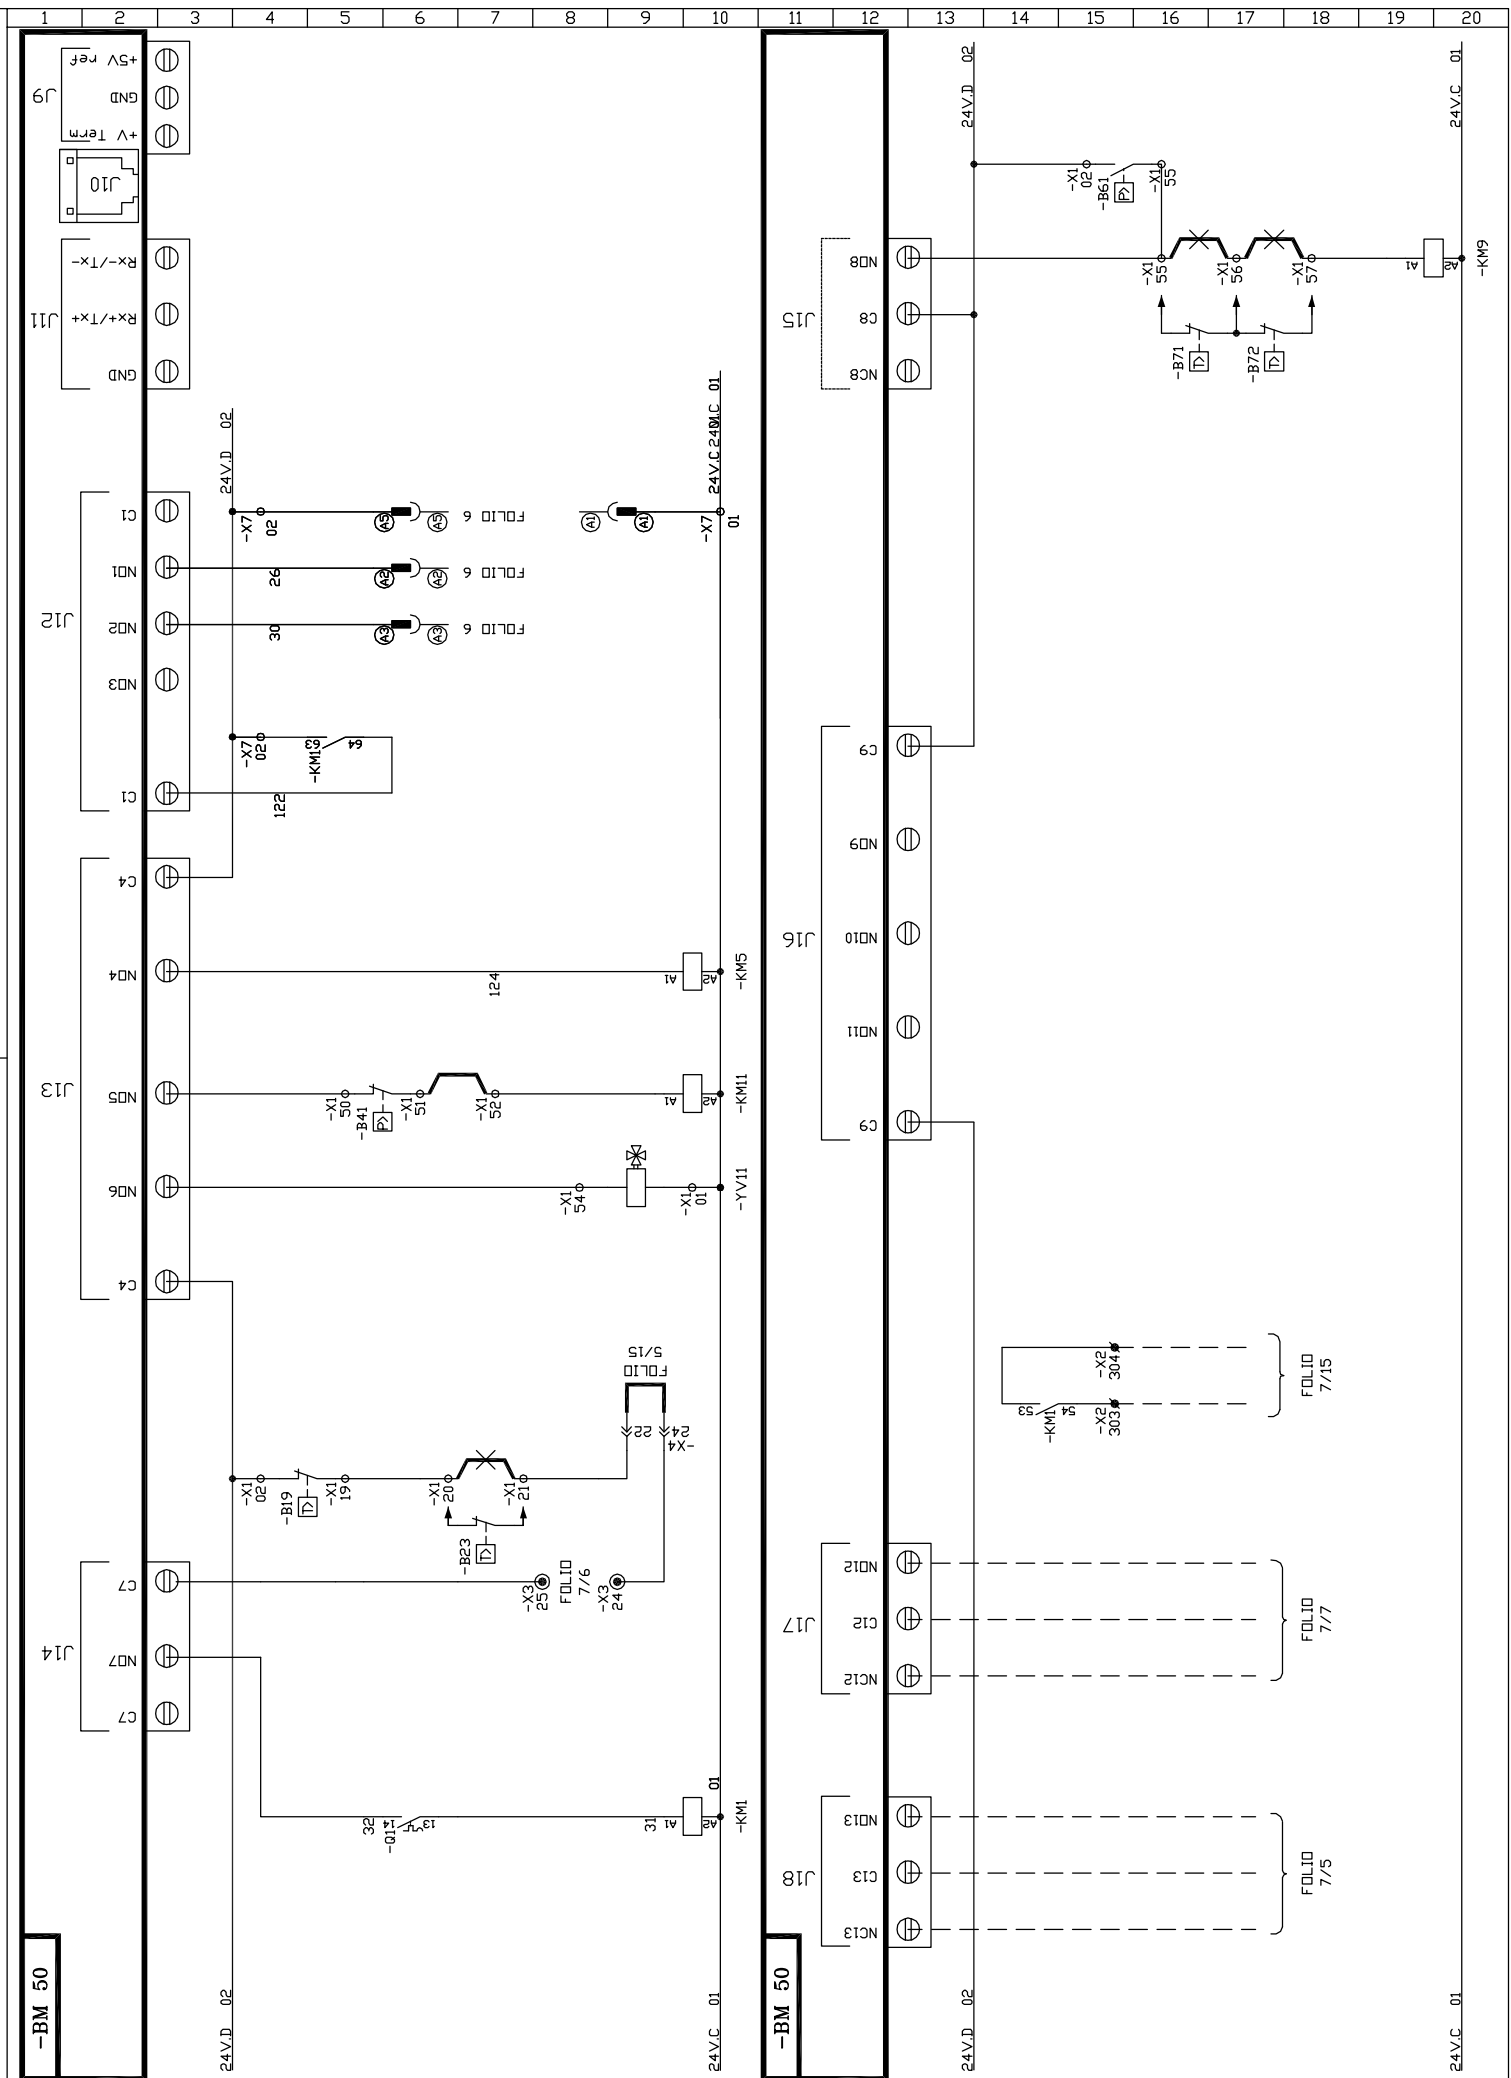

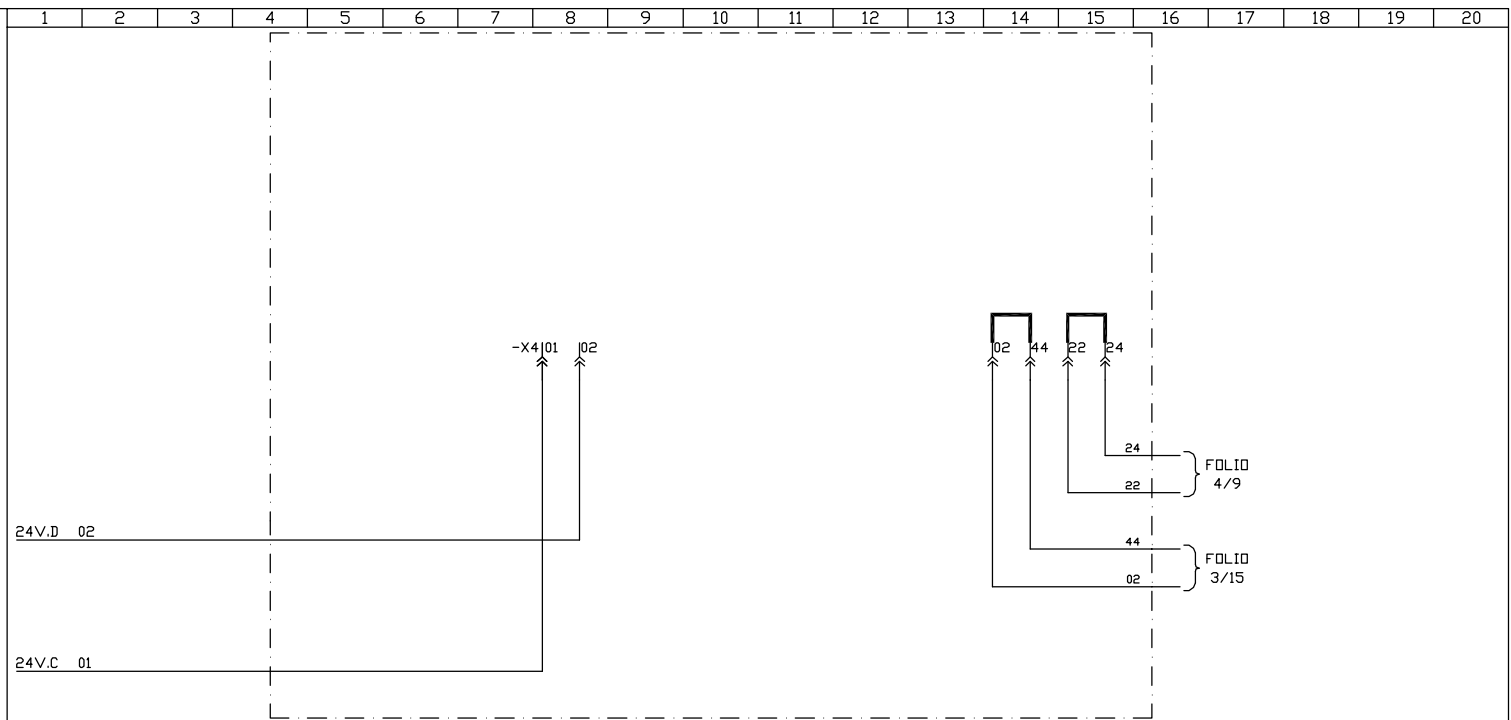

REPERE	REFERENCE	CODE	Nb
-QF2	C60N 1A BIPOL COURBE D	4480589E	1
-T3	88VA 400V/40V/230V	4430131Z	1
-RC	CIRCUIT RC 1MEG0HM - 22nF	4770012Z	1
-EF48	-EF48	4770624Z	1


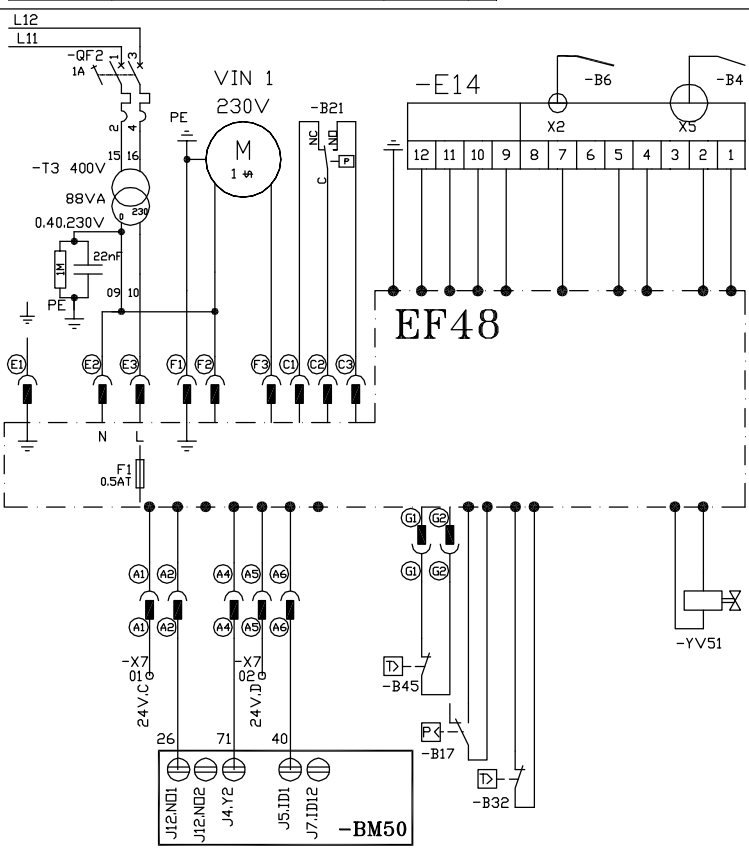


Indice	DATE	NOM	MODIFICATIONS

(4) BDK 025 HS  
Kit chauffage  
GAS


Dessine: CTO  
Date: 18.01.07



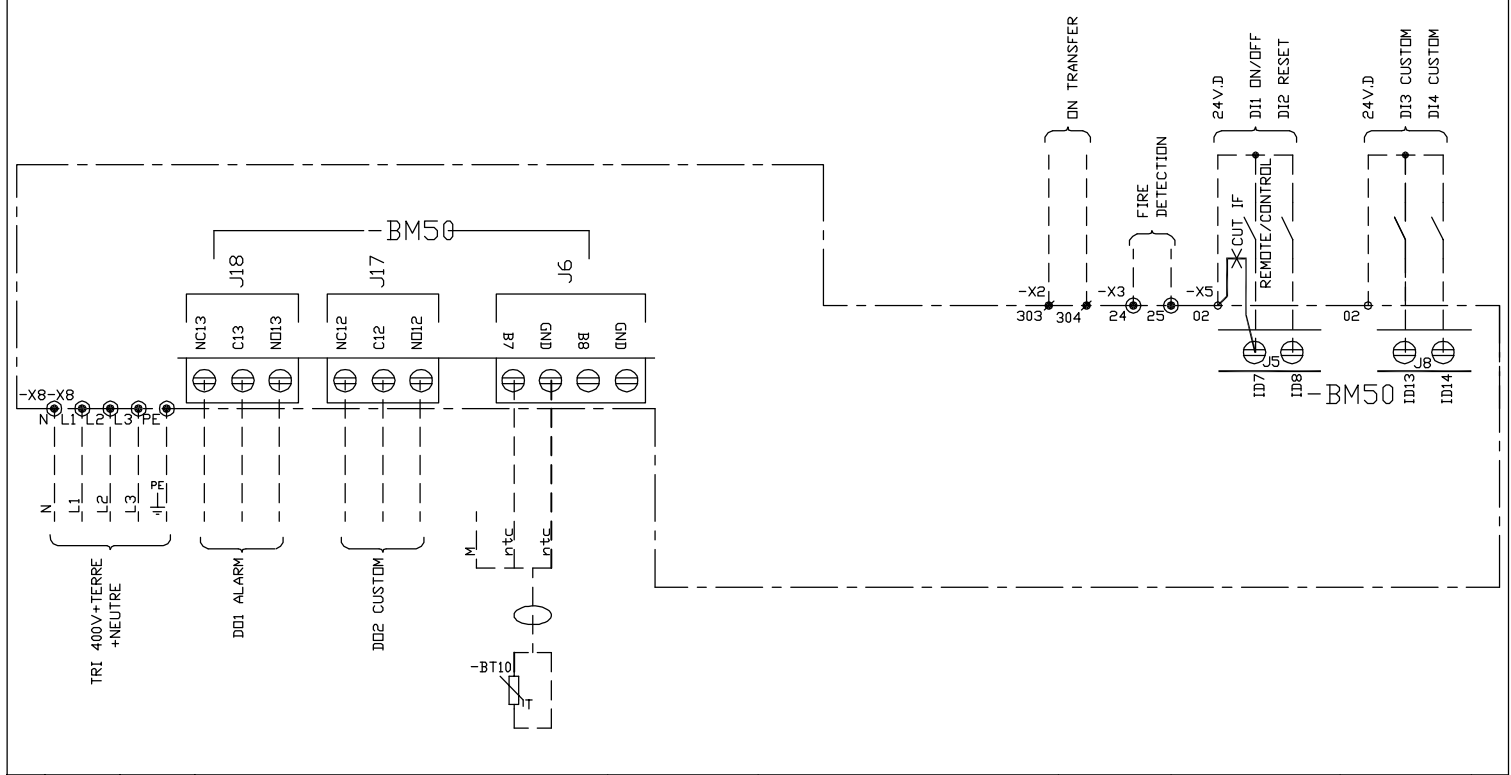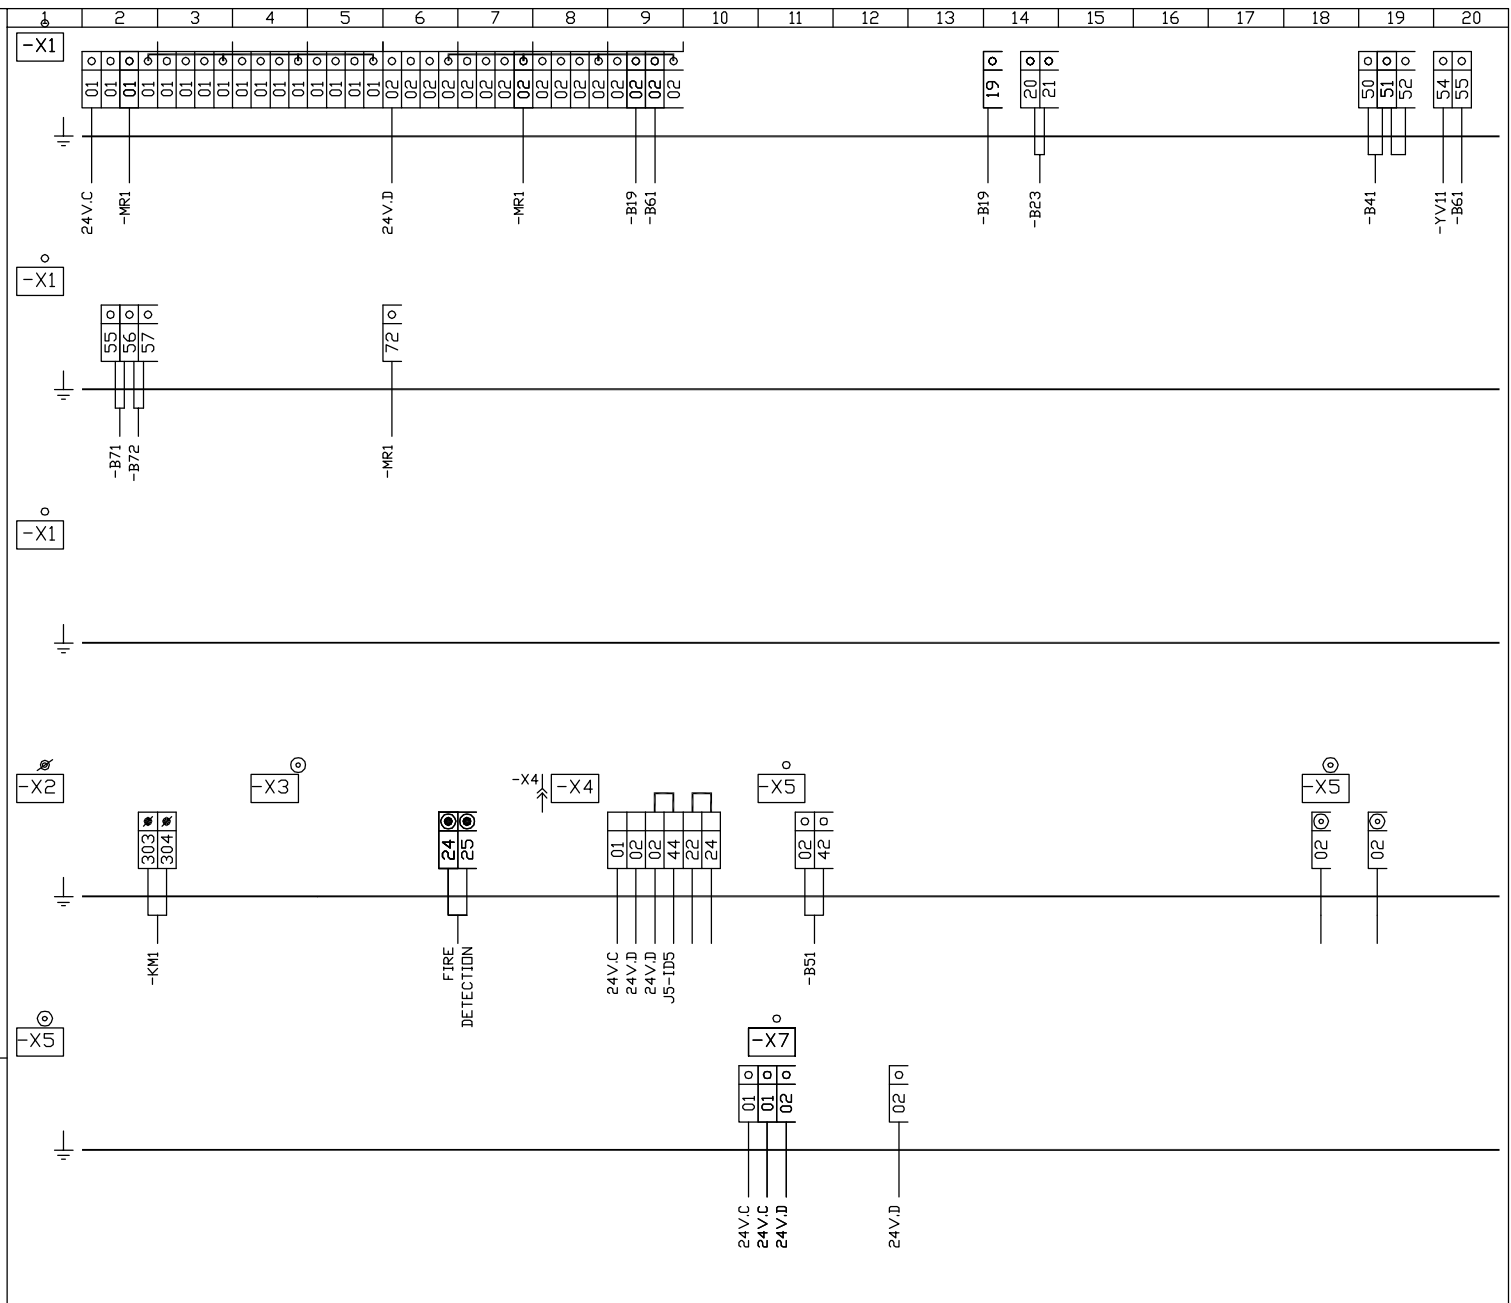






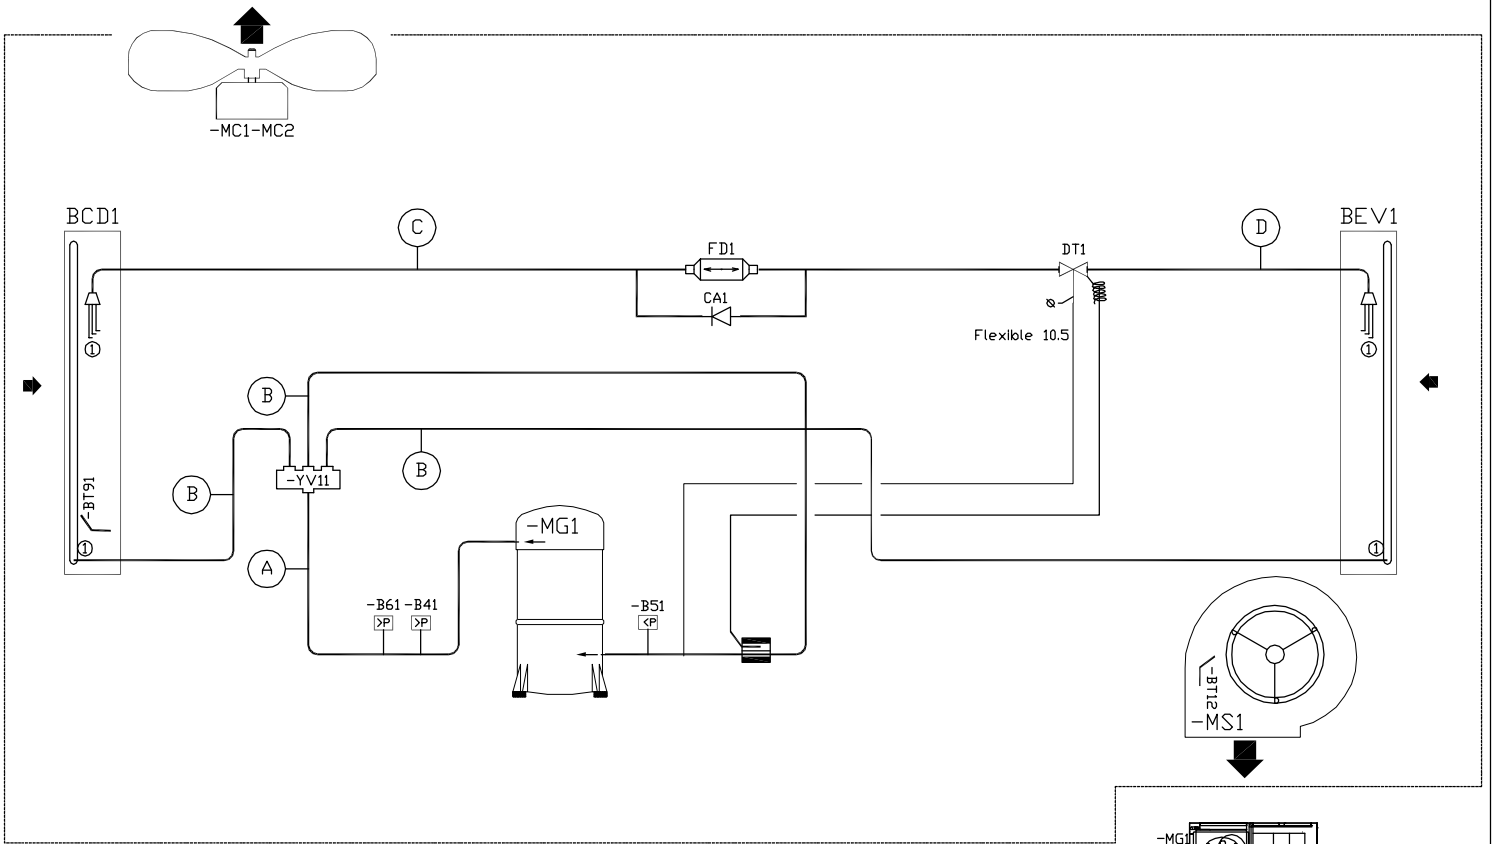

BOX	20/25
D	5/8"
C	1/2"
B	1 1/8"
A	7/8"



Indice	DATE	NOM	MODIFICATIONS

(4) BDK 025 HS  
 Schéma Frigorifique \ Hydraulique  
 Cooling \ Hydraulic Diagram

Dessine: CTO  
 Date: 18.01.07

**LENNOX**  
 USINE DE LONGVIC

252725 9/11



