
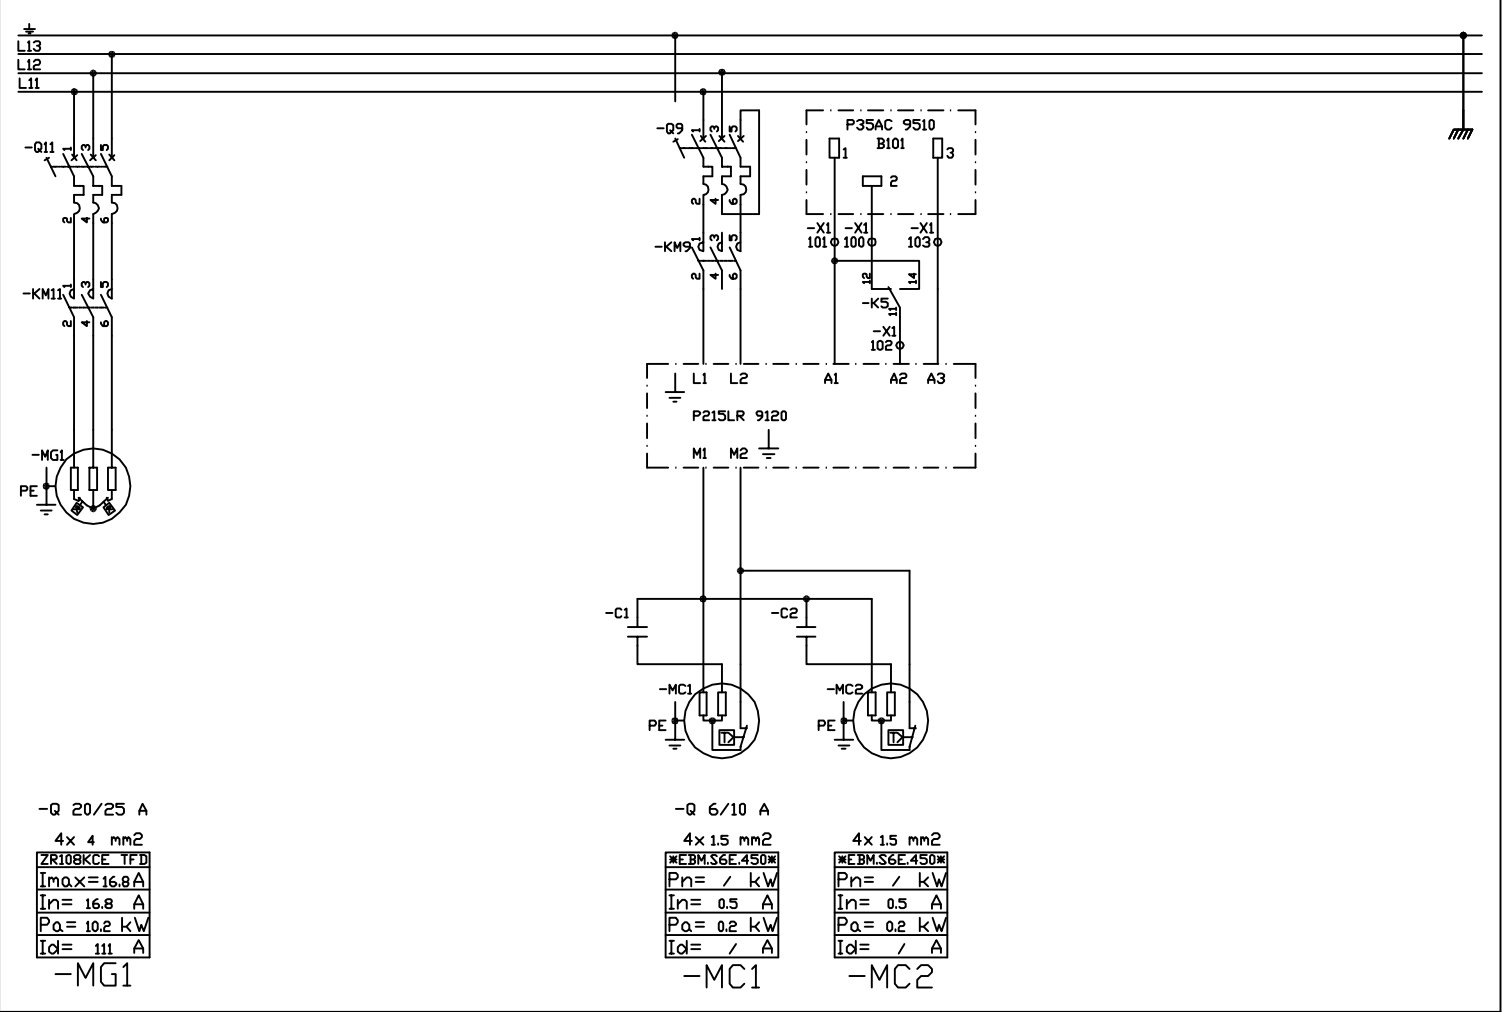
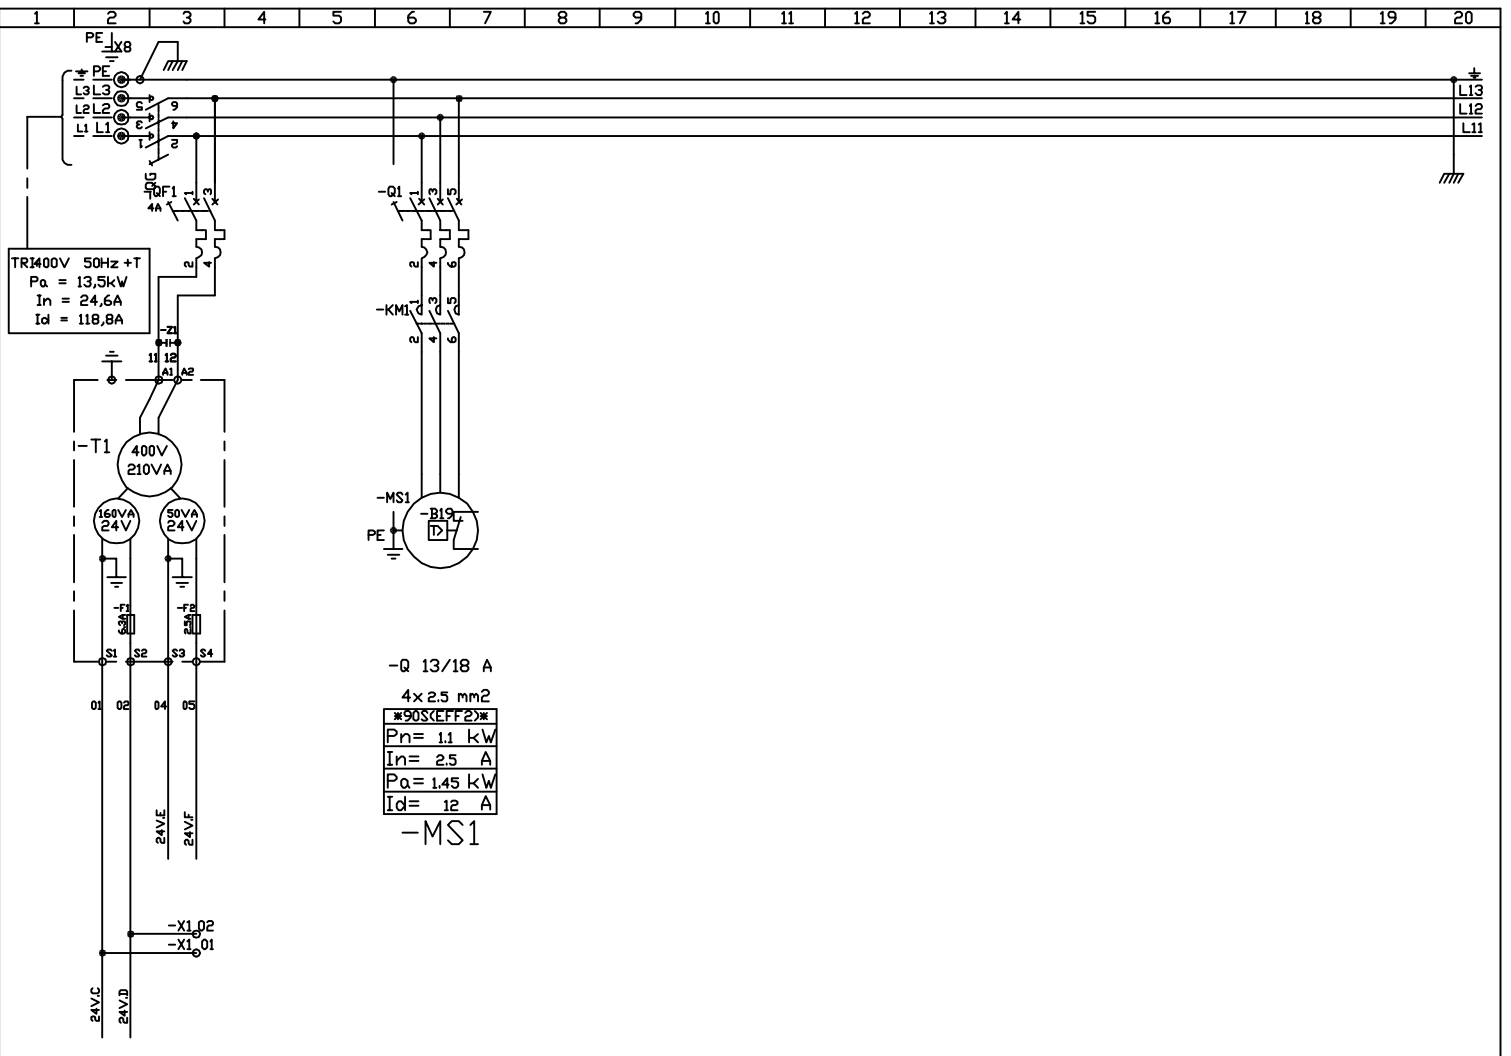
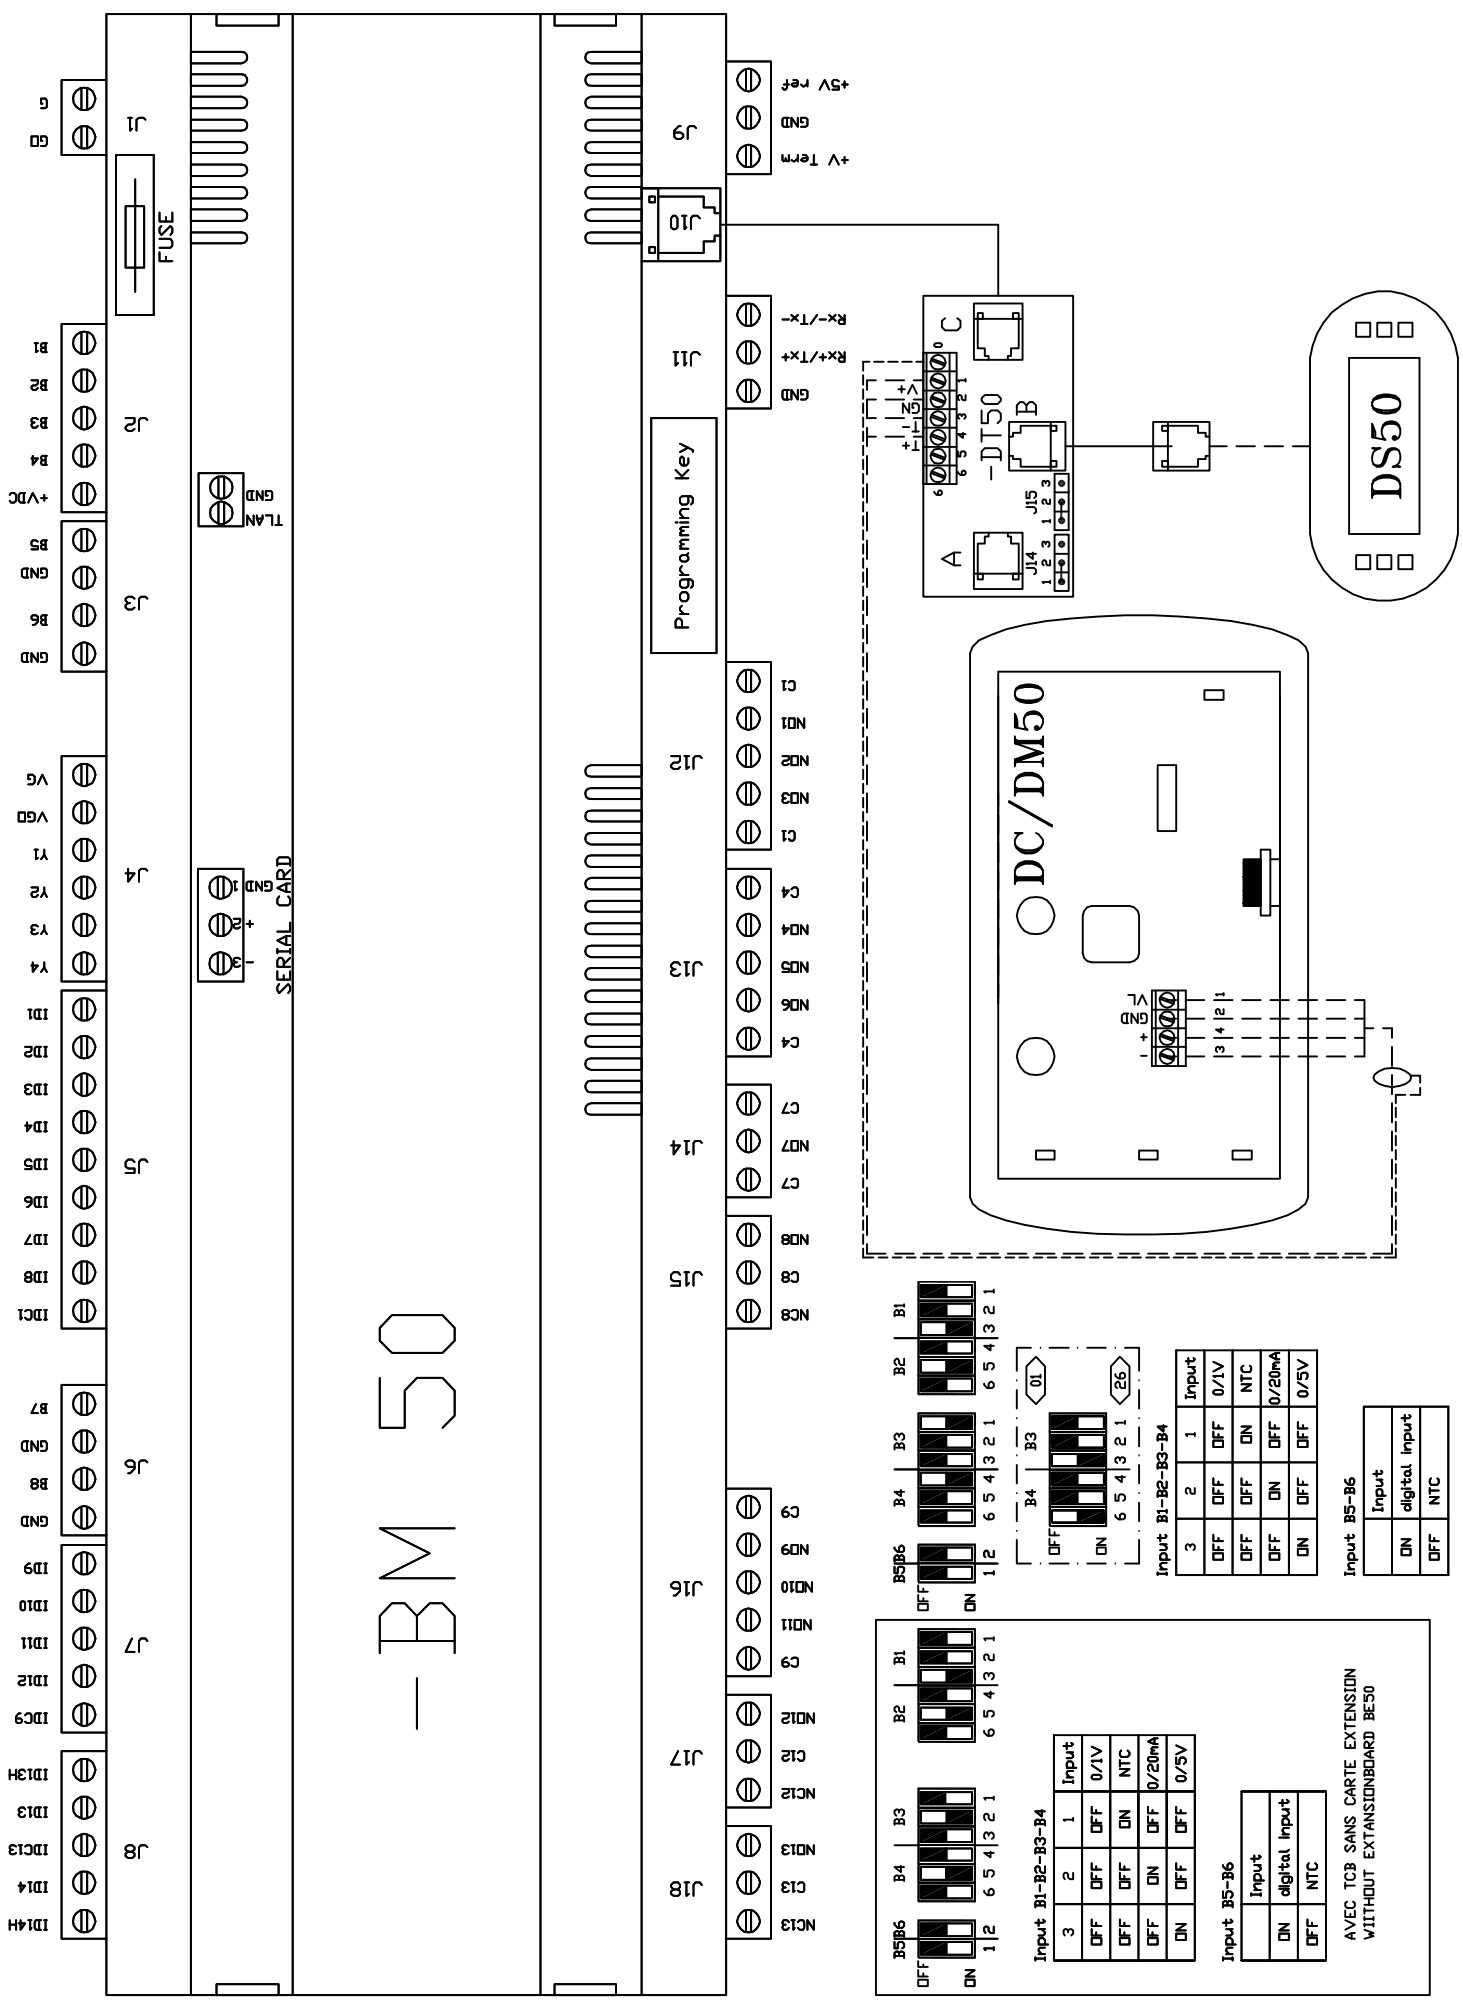


| Indice | DATE | NOM | MODIFICATIONS |
|--|------|--------------------------------|-----------------------------------|
|  | | | |
| Dominion Theatre | | | |
| (1) BHK 025 NS LENNOX UK | | Dessine: CTO Date: 11.10.07 | PAGE DE GARDE 257544 0 / 11 |





| | | | |
|--------|------|-----|---------------|
| Indice | DATE | NOM | MODIFICATIONS |
| | | | |

(1) BHK 025 NS
Automate CLIMATIC 50
Climatic 50 Controller

Dessine: CTO
Date: 11.10.07



257544 2/11

Input B1-B2-B3-B4

| | 1 | 2 | 3 | Input |
|-----|-----|-----|-----|--------|
| OFF | OFF | OFF | OFF | 0/1V |
| DN | DN | DN | DN | NTC |
| DN | DN | DN | DN | 0/20mA |
| DN | DN | DN | DN | 0/5V |

Input B5-B6

| | Input |
|-----|---------------|
| DN | digital input |
| OFF | NTC |


AVEC TCB SANS CARTE EXTENSION
WITHOUT EXTENSIONBOARD BE50


Input B1-B2-B3-B4


| | 1 | 2 | 3 | Input |
|-----|-----|-----|-----|--------|
| OFF | OFF | OFF | OFF | 0/1V |
| DN | DN | DN | DN | NTC |
| DN | DN | DN | DN | 0/20mA |
| DN | DN | DN | DN | 0/5V |


Input B5-B6


| | Input |
|-----|---------------|
| DN | digital input |
| OFF | NTC |

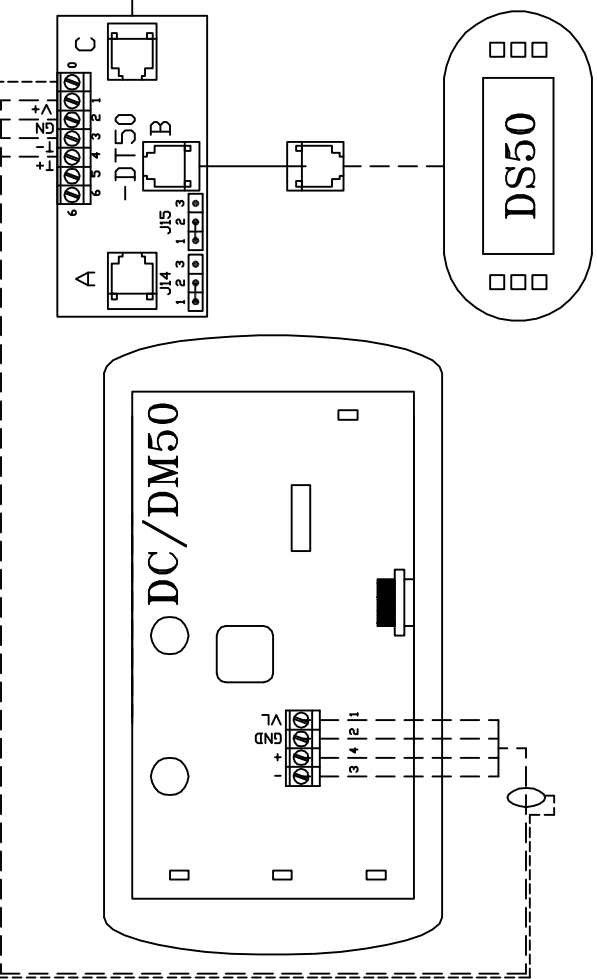

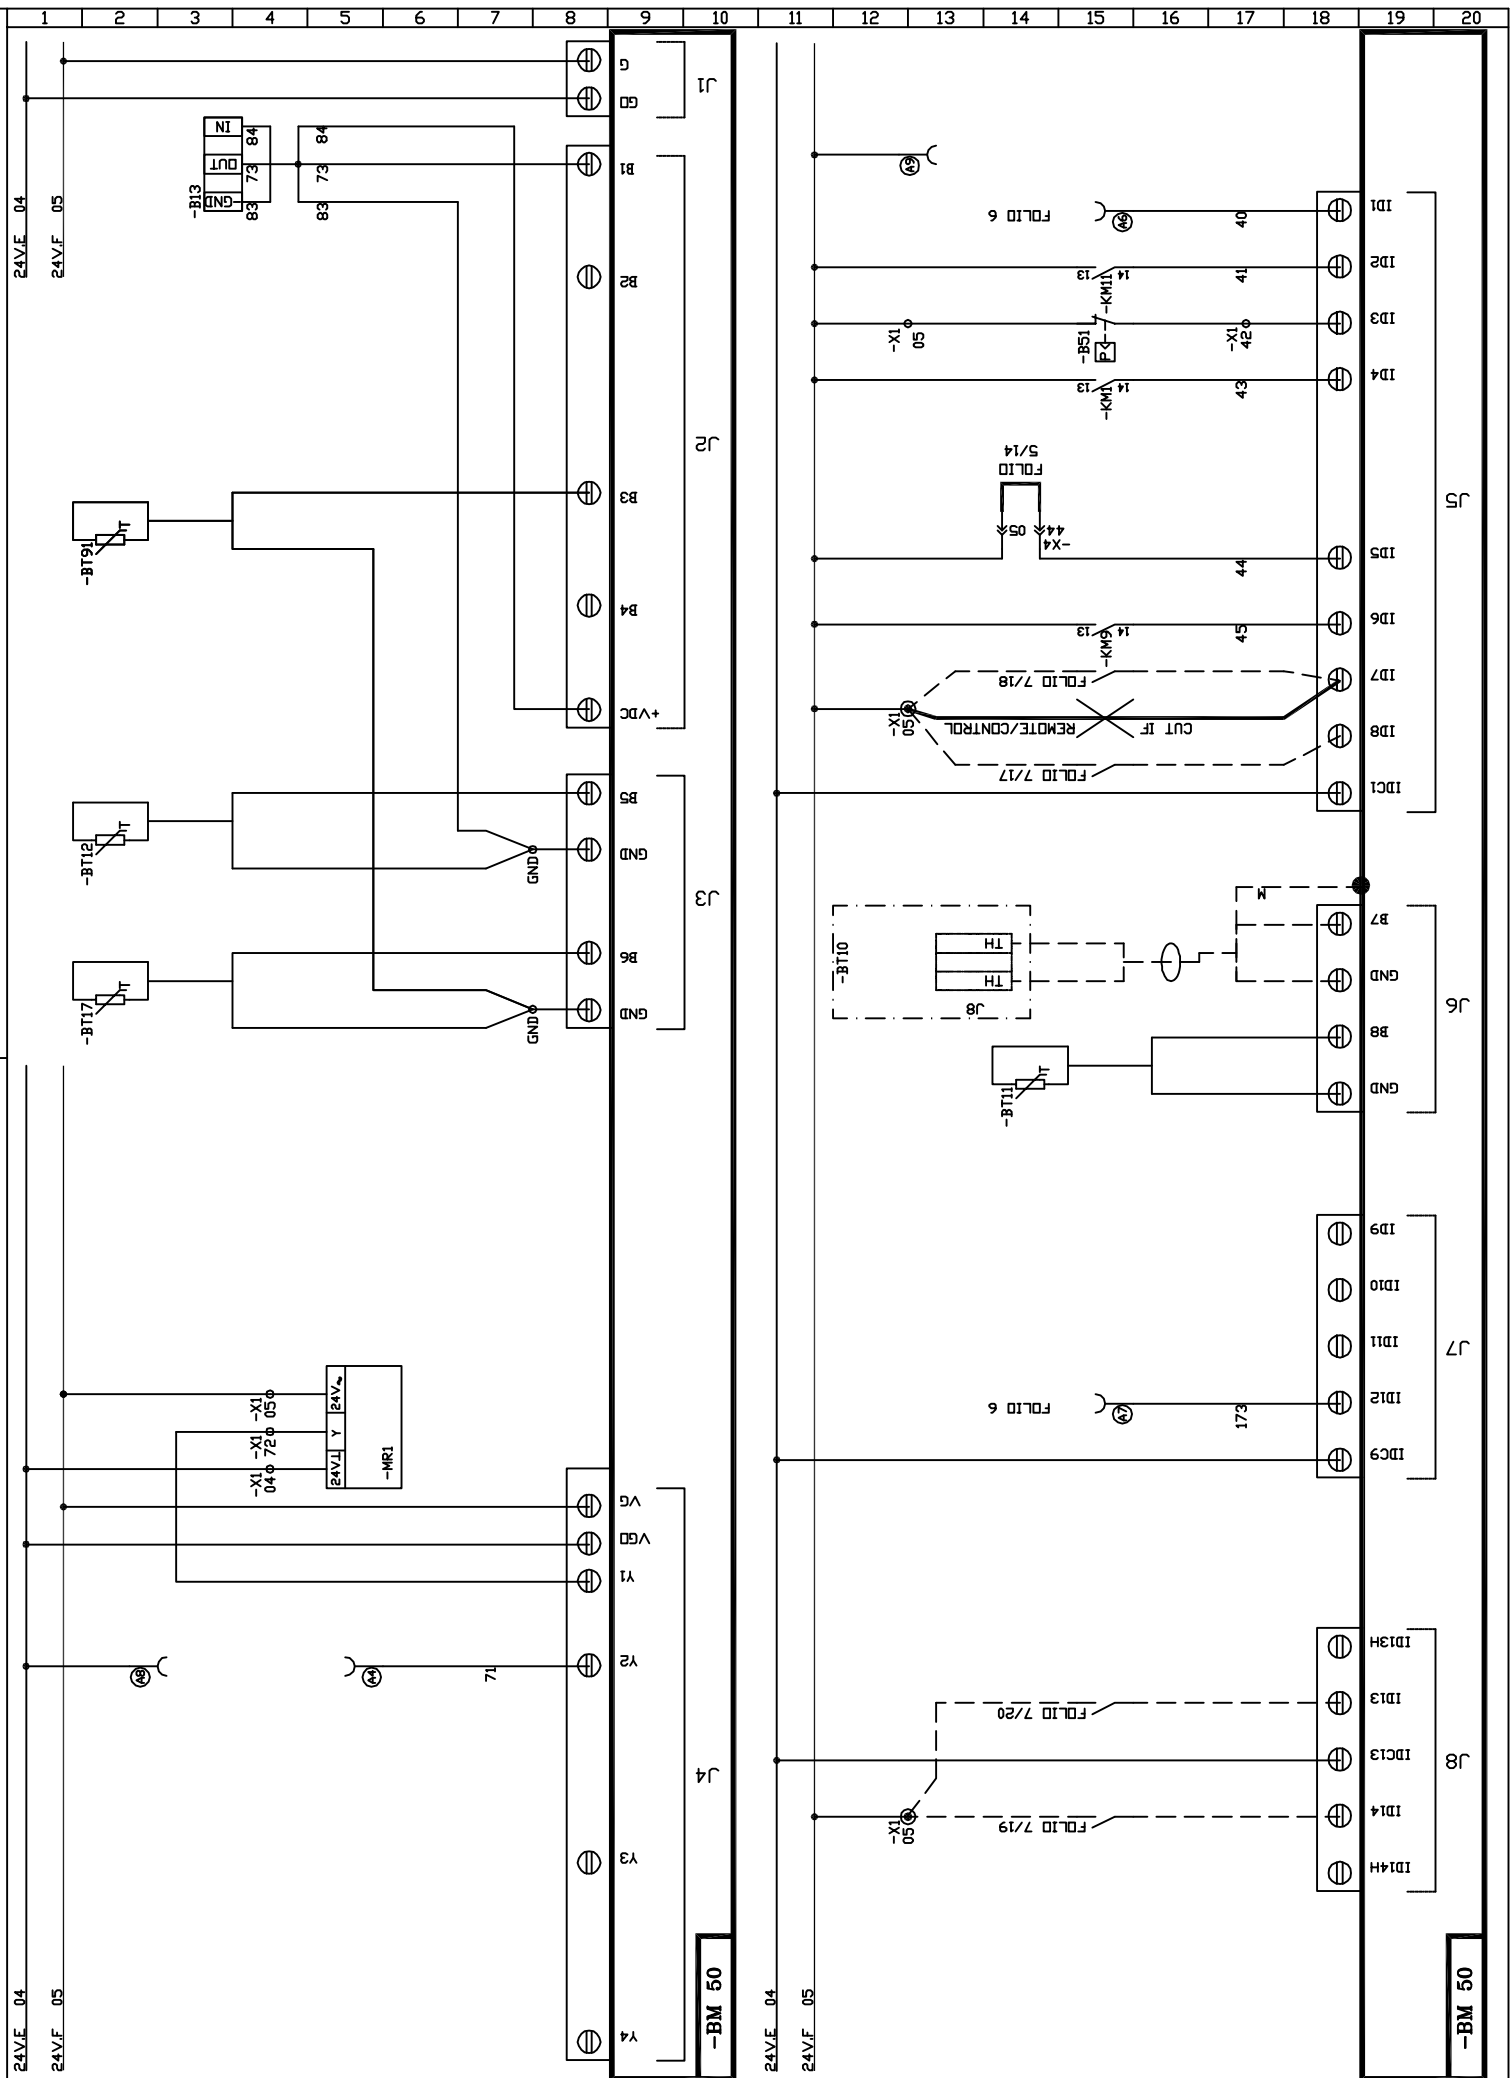
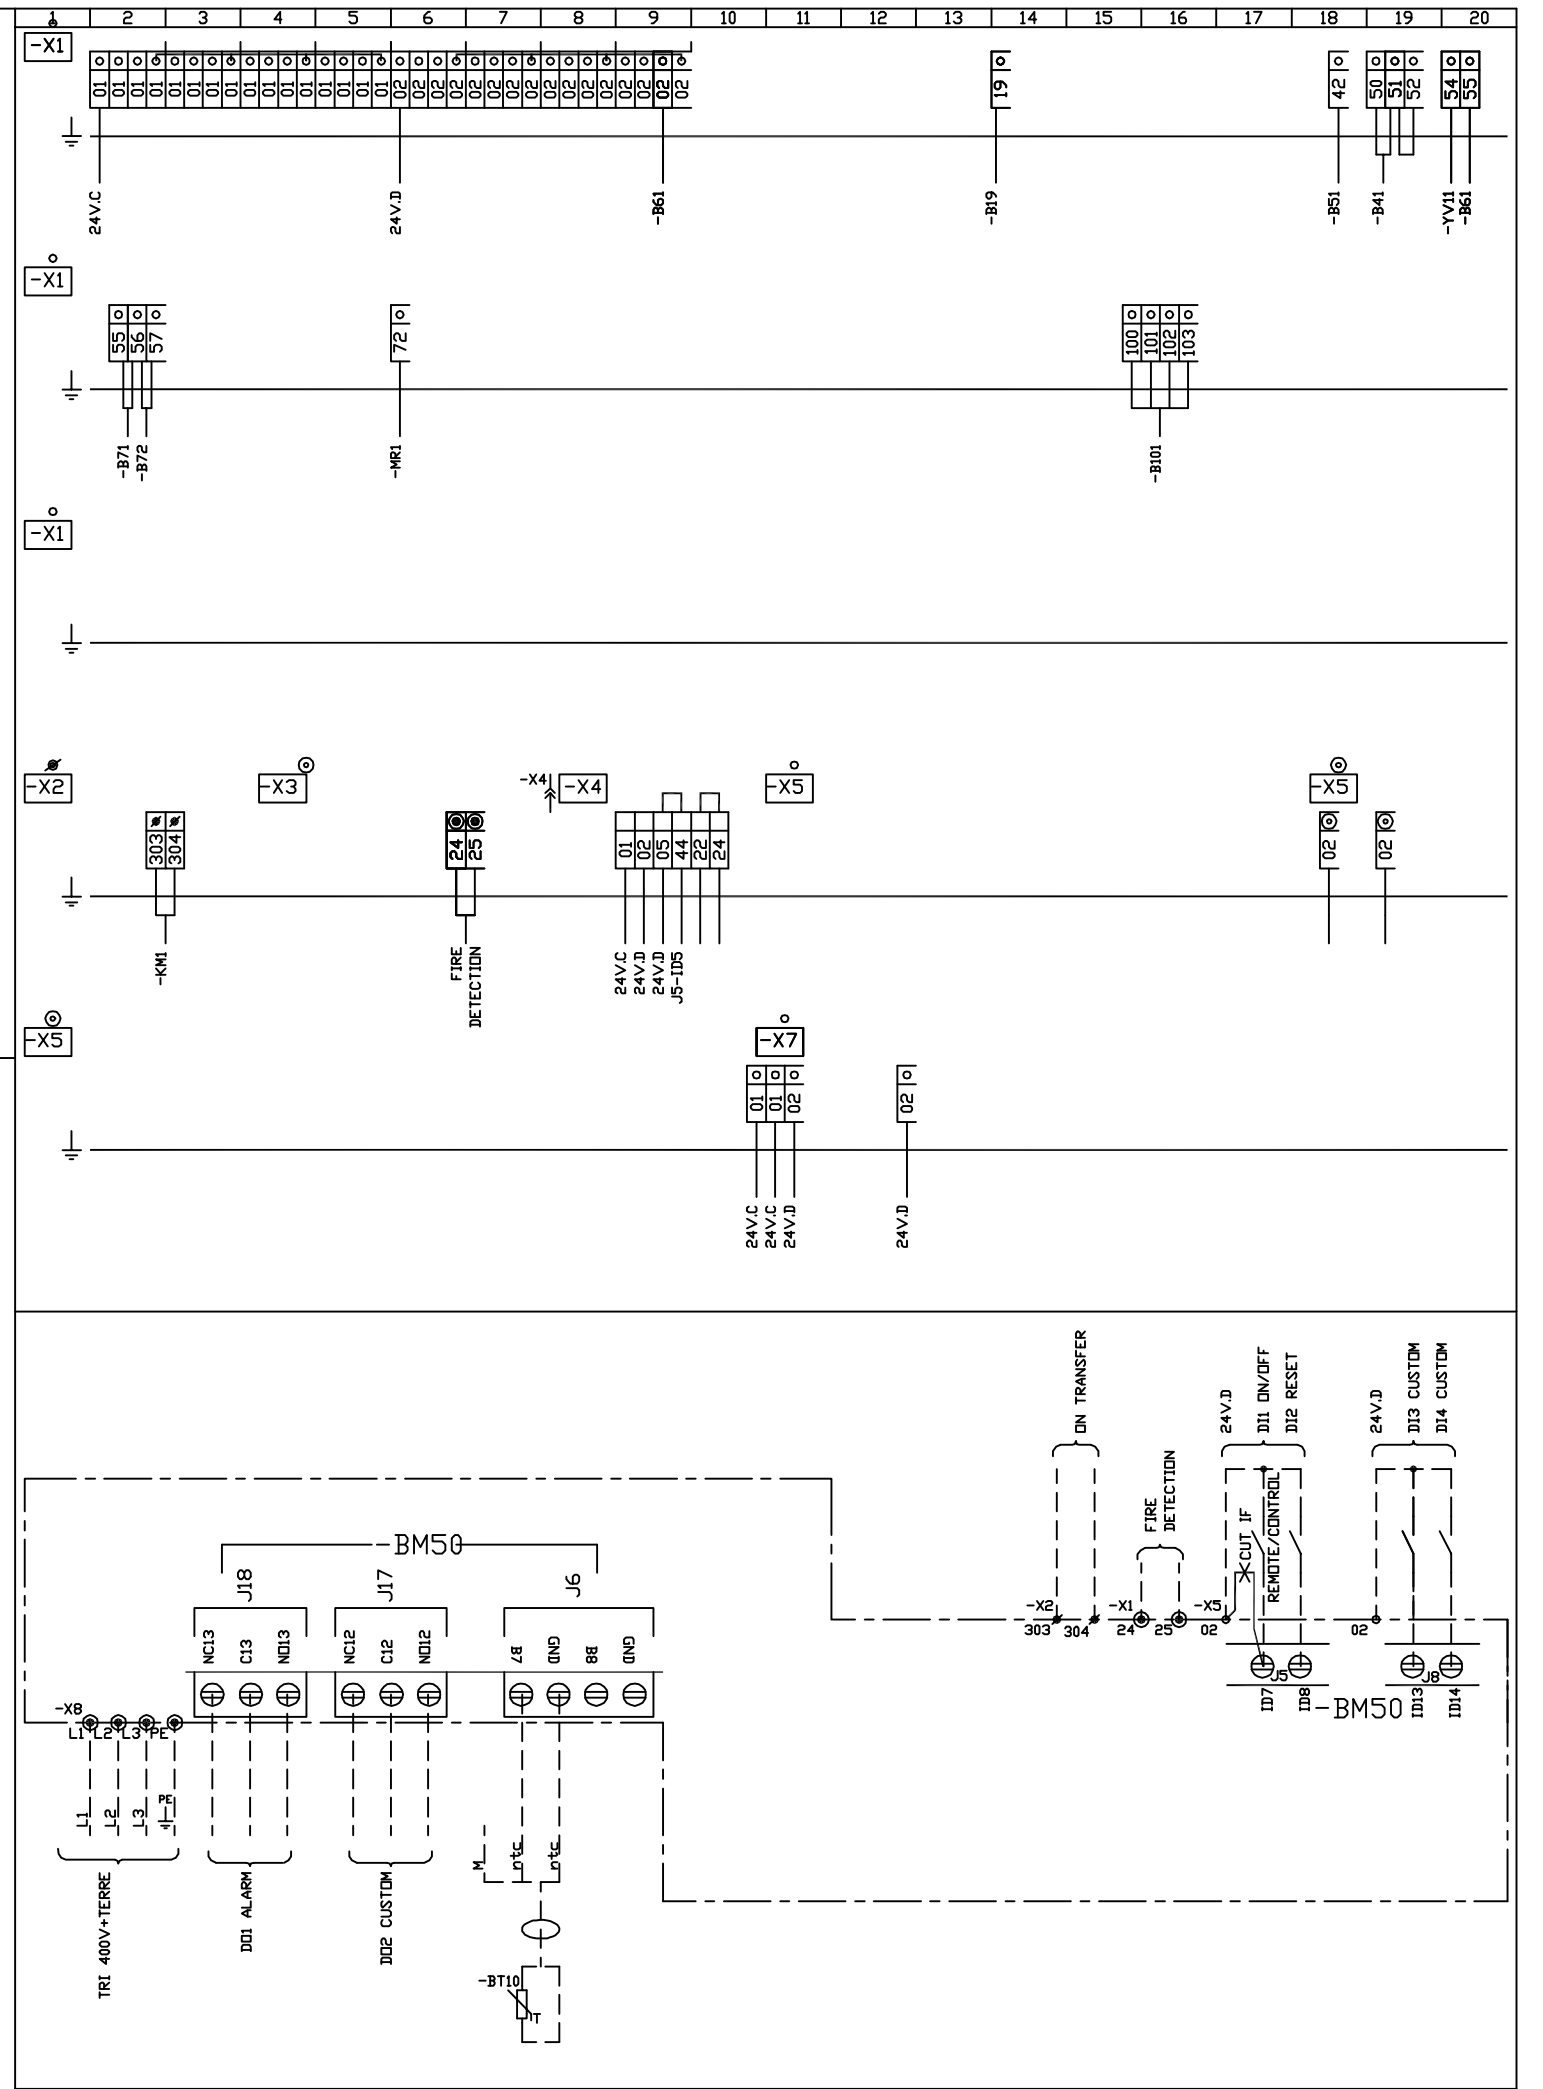


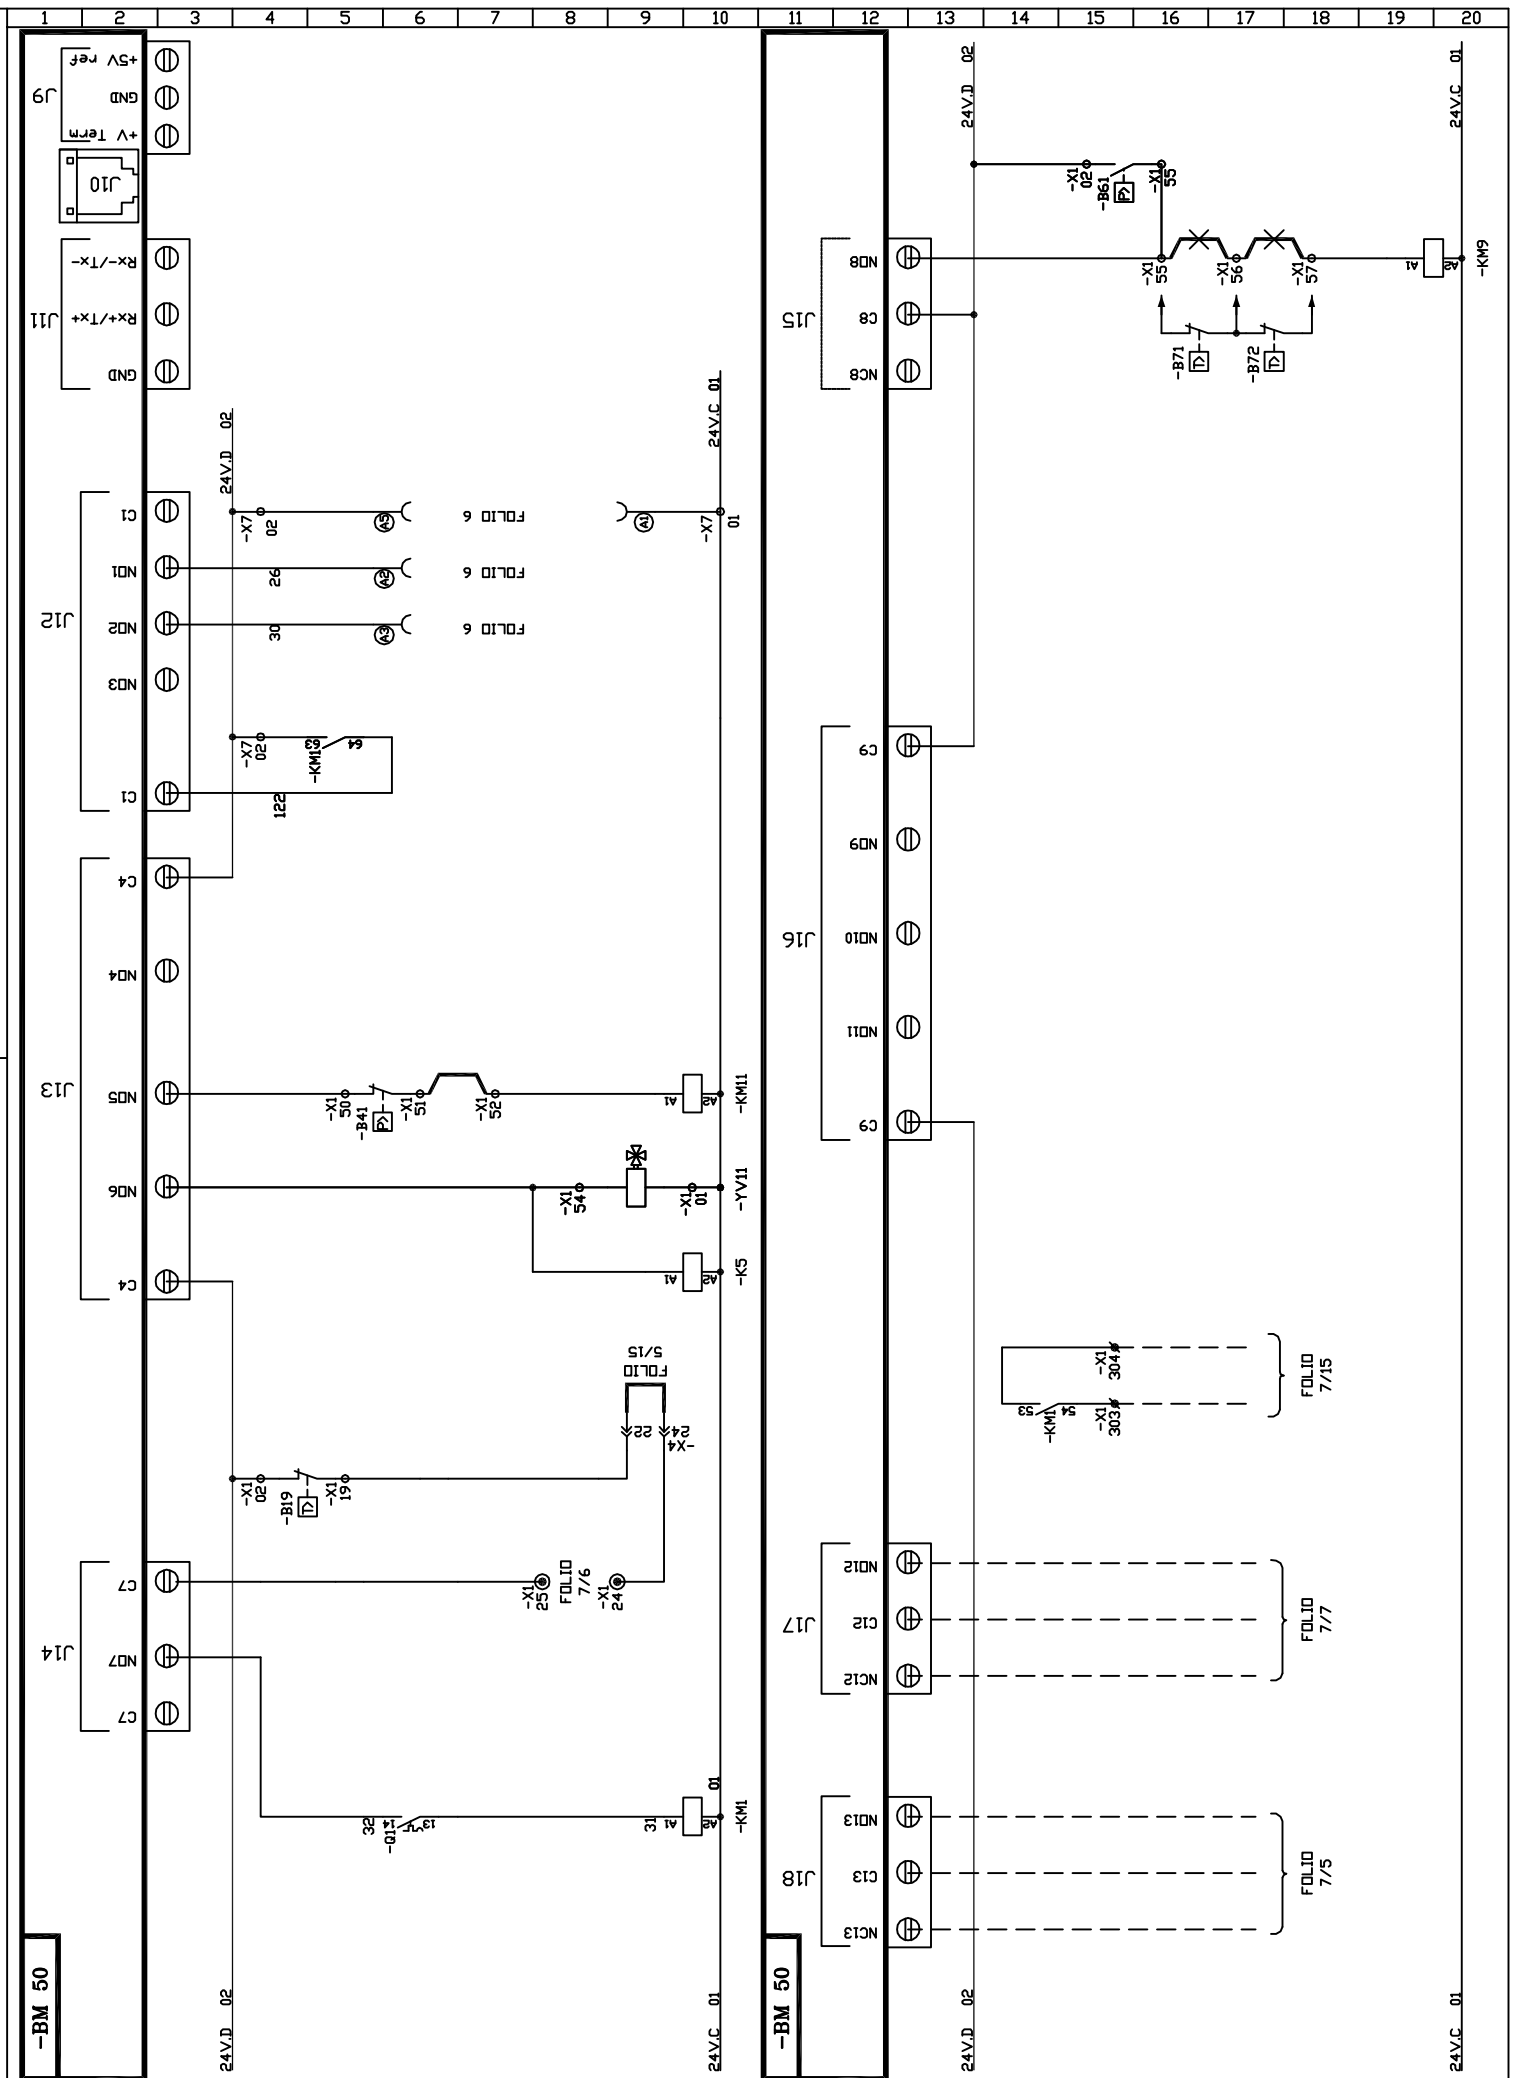

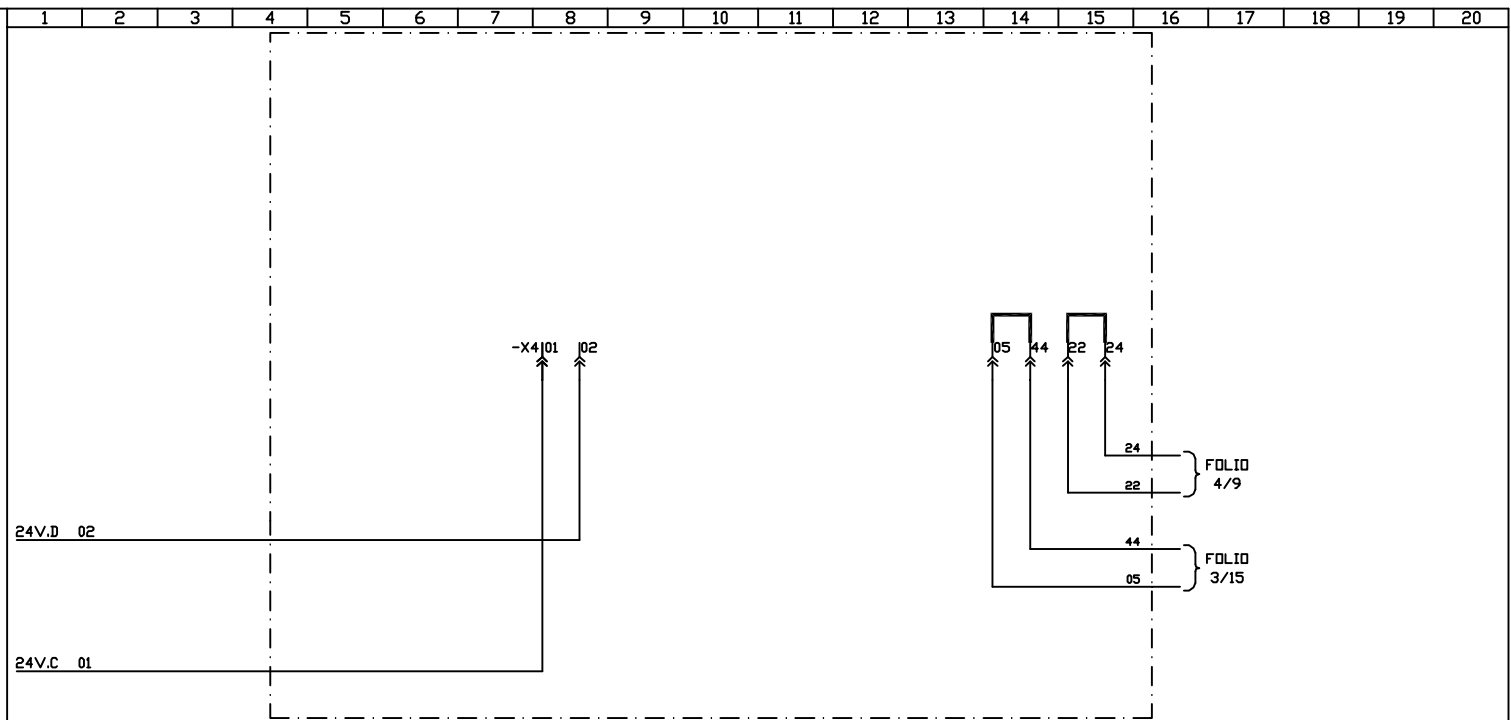



| | | | | | | | | | |
|--------|------|-----|---------------|--|--|-----------------------------------|---|--------|--------|
| | | | | | (1) BHK 025 NS Kit chauffage GAS | Dessine: CTO Date: 11.10.07 |  USINE DE LONGVIC | 257544 | 6 / 11 |
| Indice | DATE | NOM | MODIFICATIONS | | | | | | |




| Indice | DATE | NOM | MODIFICATIONS |
|--------|------|-----|---------------|
| | | | |
| | | | |

(1) BHK 025 NS
 Borniers \ Raccordement Client
 Terminal Strip \ Customer


Dessine: CTO
 Date: 11.10.07



257544 7/11

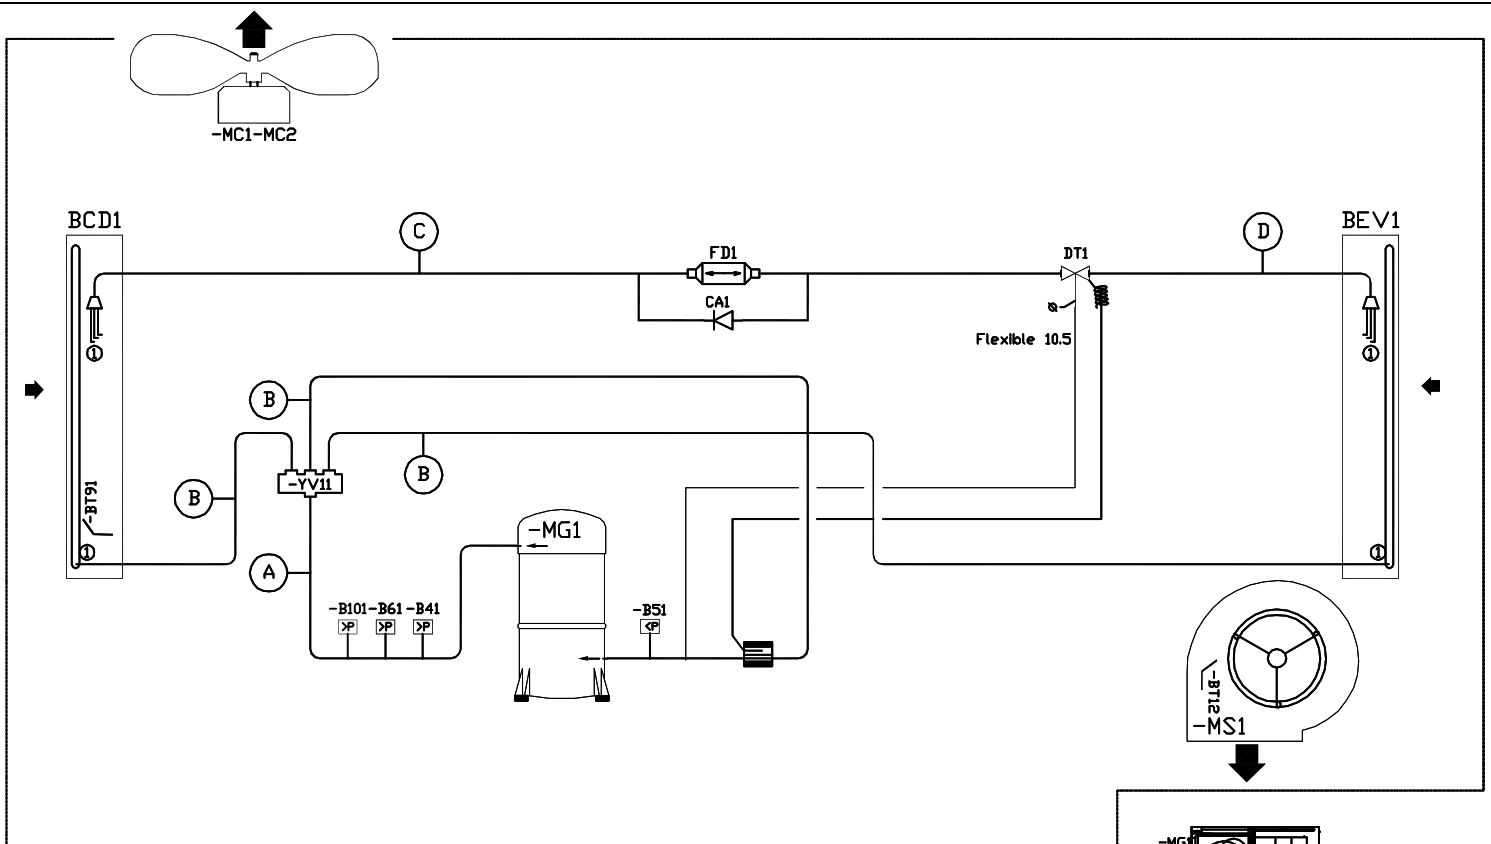

| | |
|-----|--------|
| BOX | 20/25 |
| D | 5/8" |
| C | 1/2" |
| B | 1 1/8" |
| A | 7/8" |



| Indice | DATE | NOM | MODIFICATIONS |
|--------|------|-----|---------------|
| | | | |
| | | | |

(1) BHK 025 NS
 Schéma Frigorifique \ Hydraulique
 Cooling \ Hydraulic Diagram

Dessine: CTO
 Date: 11.10.07



257544 9/11

