



CHP15 SERIES — 50 Hz. SINGLE PACKAGE HEAT PUMPS
 *6.2 to 15.9 kW (21 300 to 54 300 Btuh) Total Cooling Capacity
 *6.2 to 15.6 kW (21 300 to 53 300 Btuh) Total Heating Capacity
 4.2 to 23.0 kW (14 300 to 78 500 Btuh) Optional Electric Heat
*ARI Standard 240 Test Conditions




Page	Contents
2	Features
4	Control system options
5	Specifications
5	Cooling and heating ratings
6	Optional electric heat data
8	Blower data
8	Accessory air resistance
8	Blower performance
9	Diffuser air throw data
10	Control selection
10	flow charts
12	Electrical data and field wiring
14	Guide specifications
15	Dimensions

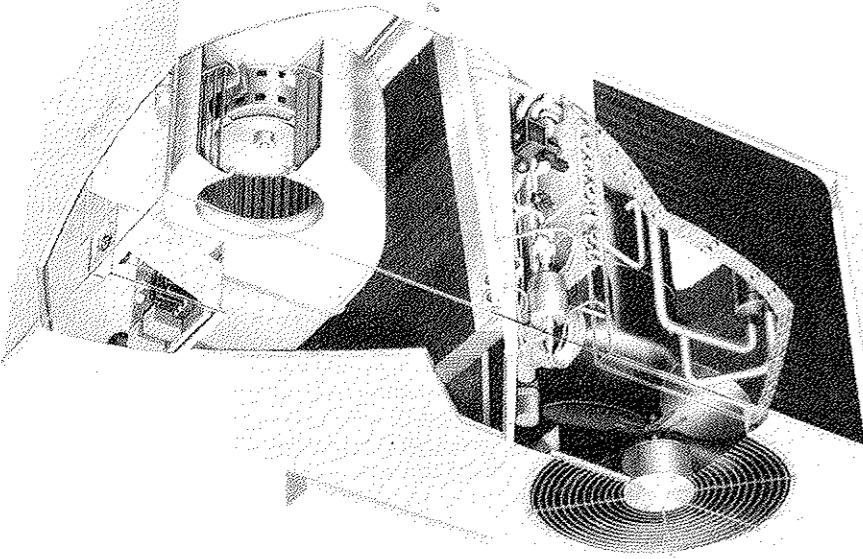


Typical Applications

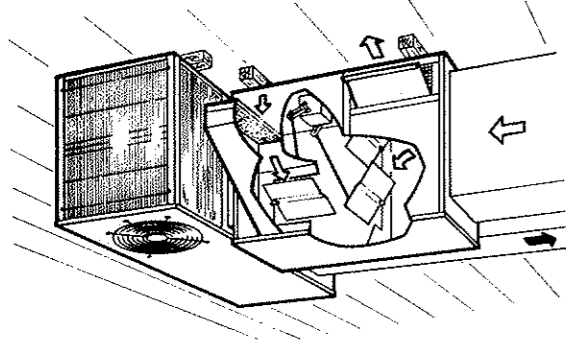


Rooftop Installation Unit with EMDH15 horizontal economizer

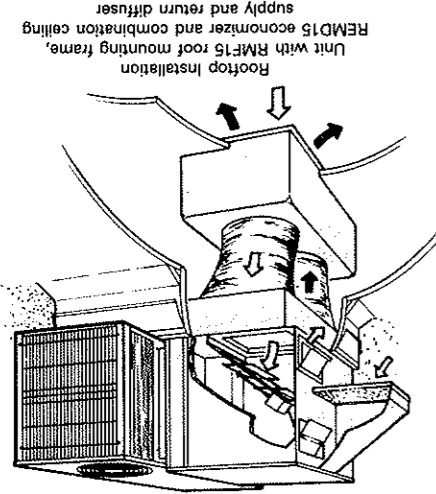

Rooftop Installation Unit with RMF15 roof mounting frame, RMD15 economizer and combination ceiling supply and return diffuser

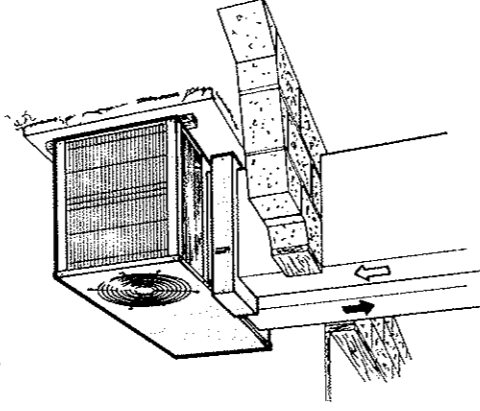


Grade Level Installation Unit with filter section

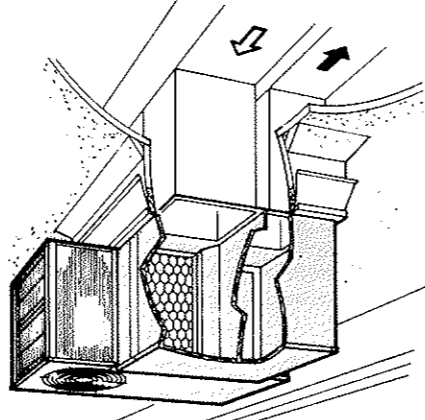


Rooftop Installation Unit with RMF15 roof mounting frame and RDE15 duct enclosure

NOTE — Specifications, Ratings and Dimensions subject to change without notice.

DIMENSIONS — mm (inches)

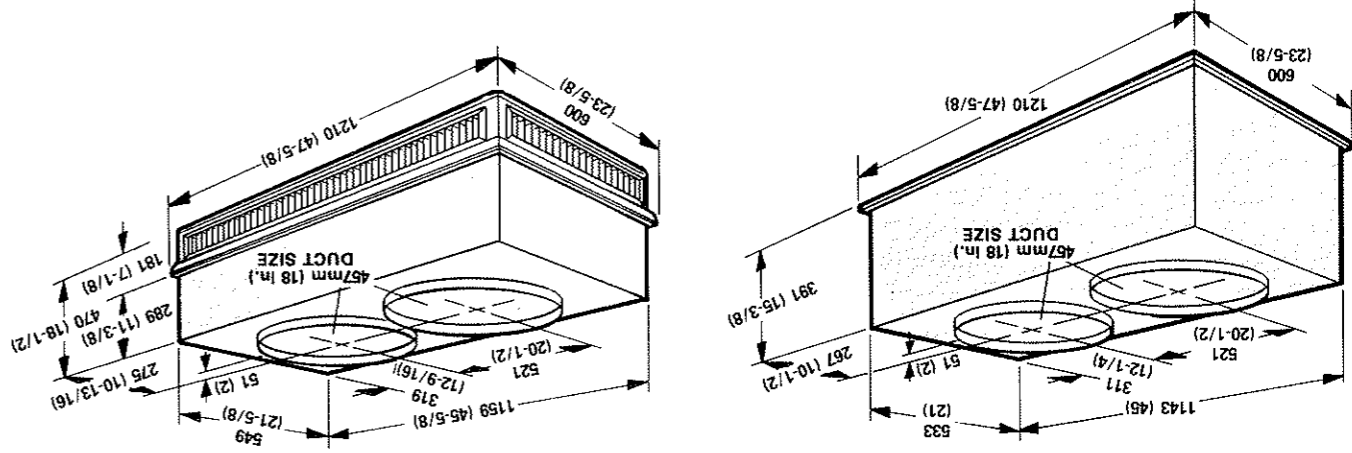

INSTALLATION CLEARANCES — mm (inches)

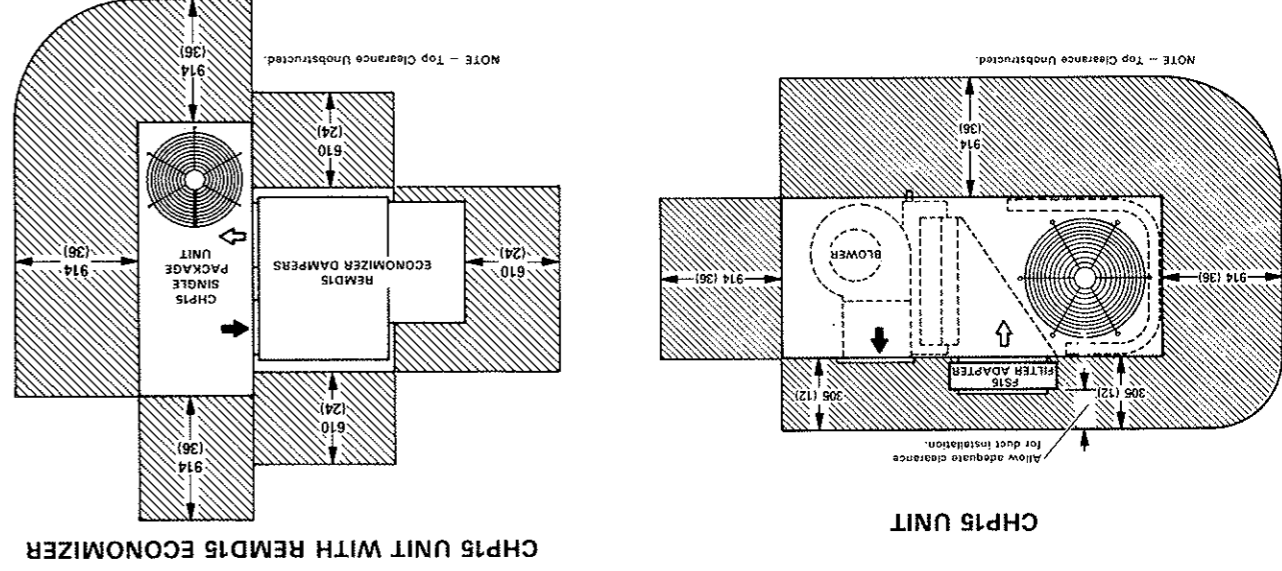

LENNOX Industries Limited

P. O. Box 43, Lister Road, Basingstoke, Hampshire, RG22 4AR, Tel: (0256) 461261, Telex: 858675, Fax (0256) 840487
 © Lennox Industries Limited 1987. Printed in England 1/87 MM

FEATURES

Applications — Lennox single package CHP15 heat pump units are designed for residential or small commercial installations. Units can be installed with ducts extended through a wall, in a crawlspace, basement, utility room or attic. Installation on a slab at grade level or on a rooftop will save valuable interior floor space. Unit has side by side supply and return air openings and is adaptable to over and under duct systems and combination ceiling diffuser supply and return systems. Optional accessories available include; electric heaters, roof mounting frame, over and under duct transition, filter section, outdoor air damper, gravity exhaust damper, ceiling diffusers and economizer dampers. Units are factory assembled, test operated and shipped ready for installation.

Completely Tested — Units have been thoroughly tested in the Lennox Research Laboratory environmental test room and accurately rated according to Air Conditioning And Refrigeration Institute (ARI) Standard 240 conditions. In addition, units have been sound tested in the Lennox reverberant sound test room and rated according to ARI Standard 270. Units and components within are bonded for grounding to meet safety standards for servicing required by ETL Testing Laboratories and the International Electrotechnical Commission (IEC). Blower data is from unit tests conducted in the Lennox Laboratory air test chamber.

Defrost Control — A clock timer defrost control is furnished as standard equipment. The control for the CHP15-261 and 413 models give a defrost cycle for every 36 or 108 minutes (adjustable) or compressor "on" time at outdoor temperature below 7°C (45°F). The solid state control for the CHP15-513-653 models provides a defrost cycle every 30 or 90 minutes. A thermostat mounted on the outdoor coil determines when the defrost cycle is required and also when to terminate a cycle.

Start Controls (Optional) — Start controls are not furnished with CHP15-261 and must be ordered extra for field installation. Provides assistance for compressor start under loaded conditions or in the event of low voltage. See Repair Parts Cross Reference List for kit requirements. Supplemental Electric Heat (Optional) — Additive electric heaters field installed internal to the unit cabinet and are available in several kW sizes, see Electric Heat table. The helix wound nichrome heating elements are exposed directly in the air stream resulting in instant heat transfer, low element temperatures and long service life. The elements are accurately located and insulated from the heavy gauge steel support frame by high quality insulators. Each heating element is equipped with accurately located limit control with fixed temperature off setting and automatic reset. In addition, elements have supplemental thermal cutoff safety fuse providing positive protection in case of excessive temperatures. Cutoff fuses are galvanized steel. Electrical inlet holes are provided in the box. Electric heaters are completely factory assembled with all controls installed and wired.


Rugged Cabinet — Constructed of heavy gauge galvanized steel. A five station wash metal preparation assures a perfect bonding surface for the finish coat of baked-on outdoor enamel. Conditioned air section of cabinet is lined with thick fiberglass insulation. Supply and return air openings have flanges for ease of duct connection. Removable panels permit complete access to interior of cabinet. Indoor coil drain pan is equipped with a pipe drain outlet exterior to the cabinet. Drainage outlets are furnished in the outdoor coil section of the base. Electrical inlets are furnished in cabinet for wiring entry. Control box is conveniently located for service access with controls installed and wired.

Powerful Indoor Coil Blower — Units are equipped with direct drive centrifugal blower precisely matched to the unit for maximum efficiency and minimum noise level. Blower is statically and dynamically balanced as an assembly before being installed in the unit. Multiple speed permanent split capacitor (PSC) motor is resiliently mounted. A choice of blower speeds is available, see blower performance tables. Change in blower speed is easily accomplished by a simple field change in wiring.


Low Ambient Control (Optional) — Units will operate satisfactorily in the cooling mode down to 10°C (50°F) outdoor air temperature without any additional controls. For cases where operation of the unit in the cooling mode is required at lower ambients, a Low Ambient Control Kit (LB-44961BA) can be added in the field, enabling it to operate properly down to minus 18°C (0°F).

DIMENSIONS — mm (inches)


CHP15 UNIT WITH EMDH15 HORIZONTAL ECONOMIZER

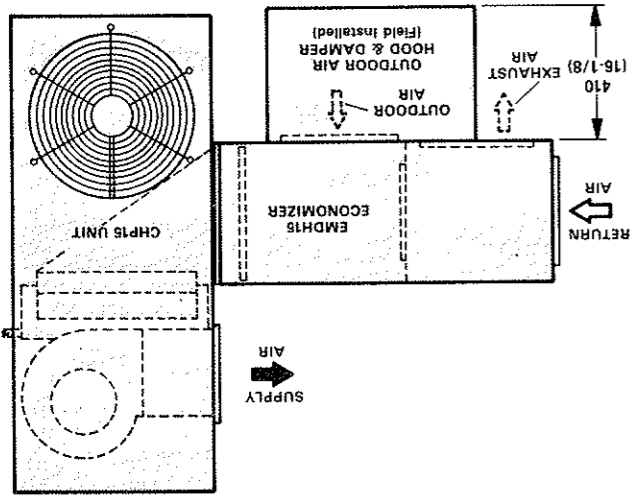

TOP VIEW

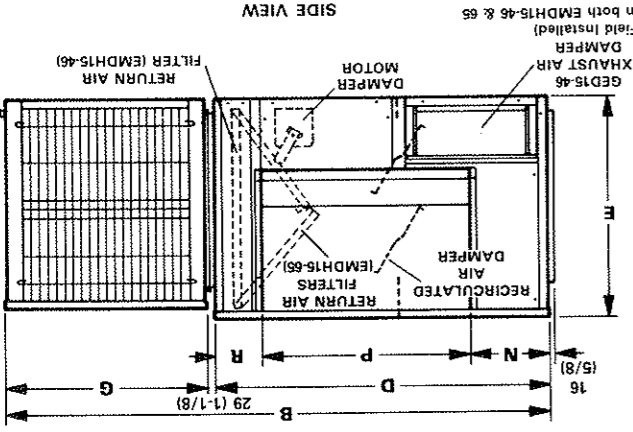

SIDE VIEW

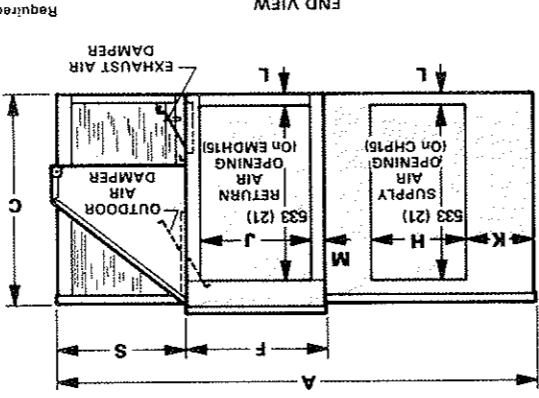


END VIEW

Model Number	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R	S
CHP15-261	1454	1654	641	1016	673	432	610	348	337	222	41	48	235	638	143	384
	57-1/4	65-1/8	25-1/4	40	26-1/2	17	24	13-11/16	13-1/4	8-3/4	1-5/8	1-7/8	9-1/4	25-1/8	5-5/8	15-1/8
	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm
CHP15-413	1530	1826	714	1016	673	432	781	348	337	222	41	48	235	638	143	508
	60-1/4	71-7/8	28-1/8	40	26-1/2	17	30-3/4	13-11/16	13-1/4	8-3/4	1-5/8	1-7/8	9-1/4	25-1/8	5-5/8	20
	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm
CHP15-513-653	1778	2400	879	1432	879	530	940	391	441	197	137	44	140	816	476	576
	70	94-1/2	34-5/8	56-3/8	34-5/8	20-7/8	37	15-3/8	17-3/8	7-3/4	5-3/4	1-3/4	5-1/2	32-1/8	18-3/4	22-5/8
	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm

GED15 GRAVITY EXHAUST DAMPER

NOTE — GED15-46 Model must be used on both the EMDH15-46 and EMDH15-65 Economizer Dampers.

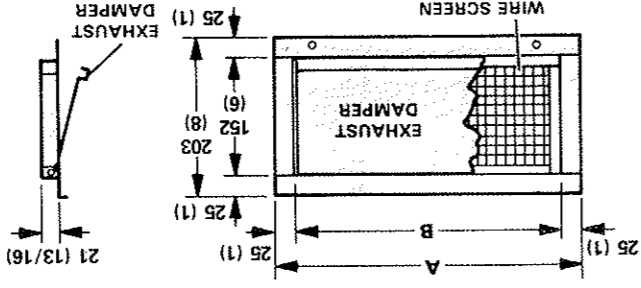

Model	A		B	
Number	mm	in.	mm	in.
GED15-46	391	15-3/8	340	13-3/8
GED15-65	506	19-15/16	456	17-15/16

FEATURES

GED15 Gravity Exhaust Damper (Optional) — Available for use with the economizer damper section and must be ordered extra. Provision is made for easy field installation in the economizer cabinet. Pressure operated expanded aluminum damper rotates smoothly in nylon bearings and is gasketed for a tight seal and quiet operation. Bird screen is provided. The GED15-46 model damper is required for the REMD15-46 down-flow, EMDH15-46 and EMDH15-65 horizontal economizers. The GED15-65 model is used with the REMD15-65 down-flow economizer only.

OAD15 Outdoor Air Damper (Optional) — Field installs on the duct enclosure and must be ordered extra. Damper opens automatically whenever blower is operating. Manually adjusted damper weight closes when blower stops. A cleanable polyurethane frame (furnished) is furnished for extra air filtering and bird screen protection.

Single-Point Power Source Control Box (Optional) — Available for electric heat applications. Field installs external to the unit cabinet. Provides single power service connection to the unit and sub-fusing. Constructed of galvanized steel with outdoor enamel paint finish, prepunched mounting holes and electrical inlet knockouts. Box cover is hinged for easy access. 4 boxes are available. Box is 305mm x 254mm x 152mm (12" x 10" x 6" deep), shipping weight 7 kg (15 lbs.). See Electric Heat Data Tables for usage.

SP11 Remote Status Panel (Optional) — The operation of the unit can be checked on the Remote Status Panel (12FR83) located within the conditioned area. Signal lights on the panel indicate "Cool Mode," "Heat Mode," "Compressor 1," "Compressor 2," "No Heat," and "Filter." The Cool Mode signal light is green when lit and indicates cooling operation. Heat Mode light is green and reflects heating operation and will turn red if there is an operational malfunction. Compressor 2 light is not required and should be disregarded. The No Heat and Filter lights will show red and indicate a requirement for service. Additional controls are required for use with the Status Panel and must be specified when ordering. Filter Switch Kit (97C85) is used in conjunction with the Filter light. Operation of No Heat light with electric heat requires a Current Sensing Relay (29F79). Status Panel Readout Relay Kit (14F92) is required to interface status panel with unit operation.

RTD9-65 Combination Supply and Return Diffuser (Optional) — RTD9-65 step-down mount diffuser extends slightly below ceiling level when installed and discharges conditioned air out through grilles on all four sides. Aluminum grilles are fitted with double deflection louvers for precise directional control of air flow. Return air enters through the large center grille. Assembly also includes insulated diffuser box with connection collars for round duct connection, support hanger eyes at the top corners for secure installation and even air flow on all four sides. Transition is sealed internally to prevent recirculation. Diffuser assembly is completely factory assembled. Diffuser readily adapts to T-bar ceiling grids and plaster ceilings.

FD9-65 Combination Ceiling Supply and Return Diffuser (Optional) — FD-65 flush mount diffuser installs almost flush with the ceiling level and discharges conditioned air out through fixed blade louvers on all four sides. Fixed blade louvers insure that air flow will be evenly distributed. Return air enters through large center grille. Assembly also includes insulated diffuser box with connection collars for round duct connection, support hanger eyes at the top corners for secure installation and even air flow on all four sides. Transition is sealed internally to prevent recirculation. Diffuser assembly is completely factory assembled. Diffuser readily adapts to T-bar ceiling grids and plaster ceilings.

SRT15 Ceiling Diffuser Supply and Return Transition (Optional) — Transition field installs in the roof mounting frame and provides round duct connection to the ceiling supply and return diffuser. Completely insulated galvanized steel transition is not furnished and must be ordered extra. Transition is completely factory assembled and easily field installs with minimum costs and labor requirement.

FS15 Filter Section (Optional) — Installs on return air opening of the CHP15 unit. Constructed of heavy gauge galvanized steel with a baked-on enamel paint finish. Completely insulated with thick matt faced fiberglass insulation. Shipped factory assembled ready to install. Equipped with hinges for ease of duct connection. Removable panel allows easy access to filters. Disposable 25mm (one inch) frame filter(s) with fiberglass media is furnished. Filter rack is designed to accept alternate 51mm (two inch) thick filter(s).

DT15 Side by Side and Under Duct Transition (Optional) — Installs over supply and return air openings of CHP15 unit for replacement of units in installation with over/under duct connections. Constructed of heavy gauge galvanized steel with a baked-on enamel paint finish. Completely insulated with thick matt faced fiberglass insulation. Disposable 25mm (one inch) frame filter(s) with fiberglass media is furnished. Filter rack is designed to accept alternate 51mm (two inch) thick filter(s). Removable panel allows easy access to filter(s). Re-movable panel allows easy access to filter(s). Shipped factory assembled ready to install.

RMF15 Roof Mounting Frame (Optional) — The roof mounting frame mates to the unit and duct enclosure providing weather sealed installation. Heavy gauge steel platform on roof frame provides weather seal and mounting surface for the equipment. Shipped knocked down for ease of shipping and handling it is easily field assembled. Assembling hardware is furnished. A wood nailer is attached to the frame to facilitate flashing.


RD15 Duct Enclosure (Optional) — The duct enclosure mounts on the down-flow applications. Duct enclosure is furnished as standard with the REMD15 economizer dampers. Constructed of heavy gauge galvanized steel with a baked-on enamel paint finish. Completely insulated with thick matt faced fiberglass insulation. Removable panels allow access to interior. Supply and return air openings are located in bottom of enclosure. Disposable 25mm (one inch) thick frame filter(s) with fiberglass media is furnished. Filter rack is designed to accept alternate 51mm (two inch) thick filter(s). Removable panel allows easy access to filter(s). Shipped factory assembled.

REMD15 Economizer Dampers (Optional) — The REMD15 economizer section consists of: RDE15 duct enclosure, recirculated air dampers, outdoor air hood and damper, damper motor and controls. The recirculated air dampers and damper field mount to the duct enclosure. Formed dampers rotate smoothly in nylon bearings. The positioning of the dampers is accomplished with a 24 volt three position spring return damper motor with adjustable minimum damper positioner. Damper motor is controlled by the room thermostat, adjustable mixed air controller and adjustable enthalpy control. The enthalpy control allows 0 to 100% outdoor air to be used for "free cooling" when outdoor humidity and temperature are acceptable. Adjustable compressor monitor locks compressor out at low ambient in the cooling mode. Factory wired and only requires plug-in field connection. Cleanable polyurethane media frame filter(s) is furnished with the outdoor air hood for extra air filtering and bird screen protection.

EMDH15 Horizontal Economizer Dampers (Optional) — The horizontal economizer cabinet contains recirculated air dampers, outdoor air hood with damper and controls. Economizer section is factory assembled except for the outdoor air hood and damper that field install on the cabinet. Cabinet is constructed of heavy gauge galvanized steel with a baked-on enamel paint finish. Completely insulated with thick matt faced fiberglass insulation. Supply and return air openings are fitted with disposable 25mm (one inch) thick frame filter(s) with fiberglass media. Filter rack is designed to accept alternate 51mm (two inch) thick filter(s). Additionally the outdoor air hood has a cleanable polyurethane frame filter(s) for extra air filtering and bird screen protection. Formed dampers rotate smoothly in nylon bearings. The positioning of the dampers is accomplished with a 24 volt three position spring return damper motor with adjustable minimum damper positioner. Damper motor is controlled by the room thermostat, adjustable mixed air controller and adjustable enthalpy control. The enthalpy control allows 0 to 100% outdoor air to be used for "free cooling" when outdoor humidity and temperature are acceptable. Adjustable compressor monitor locks compressor out at low ambient in the cooling mode. Factory wired and only requires plug-in field connection. Cleanable polyurethane media frame filter(s) is furnished with the outdoor air hood for extra air filtering and bird screen protection.


DIMENSIONS — mm (Inches)

RMF15 ROOF MOUNTING FRAME

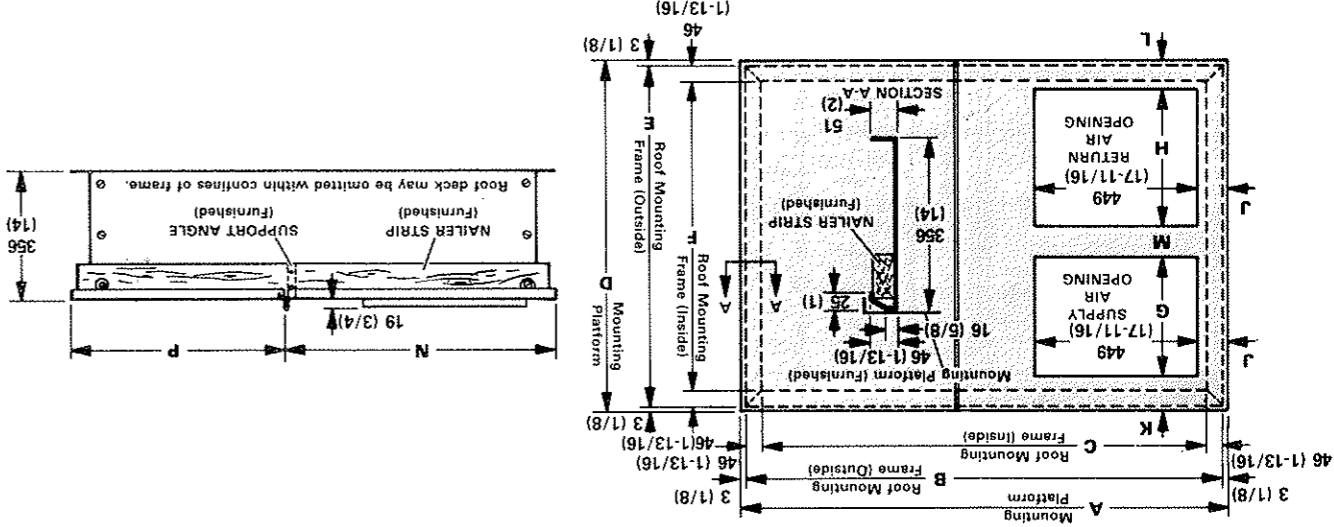



Model Number	A	B	C	D	E	F	G	H	J	K	L	M	N	P
RMF15-46	1343	1337	1245	962	956	864	335	386	70	86	73	83	749	594
	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm
RMF15-65	1699	1692	1600	1118	1111	1019	386	437	95	103	103	89	775	924
	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm
	52-7/8	52-5/8	49	37-7/8	37-5/8	34	13-3/16	15-3/16	2-3/4	3-3/8	2-7/8	3-1/4	29-1/2	23-3/8
	in.	in.	in.	in.	in.	in.	in.	in.	in.	in.	in.	in.	in.	in.

RMF15 ROOF MOUNTING FRAME WITH SRT15 SUPPLY AND RETURN TRANSITION

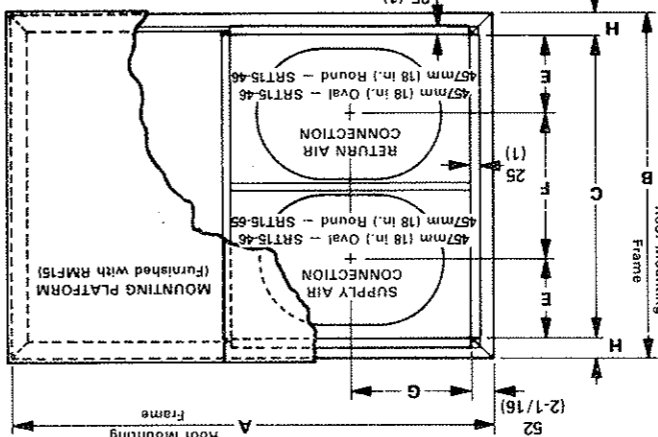



Model Number	A	B	C	D	E	F	G	H
RMF15-46	1337	956	845	670	219	406	351	56
	mm	mm	mm	mm	mm	mm	mm	mm
SRT15-46	52-5/8	37-5/8	33-1/4	26-3/8	8-5/8	16	13-13/16	2-13/16
	in.	in.	in.	in.	in.	in.	in.	in.
RMF15-65	1692	1111	1003	699	244	514	349	54
	mm	mm	mm	mm	mm	mm	mm	mm
SRT15-65	66-5/8	43-3/4	39-1/2	27-1/2	9-5/8	20-1/4	13-3/4	2-1/8
	in.	in.	in.	in.	in.	in.	in.	in.

TYPICAL FLASHING FOR ROOF MOUNTING FRAME

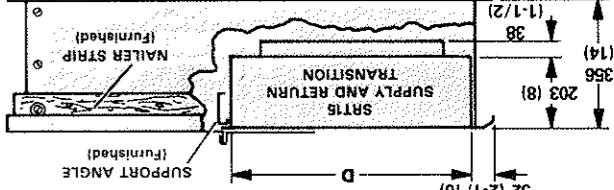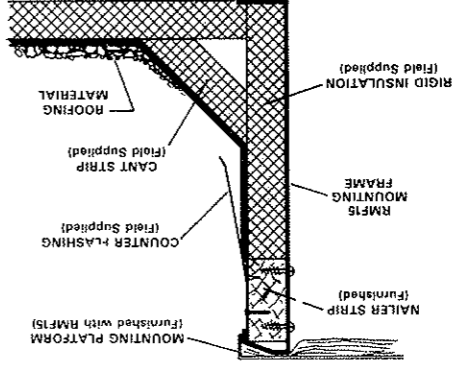

CHP15-513 AND CHP15-653 CONTROL SYSTEM OPTIONS

CHP15 UNIT WITH REMD15 ECONOMIZER AND RMF15 ROOF MOUNTING FRAME DIMENSIONS — mm (inches)

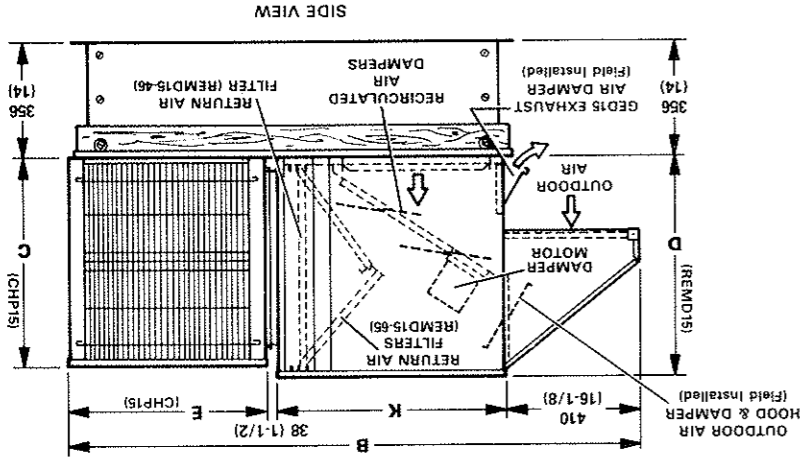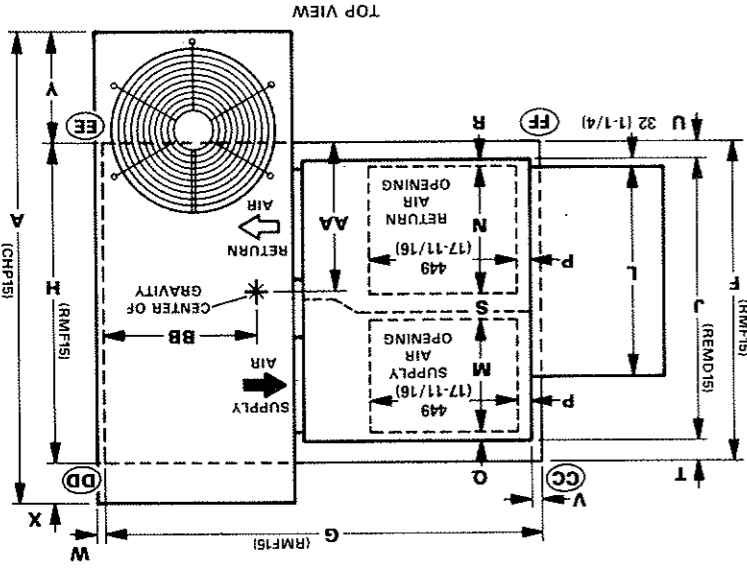

CENTER OF GRAVITY

Model	AA	BB
CHP15-261	508	20
CHP15-413	391	15-3/8
CHP15-513-653	610	24

CORNER WEIGHTS

Model	CC	DD	EE	FF
CHP15-261	43	94	153	69
CHP15-413	26	58	64	140
CHP15-513	44	96	164	362
CHP15-653	44	97	166	367

Optional Electro-Mechanical Thermostat and Control System — The thermostat and related controls of this system must be ordered extra for field installation. Two stage heat and two stage cool thermostat (13F06) with dual temperature selector levers. Uses subbase (13F17) (Auto-On) or non-switching subbase (13F16). SP11 Remote Status Panel (12F83) or SP11 Remote Switching Status Panel (12R84) is available for observing and controlling unit operation from the conditioned area. A SP11 Relay Kit (41G39) is required for switching functions of the Switching Status Panel. Kit must be ordered extra and field installed. For nite operation the following are available. Single stage heating thermostat (13F12) and non-switching subbase (13F16). For applications without the economizer a Nite Kit (39G74), containing a plug-in relay, is required to override the operation of day thermostat. Two time clocks are available for the system, both have nickel cadmium battery to provide approximately 150 hours running reserve during periods of supply failure or disconnection. The 24 hour model (P-8-65726) can give minimum switching periods of 30 minutes and is normally supplied with 4 pairs of taps. The 7 day model (P-8-65727) can provide a minimum switching period of 3 hours and is normally supplied with 9 pairs of taps. Day omission is achieved on 7 day dial by omitting taps.

Also available is a Warm Up Kit (39G77) which holds the economizer outdoor air dampers closed during nite operation and morning warm up. See Flow Chart on page 10.

Optional FLEXSTAT Thermostat and Controls System — The thermostat and related controls of this system must be ordered extra for field installation. Flexstat programmable thermostat (43G01) has touch sensitive keyboard, automatic switching from heat to cool, °C or °F readout, no anticipator, zero drop, indicator lights, hour/day programming, override capabilities, time readout, stage status indicators, operational mode symbols and battery back-up. A Remote Temperature Sensor (82F5) can be adapted to the thermostat for applications where it is desirable to locate the thermostat out of the conditioned area. SP11 Remote Status Panel (12F83) is available for checking unit operation from within the conditioned area. Also available is a Warm Up Kit (39G77) which holds the economizer outdoor air dampers closed during nite heat operation and morning warm up. See Flow Chart on page 10.

Optional W7400 Control System — Control system must be ordered extra for field installation. Control Module (46G48) controls the operation of the economizer dampers and the stages of heating and cooling. Controlling input signals are setpoint, space temperature sensor and time-of-day scheduling from the thermostat. The control module balances the space temperature signal against the number of stages operating for system output. System output is measured and updated by monitoring the actual space temperature deviation from set point, and the rate of change of the space temperature. The control module field installs in the unit or in a remote panel located within the conditioned area. Two thermostats are available for the system. A room thermostat (43G96) with integral sensor that installs in the conditioned space or a remote thermostat (43G97) that installs outside the conditioned space with a Room Temperature Sensor (58C92) in the conditioned area or a Return Air Temperature Sensor (27C40) in the return air duct of the unit. Thermostat and transmitter are furnished with a wiring subbase (58C94) with system selector switch (Cool-Auto-Heat-Emergency Heat) and fan switch (On-Auto-Off). SP11 Remote Status Panel (12F83) or SP11 Remote Switching Status Panel (12R84) is available for observing and controlling unit operation from the conditioned area. Two time clocks are available for the system. Automatic 7 day time clock (43G98) programs a weekly schedule. Any day settings have been made the clock will turn the system on and off. Spaced in 2 hour increments and equipped with battery back-up in case of power outage. 24 hour nite setback time clock (43G99) automatically programs the system to keep the conditioned area at a more conservative temperature level (nite setback thermostat setting) during a period of vacancy. Spaced in 15 minute increments and equipped with battery back-up in case of power outage. Also available is a Warm Up Kit (39G77) which holds the economizer outdoor air dampers closed during nite operation and warm up. See Flow Chart on page 11.

Optional SSP11 Remote Switching Status Panel — The operation of the unit can be controlled and observed on the Switching Status Panel (12F84) conveniently located within the conditioned area. Signal lights on the panel indicate "Cool Mode", "Heat Mode", "Compressor 1", "Compressor 2", "No Heat" and "Filter". The Cool Mode signal light is green when fit and indicates economizer damper operation or DX cooling operation for units without the economizer. Heat Mode light is green and reflects heating operation. Compressor 1 light is green when operating and will turn red if there is an operational malfunction. Compressor 2 light is not required and should be disregarded. The No Heat and Filter lights will show red and indicates a requirement for service. Additionally, panel is equipped with a system selector switch (Off — Heat — Auto — Cool — Emergency Heat) (Heat Pump Only), fan switch (Auto — On) and after hours timer. Fan switch provides a choice of intermittent (Auto) or continuous (On) blowers night setback controls providing normal operation for time period set. A momentary push button switch is used to initiate the timer period. The following field installed controls are required for use with the status panel and must be ordered extra. Filter Switch Kit (97C85) is required for operation of the filter light. Status Panel Readout Relay Kit (14F92) is required to interface status panel with unit operation. Current Sensing Relay (29F9) is required for operation of No Heat light with electric heat.

Optional W7400 Control System — Control system must be ordered extra for field installation. Control Module (46G48) controls the operation of the economizer dampers and the stages of heating and cooling. Controlling input signals are setpoint, space temperature sensor and time-of-day scheduling from the thermostat. The control module balances the space temperature signal against the number of stages operating for system output. System output is measured and updated by monitoring the actual space temperature deviation from set point, and the rate of change of the space temperature. The control module field installs in the unit or in a remote panel located within the conditioned area. Two thermostats are available for the system. A room thermostat (43G96) with integral sensor that installs in the conditioned space or a remote thermostat (43G97) that installs outside the conditioned space with a Room Temperature Sensor (58C92) in the conditioned area or a Return Air Temperature Sensor (27C40) in the return air duct of the unit. Both thermostats are equipped with touch sensitive keyboard, automatic switching from heat to cool, no anticipator, zero drop, indicator lights, hour/day programming, override capabilities, time readout, stage status indicators, battery back-up and wiring wallplate. W7400 Plug-In Relay (furnished with the control module) provides separate set points for the economizer dampers and DX cooling. SP11 Remote Status Panel (12F83) is available for checking unit operation within the conditioned area. See Flow Chart on page 11.

Optional W973 Control System — Control system must be ordered extra for field installation. Logic Panel (39G76) controls the operation of the economizer dampers and the stages of cooling and heating in response to a signal from the thermostat. To maintain stable temperatures the logic panel balances the conditioned space thermostat demand against the system output. System output is measured by a discharge air duct of the unit. The combined demand and output signals from the sensor determines economizer damper position and number of cooling or heating stages energized. The logic panel field installs in the unit or in a remote panel located within the conditioned space. W973 Plug-In Relay (furnished with the logic panel) is required to adapt the control system to the unit. Two thermostats are available for the system. Dual set point room thermostat (25C52) or transmitter (25C51) with a choice of remote sensors. Both have separate heating-cooling locking set points concealed under the cover and do not have indicating thermometer. The room thermostat has integral sensor and installs in the conditioned space. The transmitter installs outside the conditioned space with a Room Temperature Sensor (58C92) in the conditioned area or a Return Air Temperature Sensor (27C40) in the return air duct of the unit. Thermostat and transmitter are furnished with a wiring subbase (58C94) with system selector switch (Cool-Auto-Heat-Emergency Heat) and fan switch (On-Auto-Off). SP11 Remote Status Panel (12F83) or SP11 Remote Switching Status Panel (12R84) is available for observing and controlling unit operation from the conditioned area. Two time clocks are available for the system. Automatic 7 day time clock (43G98) programs a weekly schedule. Any day settings have been made the clock will turn the system on and off. Spaced in 2 hour increments and equipped with battery back-up in case of power outage. 24 hour nite setback time clock (43G99) automatically programs the system to keep the conditioned area at a more conservative temperature level (nite setback thermostat setting) during a period of vacancy. Spaced in 15 minute increments and equipped with battery back-up in case of power outage. Also available is a Warm Up Kit (39G77) which holds the economizer outdoor air dampers closed during nite operation and warm up. See Flow Chart on page 11.

Model Number	A	B	C	D	E	F	G	H	J	K	L	M
CHP15-261	1454	1749	641	673	610	962	1343	962	860	692	638	335
	57-1/4	68-7/8	25-1/4	26-1/2	24	37-7/8	52-7/8	37-7/8	33-7/8	27-1/4	25-1/8	13-3/16
	in.		in.		in.			in.		in.		
	1530	1921	714	673	781	962	1343	962	860	692	638	335
	60-1/4	75-5/8	28-1/8	26-1/2	30-3/4	37-7/8	52-7/8	37-7/8	33-7/8	27-1/4	25-1/8	13-3/16
	in.		in.		in.			in.		in.		
CHP15-513-653	1778	2100	879	879	940	1118	1699	1118	1014	713	816	386
	70	82-11/16	34-5/8	34-5/8	34-5/8	44	66-7/8	44	39-15/16	28-1/16	32-1/8	15-3/16
	in.		in.		in.			in.		in.		


Model Number	N	P	Q	R	S	T	U	V	W	X	Y	Z
CHP15-261	386	35	30	27	83	56	46	19	16	362	408	
	15-3/16	1-3/8	1-3/16	1-1/16	3-1/4	2-3/16	1-13/16	3/4	5/8	14-1/4	16-1/16	
	in.		in.		in.		in.		in.			
	386	35	30	27	83	56	46	19	16	362	408	
	15-3/16	1-3/8	1-3/16	1-1/16	3-1/4	2-3/16	1-13/16	3/4	5/8	14-1/4	16-1/16	
	in.		in.		in.		in.		in.			
CHP15-413	437	59	51	51	89	52	52	32	19	170	541	592
	17-3/16	2-5/16	2-1/16	2-1/16	3-1/2	2-1/16	2-1/16	1-1/4	3/4	6-11/16	21-5/16	23-5/16
	in.		in.		in.		in.		in.			

SPECIFICATIONS


*ARI Standard 270 SRN (beis)		Model Number	
7.8	7.6	CHP15-261	CHP15-413
15.9 (54 300)	12.9 (44 000)	9.4 (32 000)	9.4 (32 000)
6.07	4.78	3.56	4.78
2.6	2.7	2.6	2.7
8.9	9.2	9.0	9.2
25%	22%	20%	20%
*ARI Certified		*ARI Certified	
Total Capacity -- kW (Btu/h)	6.2 (21 300)	9.1 (31 000)	12.7 (43 400)
Total power input -- kW	2.39	2.99	3.90
High Temperature Heating Ratings	2.59	3.0	3.26
*ARI Certified		*ARI Certified	
Total capacity -- kW (Btu/h)	3.5 (11 900)	5.0 (16 900)	6.7 (22 900)
Total power input -- kW	1.93	2.46	3.05
Low Temperature Heating Ratings	2.14	2.20	2.14
Blower Coil		Blower wheel nominal diameter x width	
Indoor Coil	9 x 9	10 x 9	11-1/2 x 9
Motor output -- W (hp)	229 x 229	254 x 229	292 x 229
Indoor Coil	229 x 229	254 x 229	292 x 229
Blower wheel nominal diameter x width	mm	mm	mm
Indoor Coil	229 x 229	254 x 229	292 x 229
Motor output -- W (hp)	249 (1/3)	373 (1/2)	373 (1/2)
Net face area -- m ² (sq. ft.)	0.24 (2.54)	0.42 (4.5)	0.60 (6.4)
Tube outside diameter -- mm (in.) -- rows	10 (3/8) -- 3	10 (3/8) -- 3	10 (3/8) -- 4
Fins/m (fins/inch)	709 (18)	591 (15)	591 (15)
Outdoor Coil	0.85 (9.1)	0.95 (10.2)	1.60 (17.2)
Net face area -- m ² (sq. ft.)	0.53 (5.7)	0.89 (9.6)	1.35 (14.5)
Tube outside diameter -- mm (in.) -- rows	10 (3/8) -- 1.7	10 (3/8) -- 2	10 (3/8) -- 2
Fins/m (fins/inch)	787 (20)	787 (20)	591 (15)
Outdoor Coil	457 (18) -- 4	508 (20) -- 4	610 (24) -- 4
Air volume -- L/s (cfm)	865 (1835)	1100 (2335)	1690 (3585)
Motor output -- W (hp)	124 (1/6)	149 (1/5)	187 (1/4)
Fan	185	235	280
Refrigerant (22) Charge furnished -- kg (oz.)	2 (68)	3 (115)	4.5 (160)
Condensate drain size -- male pipe thread -- mm (in.)	19.1 (3/4)	19.1 (3/4)	19.1 (3/4)
Net weight -- kg (lbs.) -- 1 package	122 (270)	183 (404)	240 (529)
Optional Roof Mounting Frame (Net Weight)	RMF15-46 -- 46 kg (102 lbs.)	RMF15-65 -- 49 kg (109 lbs.)	RMF15-65 -- 49 kg (109 lbs.)
Optional Economizer Dampers (Net Weight)	REM15-46 -- 47 kg (103 lbs.)	REM15-65 -- 62 kg (136 lbs.)	REM15-65 -- 62 kg (136 lbs.)
Number and size of filters -- mm (in.)	(1) 406 x 635 x 25 (16 x 25 x 1)	(2) 508 x 508 x 25 (20 x 20 x 1)	(2) 508 x 508 x 25 (20 x 20 x 1)
Optional Horizontal Economizer Dampers (Net Weight)	EMDH15-46 -- 40 kg (89 lbs.)	EMDH15-65 -- 62 kg (136 lbs.)	EMDH15-65 -- 62 kg (136 lbs.)
Number and size of filters -- mm (in.)	(1) 406 x 635 x 25 (16 x 25 x 1)	(2) 508 x 508 x 25 (20 x 20 x 1)	(2) 508 x 508 x 25 (20 x 20 x 1)
Optional Duct Enclosure (Net Weight)	RDE15-46 -- 29 kg (63 lbs.)	RDE15-65 -- 44 kg (96 lbs.)	RDE15-65 -- 44 kg (96 lbs.)
Number and size of filters -- mm (in.)	(1) 406 x 635 x 25 (16 x 25 x 1)	(2) 508 x 508 x 25 (20 x 20 x 1)	(2) 508 x 508 x 25 (20 x 20 x 1)
Optional Filter Section (Net Weight)	FS15-46 -- 5 kg (12 lbs.)	FS15-65 -- 20 kg (44 lbs.)	FS15-65 -- 20 kg (44 lbs.)
Number and size of filters -- mm (in.)	(1) 406 x 635 x 25 (16 x 25 x 1)	(2) 508 x 508 x 25 (20 x 20 x 1)	(2) 508 x 508 x 25 (20 x 20 x 1)
Optional Outside Air Dampers (Net Weight)	OAD15-46 -- 6 kg (14 lbs.)	OAD15-65 -- 10 kg (22 lbs.)	OAD15-65 -- 10 kg (22 lbs.)
Number and size of filters -- mm (in.)	(1) 406 x 635 x 25 (16 x 25 x 1)	(2) 508 x 508 x 25 (20 x 20 x 1)	(2) 508 x 508 x 25 (20 x 20 x 1)
Optional Gravity Exhaust Dampers (Net Weight)	GED15-46 -- 2 kg (4 lbs.)	GED15-65 -- 3 kg (6 lbs.)	GED15-65 -- 3 kg (6 lbs.)
Optional Side by Side to Over and Under Duct Transition (Net Weight)	DT15-46 -- 21 kg (47 lbs.)	DT15-65 -- 55 kg (122 lbs.)	DT15-65 -- 55 kg (122 lbs.)
Number and size of filter -- mm (in.)	(1) 406 x 635 x 25 (16 x 25 x 1)	(2) 508 x 508 x 25 (20 x 20 x 1)	(2) 508 x 508 x 25 (20 x 20 x 1)
Optional Ceiling Diffusers	RTD9-65 -- 30 kg (67 lbs.)	RTD9-65 -- 30 kg (67 lbs.)	RTD9-65 -- 30 kg (67 lbs.)
(Net Weight)	Flush	Flush	Flush
Optional Ceiling Diffuser Transition (Net Weight)	SRT15-46 -- 9 kg (19 lbs.)	SRT15-65 -- 9 kg (20 lbs.)	SRT15-65 -- 9 kg (20 lbs.)

*Rated at Air Conditioning and Refrigeration Institute (ARI) Standard 240 Conditions: 60 L/s (maximum) indoor air volume per kW of cooling capacity (450 cfm per ton). *Sound Rating Number in accordance with Air Conditioning and Refrigeration Institute (ARI) Standard 270.


High Temperature Heating Ratings -- 8.3°C (47°F) dry bulb, 6.1°C (43°F) wet bulb outdoor air temperature and 21°C (70°F) entering indoor coil air.
 Cooling Ratings -- 35°C (95°F) outdoor air temperature and 26.7°C (80°F) dry bulb and 9.4°C (47°F) wet bulb entering indoor coil air.
 Low Temperature Heating Ratings -- minus 8.3°C (17°F) dry bulb, minus 9.4°C (15°F) wet bulb outdoor air temperature and 21°C (70°F) entering indoor coil air.

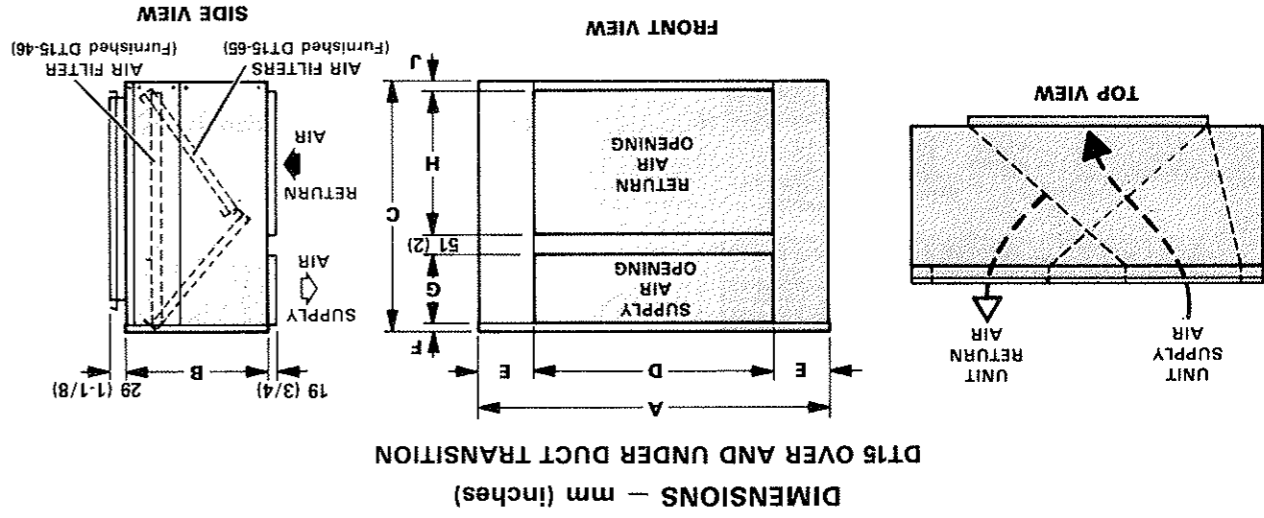

Model	A	B	C	D	E	F	G	H	J
DT15-65	1054	41-1/2	868	34-3/16	879	34-5/8	864	34	96
DT15-46	892	35-1/8	362	14-1/4	641	25-1/4	610	24	141
Number	mm	in.	mm	in.	mm	in.	mm	in.	mm
	mm	in.	mm	in.	mm	in.	mm	in.	mm
	mm	in.	mm	in.	mm	in.	mm	in.	mm

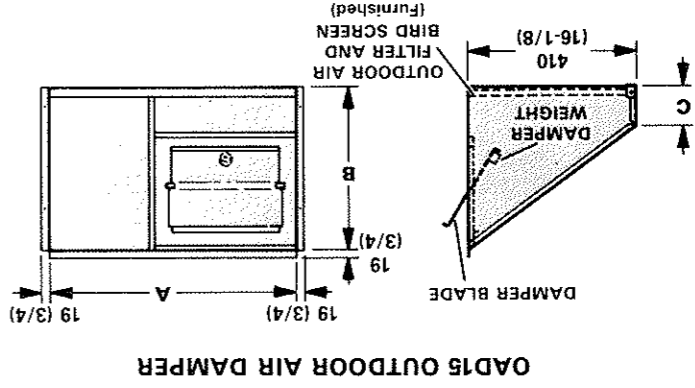

Model	A	B	C
OAD15-46	638	25-1/8	432
OAD15-65	816	32-1/8	610
Number	mm	in.	mm
	mm	in.	mm
	mm	in.	mm

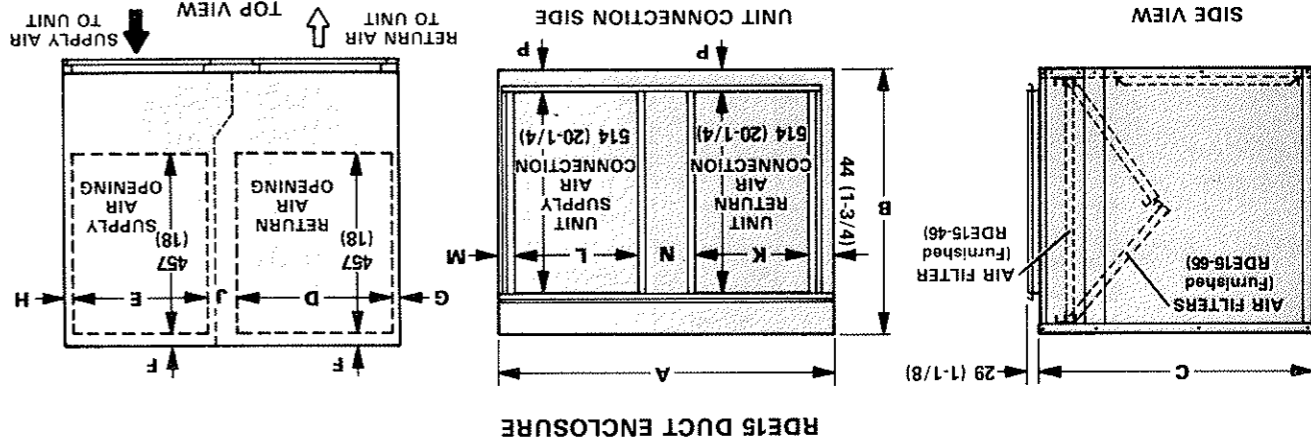

Model Number	A	B	C	D	E	F	G	H	J	K	L	M	N	P
RDE15-46	860	673	692	394	343	35	22	25	76	318	333	25	140	51
RDE15-65	1014	879	713	445	394	59	44	44	87	421	421	29	151	146
Number	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm
	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm
	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm	mm

COOLING AND HEATING RATINGS — 50 Hz

NOTE 1 — To determine sensible capacity, leaving wet bulb and dry bulb temperatures not shown in the tables, see Miscellaneous Engineering Data section, page 1.

Indoor Air Temperature	Outdoor Temperature															
	29°C (85°F)		35°C (95°F)		41°C (106°F)		46°C (115°F)		48°C (118°F)							
	Total Capacity	Compressor Input	Total Capacity	Compressor Input	Total Capacity	Compressor Input	Total Capacity	Compressor Input	Total Capacity	Compressor Input						
17.2°C (63°F)	310	650	6.1	20 900	1.78	7.2	83	98	5.7	19 400	1.96	7.5	87	100	1.00	1.00
19.4°C (67°F)	380	800	6.8	23 100	1.84	6.0	72	83	6.2	21 300	2.02	6.2	76	88	1.00	1.00
21.7°C (71°F)	450	950	7.4	25 100	1.90	4.5	58	72	6.8	23 200	2.08	4.7	61	76	1.00	1.00
17.2°C (63°F)	310	650	6.1	20 900	1.78	7.2	83	98	5.7	19 400	1.96	7.5	87	100	1.00	1.00
19.4°C (67°F)	380	800	6.8	23 100	1.84	6.0	72	83	6.2	21 300	2.02	6.2	76	88	1.00	1.00
21.7°C (71°F)	450	950	7.4	25 100	1.90	4.5	58	72	6.8	23 200	2.08	4.7	61	76	1.00	1.00

CHP15-261 HEATING CAPACITY

Indoor Air Temperature	Outdoor Temperature														
	18°C (65°F)		7°C (45°F)		-1°C (32°F)		-7°C (20°F)		-13°C (9°F)						
	Total Capacity	Compressor Input	Total Capacity	Compressor Input	Total Capacity	Compressor Input	Total Capacity	Compressor Input	Total Capacity	Compressor Input					
17.2°C (63°F)	310	650	6.1	20 900	1.78	7.2	83	98	5.7	19 400	1.96	7.5	87	100	1.00
19.4°C (67°F)	380	800	6.8	23 100	1.84	6.0	72	83	6.2	21 300	2.02	6.2	76	88	1.00
21.7°C (71°F)	450	950	7.4	25 100	1.90	4.5	58	72	6.8	23 200	2.08	4.7	61	76	1.00

CHP15-413 COOLING CAPACITY

Indoor Air Temperature	Outdoor Temperature														
	29°C (85°F)		35°C (95°F)		41°C (106°F)		46°C (115°F)		48°C (118°F)						
	Total Capacity	Compressor Input	Total Capacity	Compressor Input	Total Capacity	Compressor Input	Total Capacity	Compressor Input	Total Capacity	Compressor Input					
17.2°C (63°F)	470	1000	9.1	31 200	2.47	7.8	90	100	8.6	29 400	2.65	8.0	93	100	1.00
19.4°C (67°F)	560	1200	10.0	34 100	2.55	6.4	77	90	9.4	32 000	2.75	6.6	80	94	1.00
21.7°C (71°F)	660	1400	10.8	36 800	2.62	4.8	63	77	10.1	34 500	2.84	4.9	65	80	1.00

CHP15-413 HEATING CAPACITY

Indoor Air Temperature	Outdoor Temperature														
	18°C (65°F)		7°C (45°F)		-1°C (32°F)		-7°C (20°F)		-13°C (9°F)						
	Total Capacity	Compressor Input	Total Capacity	Compressor Input	Total Capacity	Compressor Input	Total Capacity	Compressor Input	Total Capacity	Compressor Input					
17.2°C (63°F)	470	1000	9.1	31 200	2.47	7.8	90	100	8.6	29 400	2.65	8.0	93	100	1.00
19.4°C (67°F)	560	1200	10.0	34 100	2.55	6.4	77	90	9.4	32 000	2.75	6.6	80	94	1.00
21.7°C (71°F)	660	1400	10.8	36 800	2.62	4.8	63	77	10.1	34 500	2.84	4.9	65	80	1.00

NOTE — Heating performance includes the effect of defrost cycles in the temperature range where they occur. At 70% relative humidity.

DIMENSIONS — mm (inches)



CHP15 BASIC UNIT

CORNER WEIGHTS


Model	N	P	Q	R
CHP15-261	32	70	29	65
CHP15-413	44	97	36	80
CHP15-513	60	132	57	125
CHP15-653	61	135	58	128

CENTER OF GRAVITY

Model	Number	L	M
CHP15-261	305	12	756
CHP15-413	359	14-1/8	832
CHP15-513-653	457	18	914

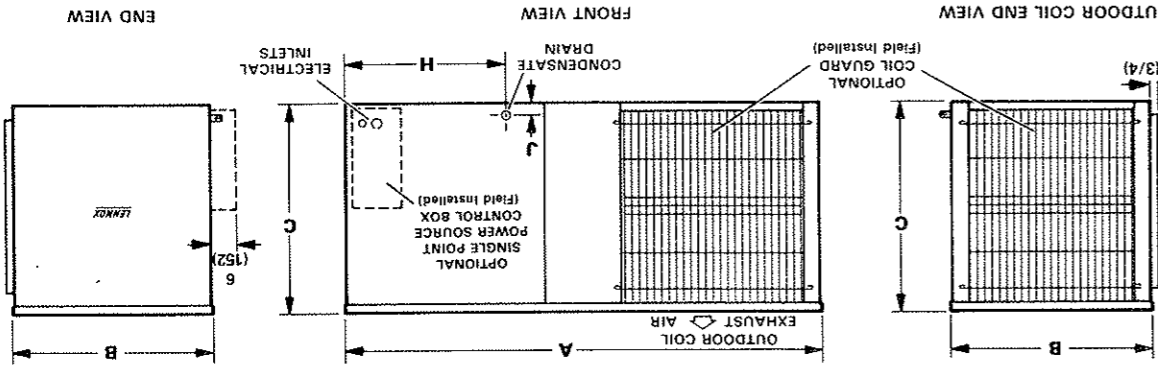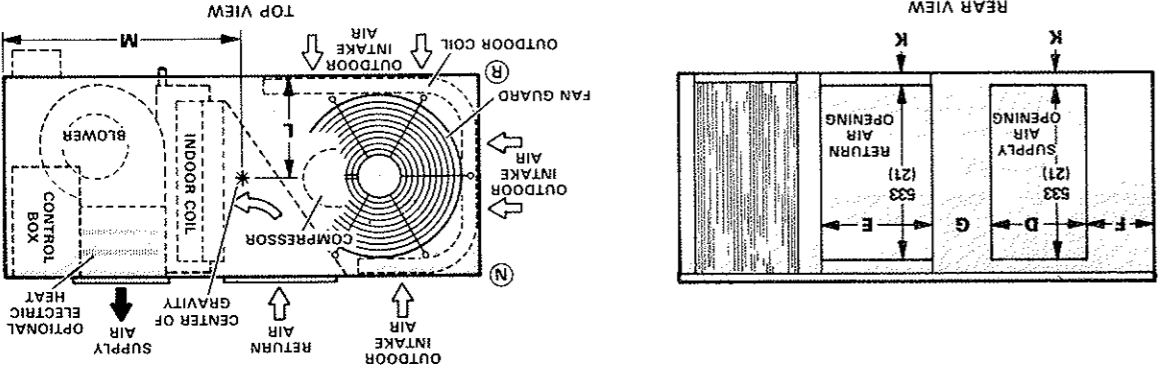

Model	A	B	C	D	E	F	G	H	J	K
CHP15-261	1454	57-1/4	610	24	641	25-1/4	348	13-11/16	341	13-7/16
CHP15-413	1530	60-1/4	781	30-3/4	714	28-1/8	348	13-11/16	338	13-5/16
CHP15-513-653	1778	70	940	37	879	34-5/8	391	15-3/8	440	17-5/16

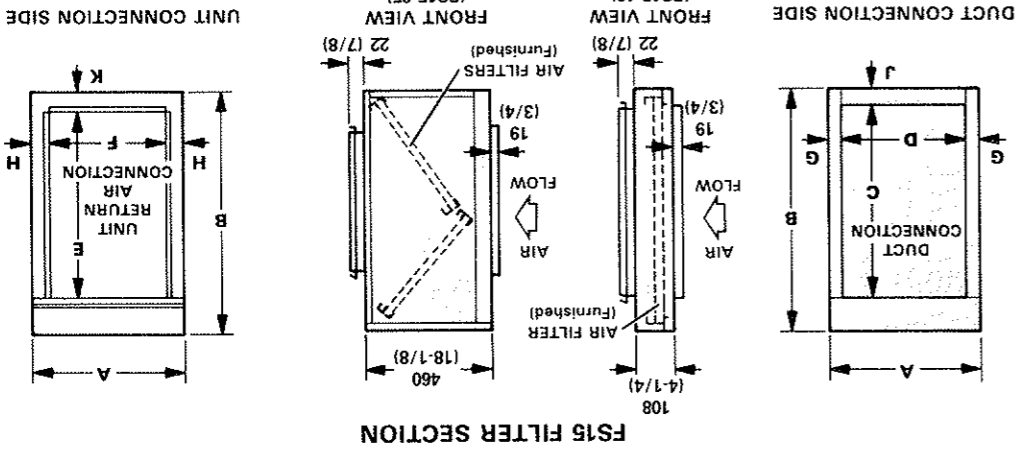

Model	A	B	C	D	E	F	G	H	J	K
FS15-46	425	16-3/4	673	26-1/2	540	21-1/4	349	13-3/4	514	20-1/4
FS15-65	530	20-7/8	879	34-5/8	533	21	441	17-3/8	518	20-3/8

GUIDE SPECIFICATIONS

COOLING AND HEATING RATINGS — 50 HZ

NOTE — To determine sensible capacity, leaving wet bulb and dry bulb temperature not shown in the tables, see Miscellaneous Engineering Data section, page 1.

Entering Air Temperature	Outdoor Temperature											
	41°C (105°F)				35°C (95°F)				29°C (85°F)			
	Total		Sensible		Total		Sensible		Total		Sensible	
Volume at 21°C (70°F)	L/s cfm		kW Btu/h		L/s cfm		kW Btu/h		L/s cfm		kW Btu/h	
	Capacity		Input		Capacity		Input		Capacity		Input	
Total Compressor	kW Btu/h		kW Btu/h		kW Btu/h		kW Btu/h		kW Btu/h		kW Btu/h	
	Heating Motor		Heating Motor		Heating Motor		Heating Motor		Heating Motor		Heating Motor	
Total Compressor		Total Compressor		Total Compressor		Total Compressor		Total Compressor		Total Compressor		
minus 28°C (minus 15°F)		minus 15°C (5°F)		minus 4°C (25°F)		minus 1°C (32°F)		minus 1°C (32°F)		minus 1°C (32°F)		

CHP15-513 COOLING CAPACITY

Entering Air Temperature	Outdoor Temperature											
	41°C (105°F)				35°C (95°F)				29°C (85°F)			
	Total		Sensible		Total		Sensible		Total		Sensible	
Volume at 21°C (70°F)	L/s cfm		kW Btu/h		L/s cfm		kW Btu/h		L/s cfm		kW Btu/h	
	Capacity		Input		Capacity		Input		Capacity		Input	
Total Compressor	kW Btu/h		kW Btu/h		kW Btu/h		kW Btu/h		kW Btu/h		kW Btu/h	
	Heating Motor		Heating Motor		Heating Motor		Heating Motor		Heating Motor		Heating Motor	
Total Compressor		Total Compressor		Total Compressor		Total Compressor		Total Compressor		Total Compressor		
minus 28°C (minus 15°F)		minus 15°C (5°F)		minus 4°C (25°F)		minus 1°C (32°F)		minus 1°C (32°F)		minus 1°C (32°F)		

CHP15-513 HEATING CAPACITY

Entering Air Temperature	Outdoor Temperature											
	41°C (105°F)				35°C (95°F)				29°C (85°F)			
	Total		Sensible		Total		Sensible		Total		Sensible	
Volume at 21°C (70°F)	L/s cfm		kW Btu/h		L/s cfm		kW Btu/h		L/s cfm		kW Btu/h	
	Capacity		Input		Capacity		Input		Capacity		Input	
Total Compressor	kW Btu/h		kW Btu/h		kW Btu/h		kW Btu/h		kW Btu/h		kW Btu/h	
	Heating Motor		Heating Motor		Heating Motor		Heating Motor		Heating Motor		Heating Motor	
Total Compressor		Total Compressor		Total Compressor		Total Compressor		Total Compressor		Total Compressor		
minus 28°C (minus 15°F)		minus 15°C (5°F)		minus 4°C (25°F)		minus 1°C (32°F)		minus 1°C (32°F)		minus 1°C (32°F)		

CHP15-653 COOLING CAPACITY

Entering Air Temperature	Outdoor Temperature											
	41°C (105°F)				35°C (95°F)				29°C (85°F)			
	Total		Sensible		Total		Sensible		Total		Sensible	
Volume at 21°C (70°F)	L/s cfm		kW Btu/h		L/s cfm		kW Btu/h		L/s cfm		kW Btu/h	
	Capacity		Input		Capacity		Input		Capacity		Input	
Total Compressor	kW Btu/h		kW Btu/h		kW Btu/h		kW Btu/h		kW Btu/h		kW Btu/h	
	Heating Motor		Heating Motor		Heating Motor		Heating Motor		Heating Motor		Heating Motor	
Total Compressor		Total Compressor		Total Compressor		Total Compressor		Total Compressor		Total Compressor		
minus 28°C (minus 15°F)		minus 15°C (5°F)		minus 4°C (25°F)		minus 1°C (32°F)		minus 1°C (32°F)		minus 1°C (32°F)		

CHP15-653 HEATING CAPACITY

Entering Air Temperature	Outdoor Temperature											
	41°C (105°F)				35°C (95°F)				29°C (85°F)			
	Total		Sensible		Total		Sensible		Total		Sensible	
Volume at 21°C (70°F)	L/s cfm		kW Btu/h		L/s cfm		kW Btu/h		L/s cfm		kW Btu/h	
	Capacity		Input		Capacity		Input		Capacity		Input	
Total Compressor	kW Btu/h		kW Btu/h		kW Btu/h		kW Btu/h		kW Btu/h		kW Btu/h	
	Heating Motor		Heating Motor		Heating Motor		Heating Motor		Heating Motor		Heating Motor	
Total Compressor		Total Compressor		Total Compressor		Total Compressor		Total Compressor		Total Compressor		
minus 28°C (minus 15°F)		minus 15°C (5°F)		minus 4°C (25°F)		minus 1°C (32°F)		minus 1°C (32°F)		minus 1°C (32°F)		

NOTE — Heating performance includes the effect of defrost cycles in the temperature range where they occur. *At 70% relative humidity.

Prepared for the guidance of architects, consulting engineers and mechanical contractors.

General — Furnish and install a single package heat pump unit complete with automatic controls. The single package unit shall be a standard product of a firm regularly engaged in the manufacture of heating-cooling equipment.

The installed weight shall not be more than _____ kg (lbs.). Entire unit shall have a width of not more than _____ mm (inches), a depth of not more than _____ mm (inches) and an overall height of not more than _____ mm (inches). The equipment shall be shipped completely factory assembled, precharged, piped and wired internally ready for field connection. In addition, manufacturer shall test operate system at the factory before shipment.

Air Distribution — Equipment shall be capable of horizontal or down-flow handling of conditioned air. All air distribution ducts shall be fiberglass or galvanized steel insulated with _____ mm (inch) thick _____ kg/m³ (lb./ft.³) density fiberglass or equivalent.

Furnish and install a (flush or stepdown) optional combination ceiling supply and return air grille. It shall be capable of not less than _____ m (ft.) radius of effective throw.

DX Cooling System — The total certified cooling capacity shall not be less than _____ kW (Btu/h) with an indoor coil air volume of _____ L/s (cfm), an entering wet bulb air temperature of _____ °C (°F), an entering dry bulb air temperature of _____ °C (°F), and an outdoor coil entering air temperature of _____ °C (°F). The compressor power input shall not exceed _____ kW at these conditions.

Heating System — The total certified heating capacity shall not be less than _____ kW (Btu/h) with an indoor coil air volume of _____ L/s (cfm), an entering wet bulb air temperature of _____ °C (°F), an entering dry bulb air temperature of _____ °C (°F) and an outdoor coil entering air temperature of _____ °C (°F). The total compressor power input shall not exceed _____ kW at the above conditions.

The coils shall be non-ferrous construction with aluminum fins mechanically bonded to durable copper tubes. Coils shall be pressure leak tested. Coil m² (sq. ft.) (outdoor) and _____ m² (sq. ft.) (indoor) and _____ m² (sq. ft.) (outdoor).

The compressor shall be resiliently mounted, have overload protection, internal pressure relief and crankcase heater. The refrigeration system shall have reversing valve, suction and discharge line service gauge ports, high pressure switch, suction line accumulator, check valve, hi-capacity drier, defrost control, and a full refrigerant charge. CHP15-261 shall have sight glass and discharge thermostat. CHP15-413, 513, 653 shall be equipped with thermometer well, crankcase thermostat and expansion valve. Control options available shall consist of thermostat, timed-off control, low ambient control and start controls (CHP15-261 only).

Supplementary Electric Heating System — The certified total heating capacity output shall be _____ kW (Btu/h) at _____ volts power supply.

Optional electric heaters shall be field installed. Heating elements shall be installed external to the unit and provide single power source connection and sub-fusing for electric heat. Shall be of galvanized steel with outdoor enamel paint, mounting holes, electrical inlets and hinged cover.

Single-Point Power Source Control Box — Optional box shall field install external to the unit and provide single power source connection and sub-fusing for electric heat. Shall be of galvanized steel with outdoor enamel paint, mounting holes, electrical inlets and hinged cover.

Remote Status Panel — Shall be available for installation within the conditioned area to observe equipment operation. The panel shall include signal lights for Cool Mode, Heat Mode, Compressor, No Heat and Filter.

CHP15-513 and CHP15-653 Control Systems — Shall provide a selection of optional thermostats and related controls to automatically operate the mechanical equipment through the heating or cooling and venting cycles as required.

Service Access — All components, wiring and inspection areas shall be completely accessible through removable panels.

Cabinet — Shall be of galvanized steel with a baked-on outdoor enamel paint finish. Cabinet panels where conditioned air is handled shall be fully insulated to prevent sweating and minimize sound. Openings shall be provided for power connection entry. Base shall have drainage holes in outdoor coil section.

Air Movers — Centrifugal conditioned air blower shall be direct driven by a multi-speed motor and be capable of delivering _____ L/s (cfm) at an external static pressure of _____ Pa (inches water gauge) requiring not more than _____ W (hp) and _____ rev/min. Blower shall be statically and dynamically balanced.

Air Filters - Cleanable filters furnished shall have not less than _____ W (hp) motor. Propeller type outdoor fan shall be direct driven by a _____ W (hp) motor. Fan motor shall be permanently lubricated and inherently protected.

Root Mounting Frame — Furnish and install a steel roof mounting frame with mounting p/rtom. When flashed into the roof it shall make a unit mounting curb and provide weatherproof duct connection and entry into the conditioned area. Flashing shall be the responsibility of a roofing contractor.

Duct Enclosure — Furnish and install an optional factory assembled duct enclosure complete with filter(s). Enclosure shall attach to the single package unit and mate to the roof mounting frame providing weatherproof duct connection and entry into the conditioned area. Enclosure shall be of galvanized steel with a baked-on outdoor enamel paint finish and shall be completely insulated.

Economizer Damper Section — Furnish and install complete with recirculated air dampers, air filter(s), damper motor, outdoor air hood with damper and controls. Dampers shall ride in nylon bearings. The economizer section shall provide for the introduction of 100% outside air for minimum Dampers shall be 24 volt, 3 position spring return. Controls shall include adjustable mixed air controller, adjustable compressor monitor and adjustable enthalpy control.

Gravity Exhaust Dampers — Optional pressure operated damper shall be available for field installation in economizer damper section. Damper blade shall ride in nylon bearings and be gasketed for tight seal. Shall be equipped with bird screen.

Outdoor Air Damper — Optional outdoor air hood and damper shall be available to provide outdoor air requirements. Damper box field installs external to duct enclosure. Damper shall open automatically when blower is operating and close when blower stops. Shall be equipped with filter(s) for extra air filtering and bird screen protection.

Filter Section — Optional filter section shall field install to single package unit. Shall be of galvanized steel with a baked-on outdoor enamel finish and completely insulated. Shall have frame type disposable air filter(s).

Over and Under Duct Transition — Optional transition shall be available for field conversion of single package unit from side by side supply and return air openings to over and under openings for replacement of units in applications with over and under duct connections. Shall be of galvanized steel with a baked-on enamel finish and shall be insulated. Shall have frame type disposable air filter(s).

Single-Point Power Source Control Box — Optional box shall field install external to the unit and provide single power source connection and sub-fusing for electric heat. Shall be of galvanized steel with outdoor enamel paint, mounting holes, electrical inlets and hinged cover.

Remote Status Panel — Shall be available for installation within the conditioned area to observe equipment operation. The panel shall include signal lights for Cool Mode, Heat Mode, Compressor, No Heat and Filter.

CHP15-513 and CHP15-653 Control Systems — Shall provide a selection of optional thermostats and related controls to automatically operate the mechanical equipment through the heating or cooling and venting cycles as required.

Service Access — All components, wiring and inspection areas shall be completely accessible through removable panels.

Cabinet — Shall be of galvanized steel with a baked-on outdoor enamel paint finish. Cabinet panels where conditioned air is handled shall be fully insulated to prevent sweating and minimize sound. Openings shall be provided for power connection entry. Base shall have drainage holes in outdoor coil section.

NOTE — All air volume data is measured external to the unit.
NOTE — Electric heaters have no appreciable air resistance.

External Static Pressure		Air Volume at Various Speeds					
Pa in. wg.	L/s cfm	High		Medium		Low	
		L/s cfm	L/s cfm	L/s cfm	L/s cfm	L/s cfm	L/s cfm
0	0	645	1365	545	1155	410	865
25	0.10	620	1315	520	1105	385	815
50	0.20	595	1260	500	1055	360	760
75	0.30	570	1205	475	1005	335	710
100	0.40	540	1145	450	950	305	650
125	0.50	510	1085	420	895	280	595
150	0.60	485	1030	395	840	255	540

BLOWER PERFORMANCE

NOTE — Electric heaters have no appreciable air resistance.
Air resistance is with the air filter in place.

Unit Number	Air Volume	L/s cfm	ECONOMD15	ECONOMD15	ECONOMD15	TRDE15	TRFS15	TRDT15	TRDU15	TRDU15	Total Resistance — Pa (in. w.g.)	
											1 Side	2 Ends
CHP15-261	380	800	40 (0.16)	40 (0.16)	52 (0.21)	52 (0.21)	40 (0.16)	27 (0.11)	40 (0.16)	40 (0.16)	27 (0.11)	27 (0.11)
	470	1000	52 (0.21)	52 (0.21)	62 (0.25)	62 (0.25)	50 (0.20)	32 (0.13)	50 (0.20)	50 (0.20)	32 (0.13)	35 (0.14)
	565	1200	62 (0.25)	62 (0.25)	72 (0.29)	72 (0.29)	60 (0.24)	47 (0.19)	60 (0.24)	60 (0.24)	47 (0.19)	42 (0.17)
	660	1400	67 (0.27)	67 (0.27)	78 (0.30)	78 (0.30)	67 (0.27)	57 (0.23)	67 (0.27)	67 (0.27)	57 (0.23)	47 (0.19)
	755	1600	75 (0.30)	75 (0.30)	82 (0.33)	82 (0.33)	75 (0.30)	62 (0.25)	82 (0.33)	82 (0.33)	62 (0.25)	60 (0.24)
	850	1800	82 (0.33)	82 (0.33)	88 (0.36)	88 (0.36)	82 (0.33)	68 (0.28)	88 (0.36)	88 (0.36)	68 (0.28)	75 (0.30)
	945	2000	107 (0.43)	107 (0.43)	114 (0.46)	114 (0.46)	107 (0.43)	94 (0.38)	114 (0.46)	114 (0.46)	94 (0.38)	109 (0.44)
	1040	2200	114 (0.46)	114 (0.46)	124 (0.50)	124 (0.50)	114 (0.46)	99 (0.40)	124 (0.50)	124 (0.50)	99 (0.40)	124 (0.50)
	1135	2400	124 (0.50)	124 (0.50)	139 (0.56)	139 (0.56)	124 (0.50)	107 (0.43)	139 (0.56)	139 (0.56)	107 (0.43)	124 (0.50)
	1350	2800	154 (0.61)	154 (0.61)	174 (0.70)	174 (0.70)	154 (0.61)	139 (0.56)	174 (0.70)	174 (0.70)	139 (0.56)	154 (0.61)


ACCESSORY AIR RESISTANCE

BLOWER DATA

NOTE — All wiring must conform to local electrical codes.
— Field wiring not furnished —

NOTE — All wiring must conform to local electrical codes.
— Field wiring not furnished —

- A — Three phase with neutral (See Electrical Data Table)
- B — Seven wire 24V
- C — Five wire 24V — with SSP11 Switching Status Panel
- D — Twelve wire 24V
- E — Two wire 24V
- F — Twenty-One wire 24V

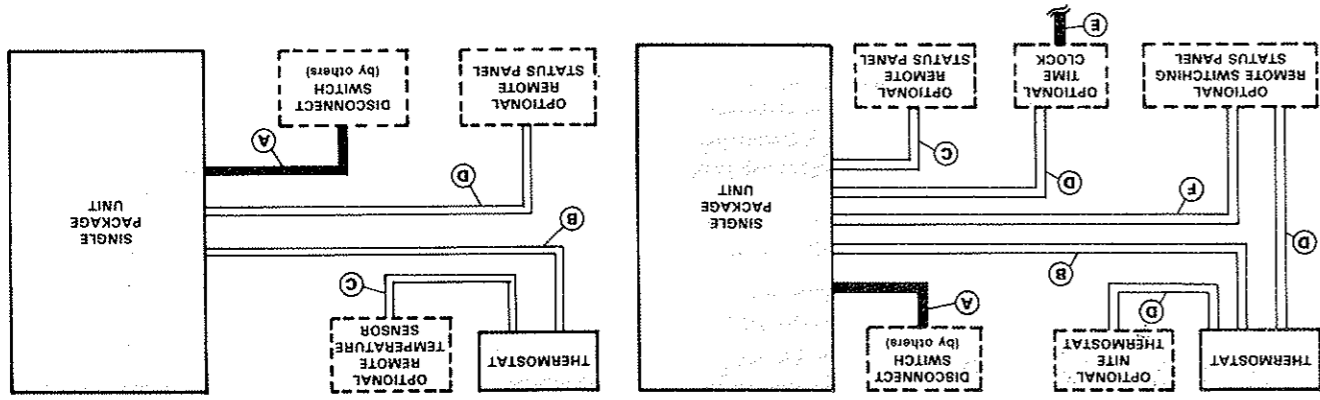

FIELD WIRING

CHP15-513 AND CHP15-653 MODELS ONLY
FLEXSTAT THERMOSTAT

CHP15-513 AND CHP15-653 MODELS ONLY
ELECTRO-MECHANICAL THERMOSTAT

OPTIONAL ELECTRIC HEAT DATA

Model Number	Shipping Weight	Electric Heat Unit Model Number and Elements (Steps) and Phase	Number of Elements (Steps) and Phase	Volts Input	Heating Capacity	
					kW	Btu/h
CHP15-261	2 kg (5 lbs.)	ECB18-5	1 (1 phase)	220	4.2	14 300
					4.6	15 700
	3 kg (6 lbs.)	ECB18-7	2 (1 phase)	220	5.9	20 100
					6.4	21 900
	3 kg (6 lbs.)	ECB18-10	2 (1 phase)	240	7.0	23 900
					8.4	28 700
	3 kg (6 lbs.)	ECB18-10	2 (1 phase)	230	9.2	31 400
					10.0	34 100
	5 kg (11 lbs.)	ECB18-15	3 (1 phase)	220	12.6	43 000
					13.5	47 000
5 kg (11 lbs.)	ECB18-15	3 (1 phase)	240	15.0	51 200	
				17.8	59 400	
7 kg (16 lbs.)	ECB18-19.1	6 (3 phase)	400	19.1	65 200	
				20.9	71 300	
10 kg (21 lbs.)	ECB18-23.0	6 (3 phase)	420	23.0	78 500	
				20.9	71 300	


Refer to local electrical code manual to determine wire, fuse and disconnect size requirements.
Use wire suitable for at least 75°C (167°F).

Model Number	Line voltage and phase (50 Hz)	Voltage range (minimum - maximum)	Rated load (A)	Compressor	Condenser	Fan Motor	Evaporator	Blower Motor
CHP15-663	380/420V 3 phase with neutral	198V - 264V	10.2	Rated load (A) 5.9	Full Load (A) 1.1	Full Load (A) 1.7	Full load (A) 2.6	Blower Motor Locked Rotor (A)
CHP15-613	380/420V 3 phase with neutral	342V - 462V	10.2	Rated load (A) 5.9	Full Load (A) 1.2	Full Load (A) 1.7	Full load (A) 2.8	Blower Motor Locked Rotor (A)
CHP15-413	380/420V 3 phase with neutral	342V - 462V	10.2	Rated load (A) 5.9	Full Load (A) 1.2	Full Load (A) 1.7	Full load (A) 2.8	Blower Motor Locked Rotor (A)
CHP15-261	220/240V 1 phase	198V - 264V	10.2	Rated load (A) 5.9	Full Load (A) 1.1	Full Load (A) 1.7	Full load (A) 2.2	Blower Motor Locked Rotor (A)
CHP15-613	380/420V 3 phase with neutral	342V - 462V	10.3	Rated load (A) 5.9	Full Load (A) 1.2	Full Load (A) 1.7	Full load (A) 2.8	Blower Motor Locked Rotor (A)
CHP15-663	380/420V 3 phase with neutral	342V - 462V	10.3	Rated load (A) 5.9	Full Load (A) 1.2	Full Load (A) 1.7	Full load (A) 2.8	Blower Motor Locked Rotor (A)

NOTE - Refer to local electrical codes to determine wire, fuse and disconnect size requirements.

ELECTRICAL DATA

FIELD WIRING

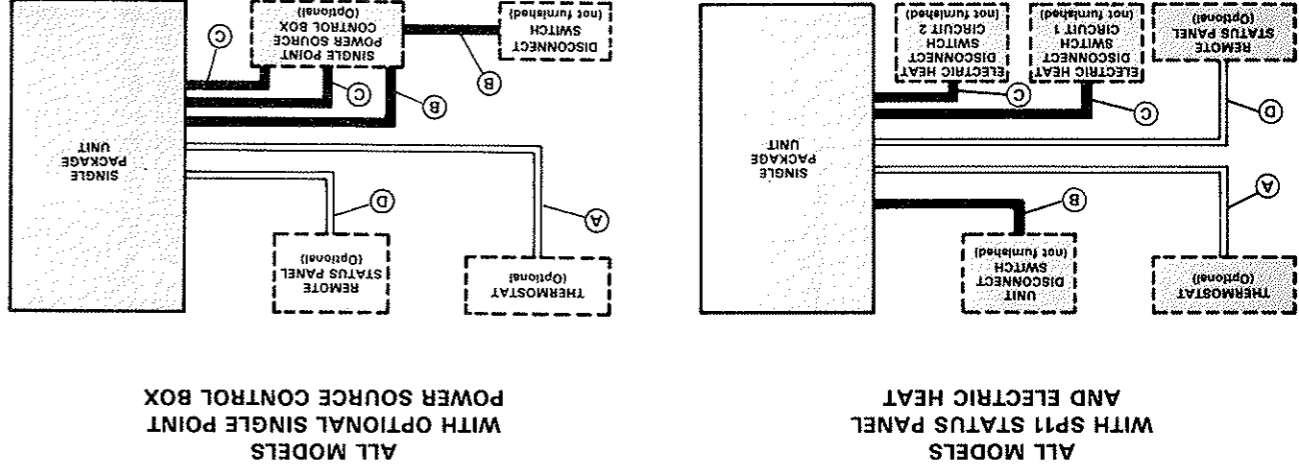

- A - Five wire 24V (Cooling Only installation)
 - Six wire 24V (Cooling with Economizer or Electric Heat)
 - Seven wire 24V (Cooling with Economizer and Electric Heat)
 - B - Single phase or three phase with neutral (See Electrical Data Table)
 - C - Single phase or three phase with neutral (See Electric Heat Data Table)
 - D - Seven wire 24V
- NOTE - All wiring must conform to local electrical codes.
- Field Wiring Not Furnished -

External Static Pressure	Air Volume at Various Speeds			
	High	Med-High	Med-Low	Low
Pa in. wg.	790	1675	625	1320
L/s cfm	405	855	405	855
Pa in. wg.	75	1495	545	1150
L/s cfm	305	650	305	650
Pa in. wg.	705	1495	545	1150
L/s cfm	305	650	305	650
Pa in. wg.	685	1455	525	1110
L/s cfm	305	650	305	650
Pa in. wg.	705	1495	545	1150
L/s cfm	305	650	305	650
Pa in. wg.	150	0.60	685	1455
L/s cfm	125	0.50	705	1495

CHP15-413

NOTE - All air volume data is measured external to the unit.
NOTE - Electric heaters have no appreciable air resistance.
NOTE - Unit should not be operated in the heating cycle within the shaded area.

External Static Pressure	Air Volume at Various Speeds			
	High	Medium	Low	Low
Pa in. wg.	965	2045	755	1595
L/s cfm	405	855	405	855
Pa in. wg.	75	1485	530	1255
L/s cfm	305	650	305	650
Pa in. wg.	705	1485	530	1255
L/s cfm	305	650	305	650
Pa in. wg.	640	1360	485	1015
L/s cfm	305	650	305	650
Pa in. wg.	705	1485	530	1255
L/s cfm	305	650	305	650
Pa in. wg.	150	0.60	685	1455
L/s cfm	125	0.50	705	1495

CHP15-513 AND CHP15-653


NOTE - All air volume data is measured external to the unit.
NOTE - Electric heaters have no appreciable air resistance.
NOTE - Units should not be operated in the heating cycle within the shaded area.

COMBINATION CEILING SUPPLY AND RETURN DIFFUSERS AIR THROW DATA

Grille Volume	Air Volume		Effective Throw - m (ft)	
	Horizontal	Vertical	Horizontal	Vertical
45° Down	180° Straight	22° Down	4.5 (15)	6.5 (21)
380	800	6.5 (22)	6.5 (21)	4.5 (15)
470	1000	7.5 (24)	6.5 (22)	5.0 (16)
565	1200	7.5 (25)	7.0 (23)	5.0 (17)
660	1400	8.0 (27)	7.5 (25)	5.5 (18)
755	1600	8.0 (27)	8.0 (26)	6.0 (19)
850	1800	8.5 (28)	8.0 (27)	6.0 (20)
945	2000	9.0 (30)	8.5 (28)	6.5 (21)
1040	2200	9.0 (30)	9.0 (30)	6.5 (22)
1135	2400	10.5 (34)	10.5 (34)	7.0 (23)
380	800	4.5 (15)	4.5 (15)	2.5 (9)
470	1000	5.0 (16)	5.0 (17)	3.0 (10)
565	1200	5.5 (18)	5.5 (17)	3.5 (11)
660	1400	6.0 (19)	6.0 (19)	3.5 (12)
755	1600	6.0 (20)	6.0 (20)	4.0 (13)
850	1800	6.5 (21)	6.5 (21)	4.0 (13)
945	2000	7.0 (23)	7.0 (23)	4.5 (14)
1040	2200	7.5 (25)	7.5 (25)	5.0 (16)
1135	2400	8.0 (27)	8.0 (27)	5.0 (17)
380	800	3.5 (12)	3.5 (12)	2.5 (8)
470	1000	4.0 (13)	4.0 (13)	2.5 (8)
565	1200	4.5 (14)	4.5 (14)	2.5 (9)
660	1400	4.5 (15)	4.5 (15)	3.0 (10)
755	1600	4.5 (15)	4.5 (15)	3.0 (10)
850	1800	5.0 (16)	5.0 (16)	3.0 (10)
945	2000	5.0 (16)	5.0 (16)	3.5 (11)
1040	2200	5.5 (17)	5.5 (17)	3.5 (11)
1135	2400	6.0 (20)	6.0 (20)	4.0 (13)
380	800	3.5 (12)	3.5 (12)	2.5 (8)
470	1000	4.0 (13)	4.0 (13)	2.5 (8)
565	1200	4.5 (14)	4.5 (14)	2.5 (9)
660	1400	4.5 (15)	4.5 (15)	3.0 (10)
755	1600	4.5 (15)	4.5 (15)	3.0 (10)
850	1800	5.0 (16)	5.0 (16)	3.0 (10)
945	2000	5.0 (16)	5.0 (16)	3.5 (11)
1040	2200	5.5 (17)	5.5 (17)	3.5 (11)
1135	2400	6.0 (20)	6.0 (20)	4.0 (13)

RTD9-65 STEP-DOWN

Effective throw is terminated at a point where conditioned air velocity has decreased to 15m (50 ft.) per minute.

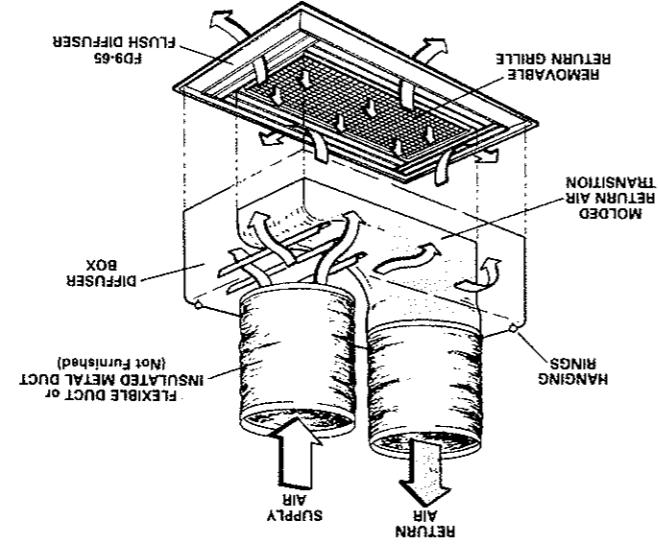

DIFFUSER AIR PATTERN


FD9-65 FLUSH

Air Volume	Effective Throw - m (ft.)	
	L/s cfm	L/s cfm
380	2.5 (8)	2.5 (8)
470	2.5 (8)	2.5 (8)
565	2.5 (9)	2.5 (9)
660	3.0 (10)	3.0 (10)
755	3.0 (10)	3.0 (10)
850	3.5 (11)	3.5 (11)
945	3.5 (12)	3.5 (12)
1040	4.0 (13)	4.0 (13)
1135	4.0 (13)	4.0 (13)

Effective throw is terminated at a point where conditioned air velocity has decreased to 15m (50 ft.) per minute.


CHP15-513 AND CHP15-653 MODELS ONLY
TEMPERATURE CONTROL SELECTION FLOW CHART

ELECTRO-MECHANICAL THERMOSTAT

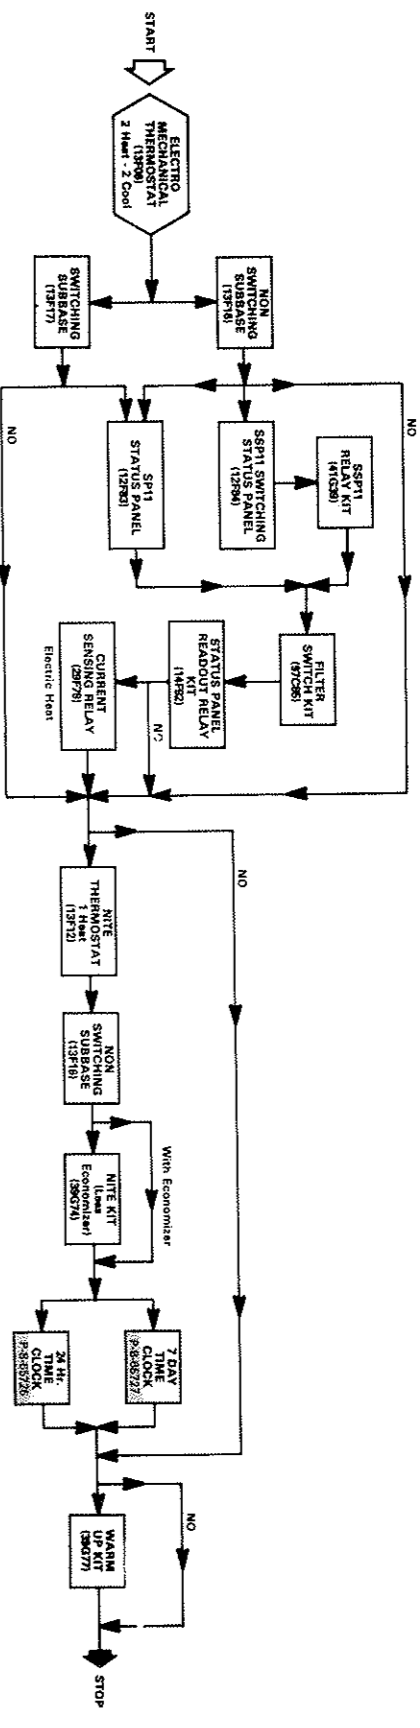


Note: Models 261 and 413 use standard heat pump thermostat.

FLEXSTAT THERMOSTAT

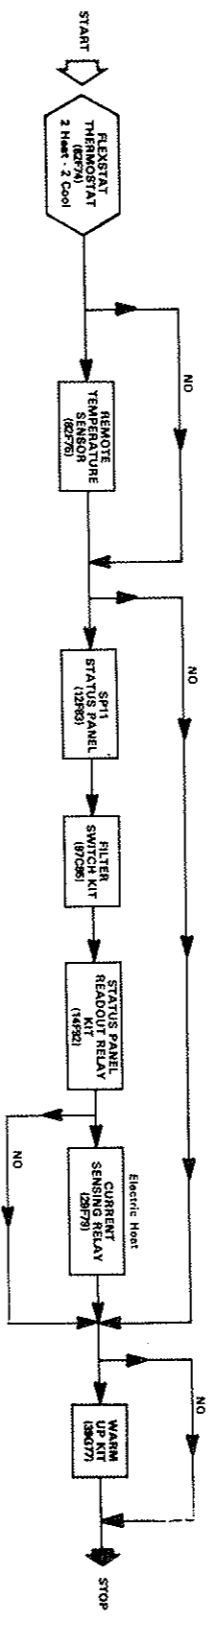

CHP15-511-513 AND CHP15-651-653 MODELS ONLY
TEMPERATURE CONTROL SELECTION FLOW CHART

W973 CONTROL SYSTEM

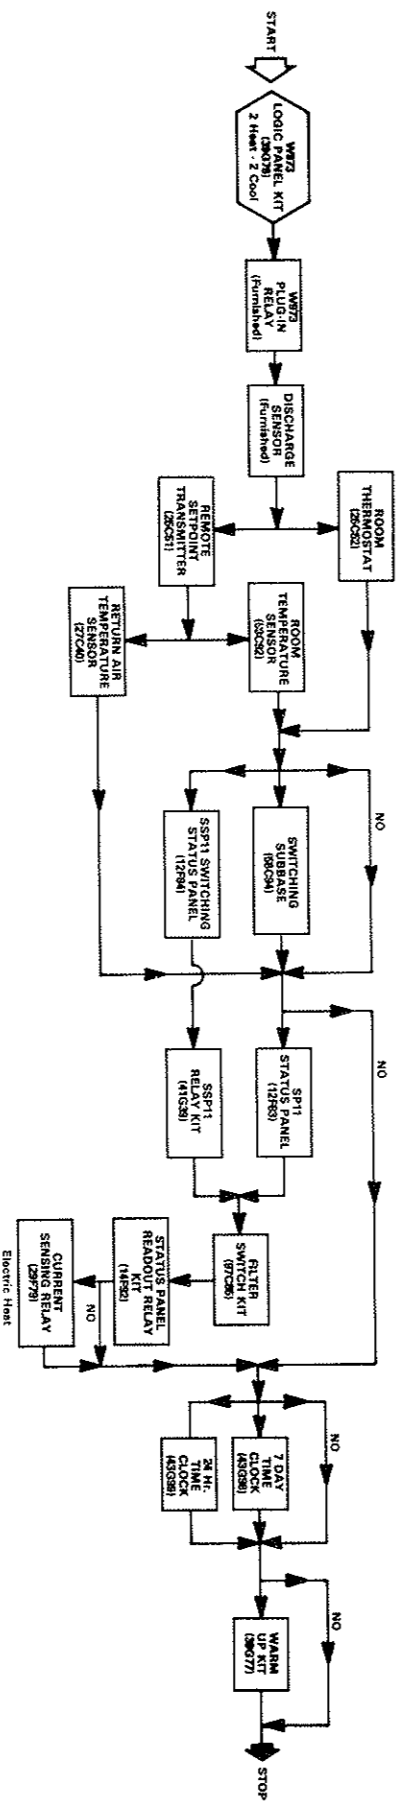

W7400 CONTROL SYSTEM

