
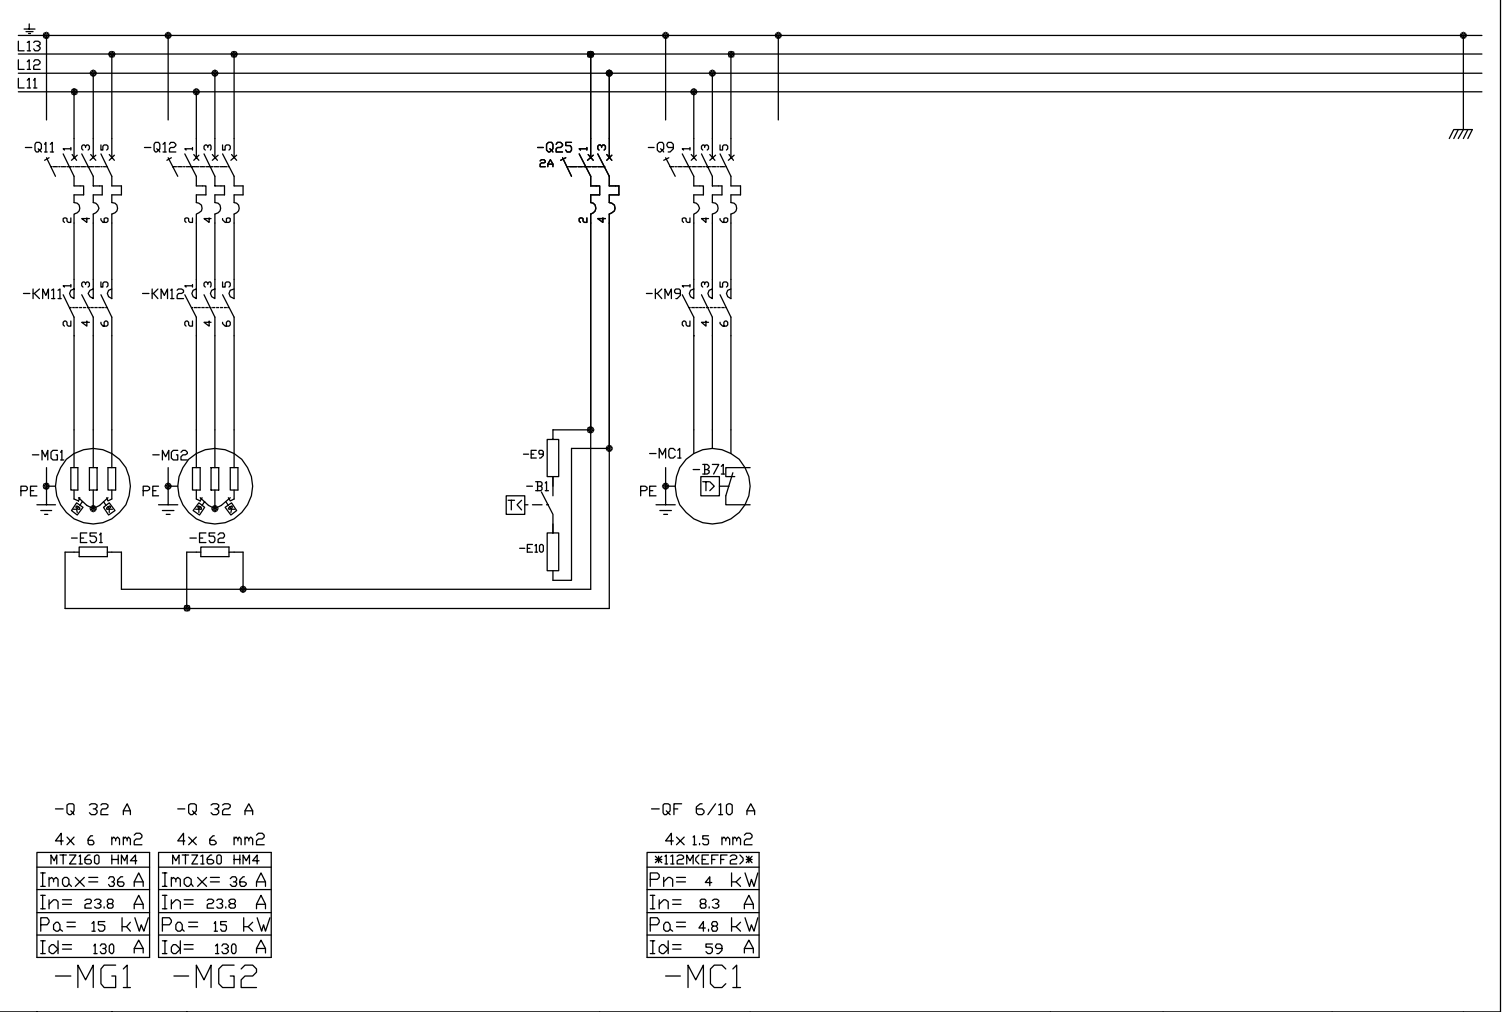
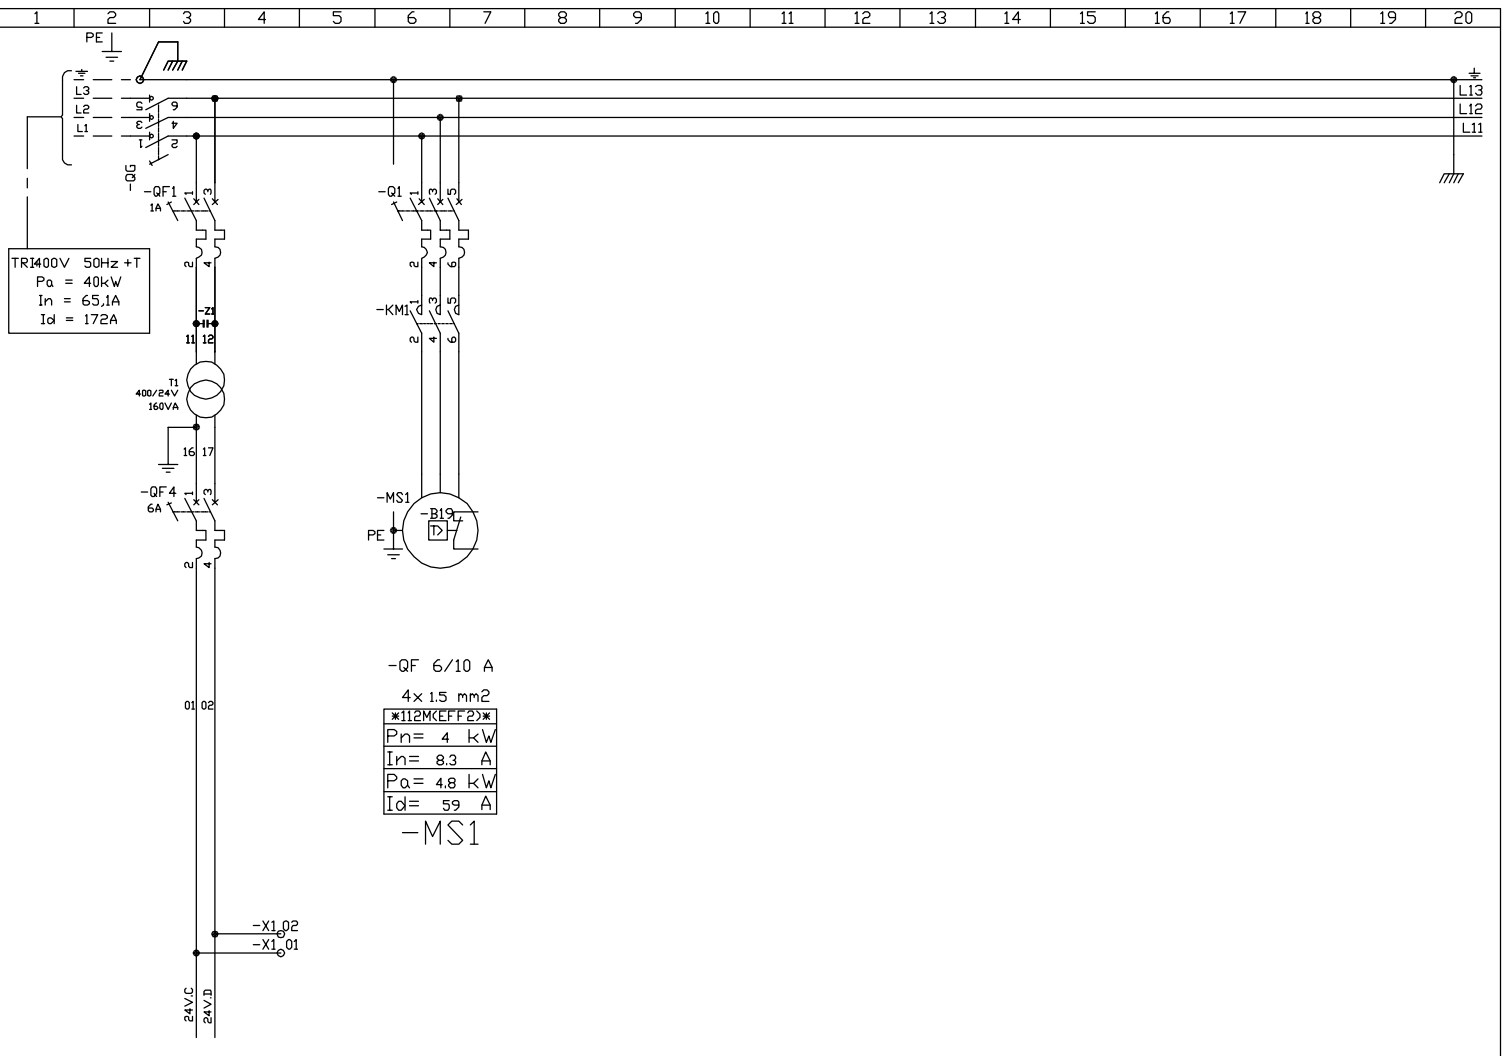
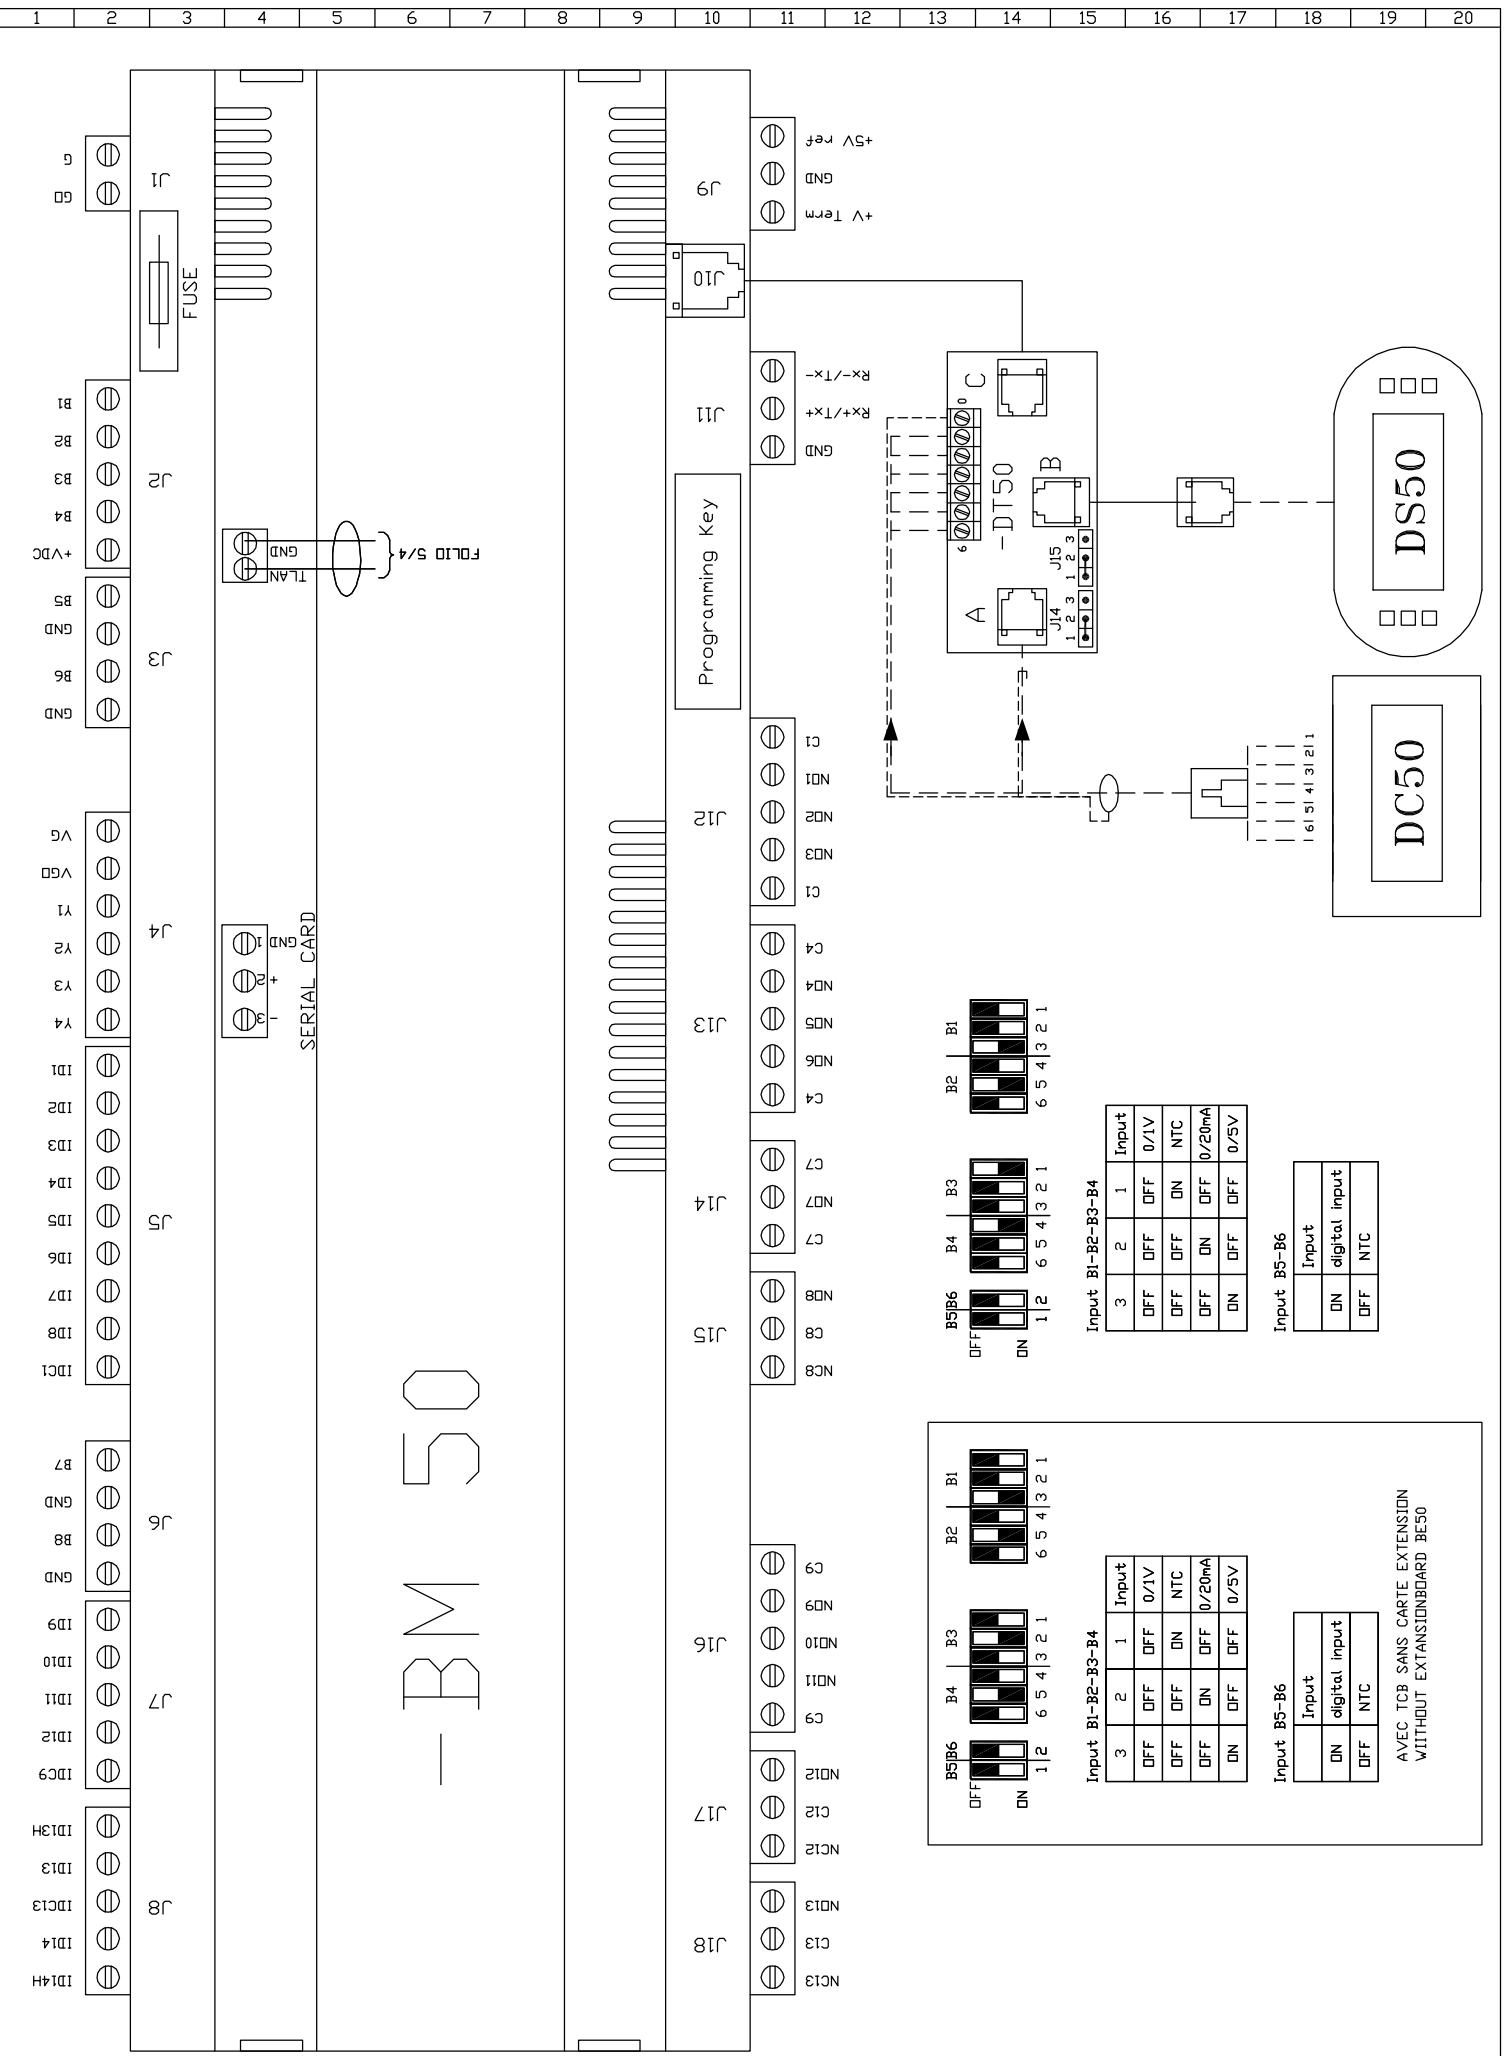


Indice	DATE	NOM	MODIFICATIONS
			
<i>Fitzgeralds</i>			
(1) FXK 085 N	Dessine: CTO	PAGE DE GARDE	249638 0/11
LENNOX UK	Date: 21.08.06		





Indice	DATE	NOM	MODIFICATIONS

(1) FXK 085 N
Automate CLIMATIC 50
Climatic 50 Controller

Dessine: CTO
Date: 21.08.06



249638 2/11

Input B1-B2-B3-B4

Input	1	2	3
0/1V	OFF	OFF	OFF
NTC	DN	OFF	OFF
0/20mA	OFF	DN	OFF
0/5V	OFF	OFF	DN

Input B5-B6

Input	digital input	NTC
DN	OFF	OFF


Input B1-B2-B3-B4

Input	1	2	3
0/1V	OFF	OFF	OFF
NTC	DN	OFF	OFF
0/20mA	OFF	DN	OFF
0/5V	OFF	OFF	DN

Input B5-B6

Input	digital input	NTC
DN	OFF	OFF

AVEC TCB SANS CARTE EXTENSION
WITHOUT EXTENSIONBOARD BE50

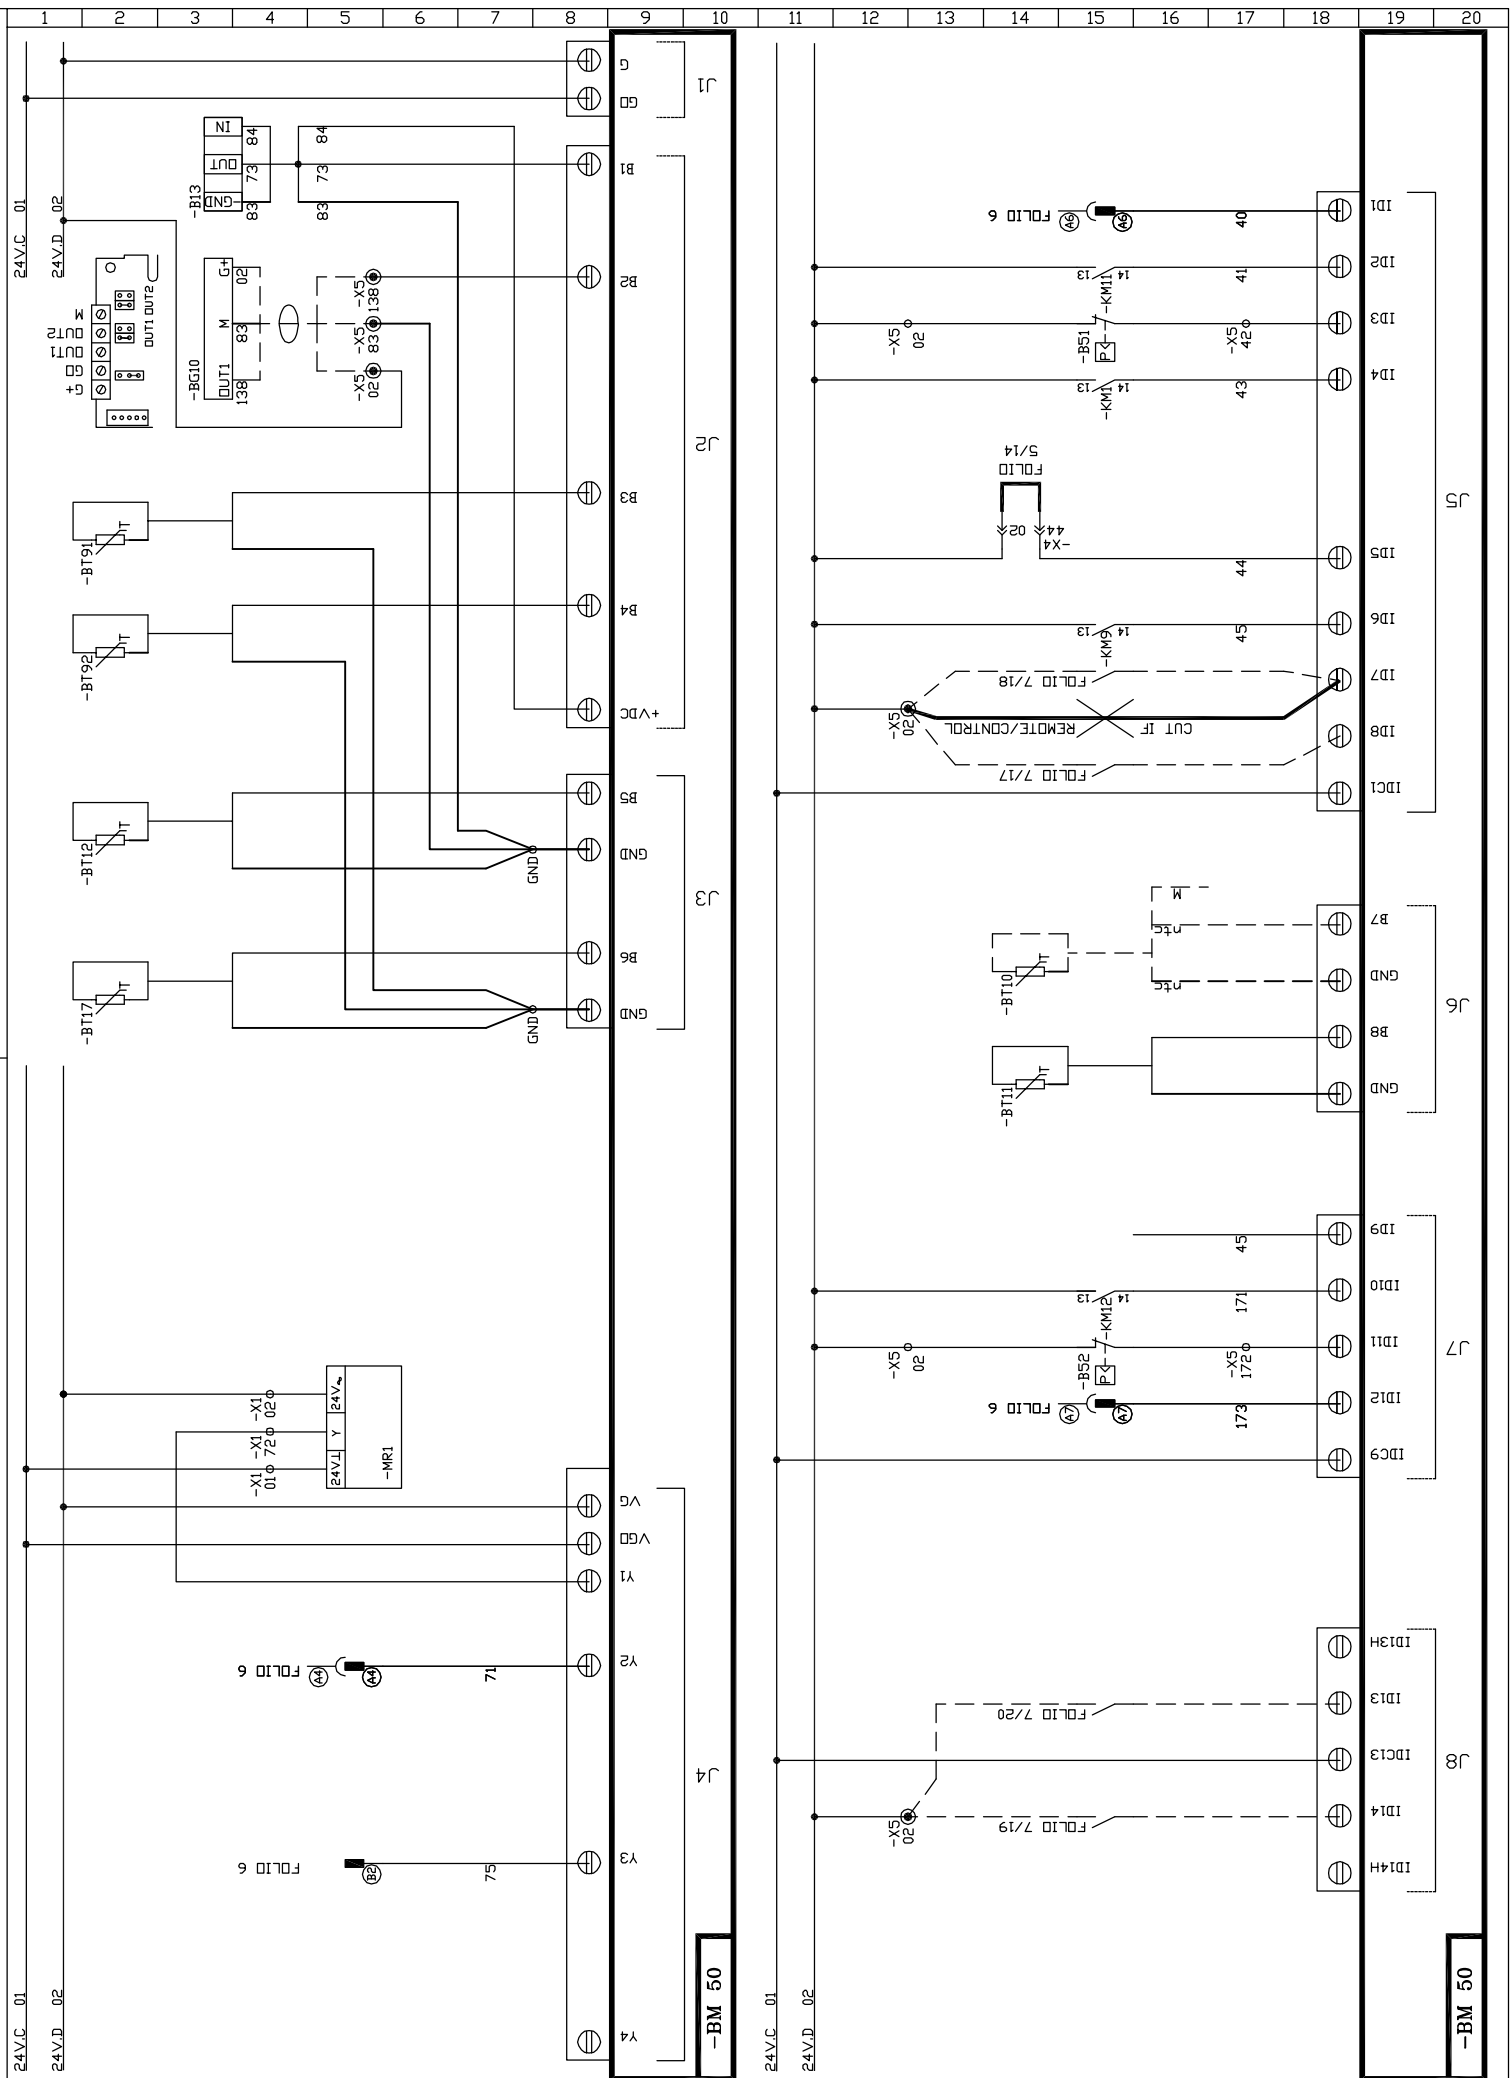


Indice	DATE	NOM	MODIFICATIONS



(1) FXK 085 N
Entrées Automate CLIMATIC 50
Climatic 50 Controller Input

Dessine: CTO
Date: 21.08.06



249638 3/11

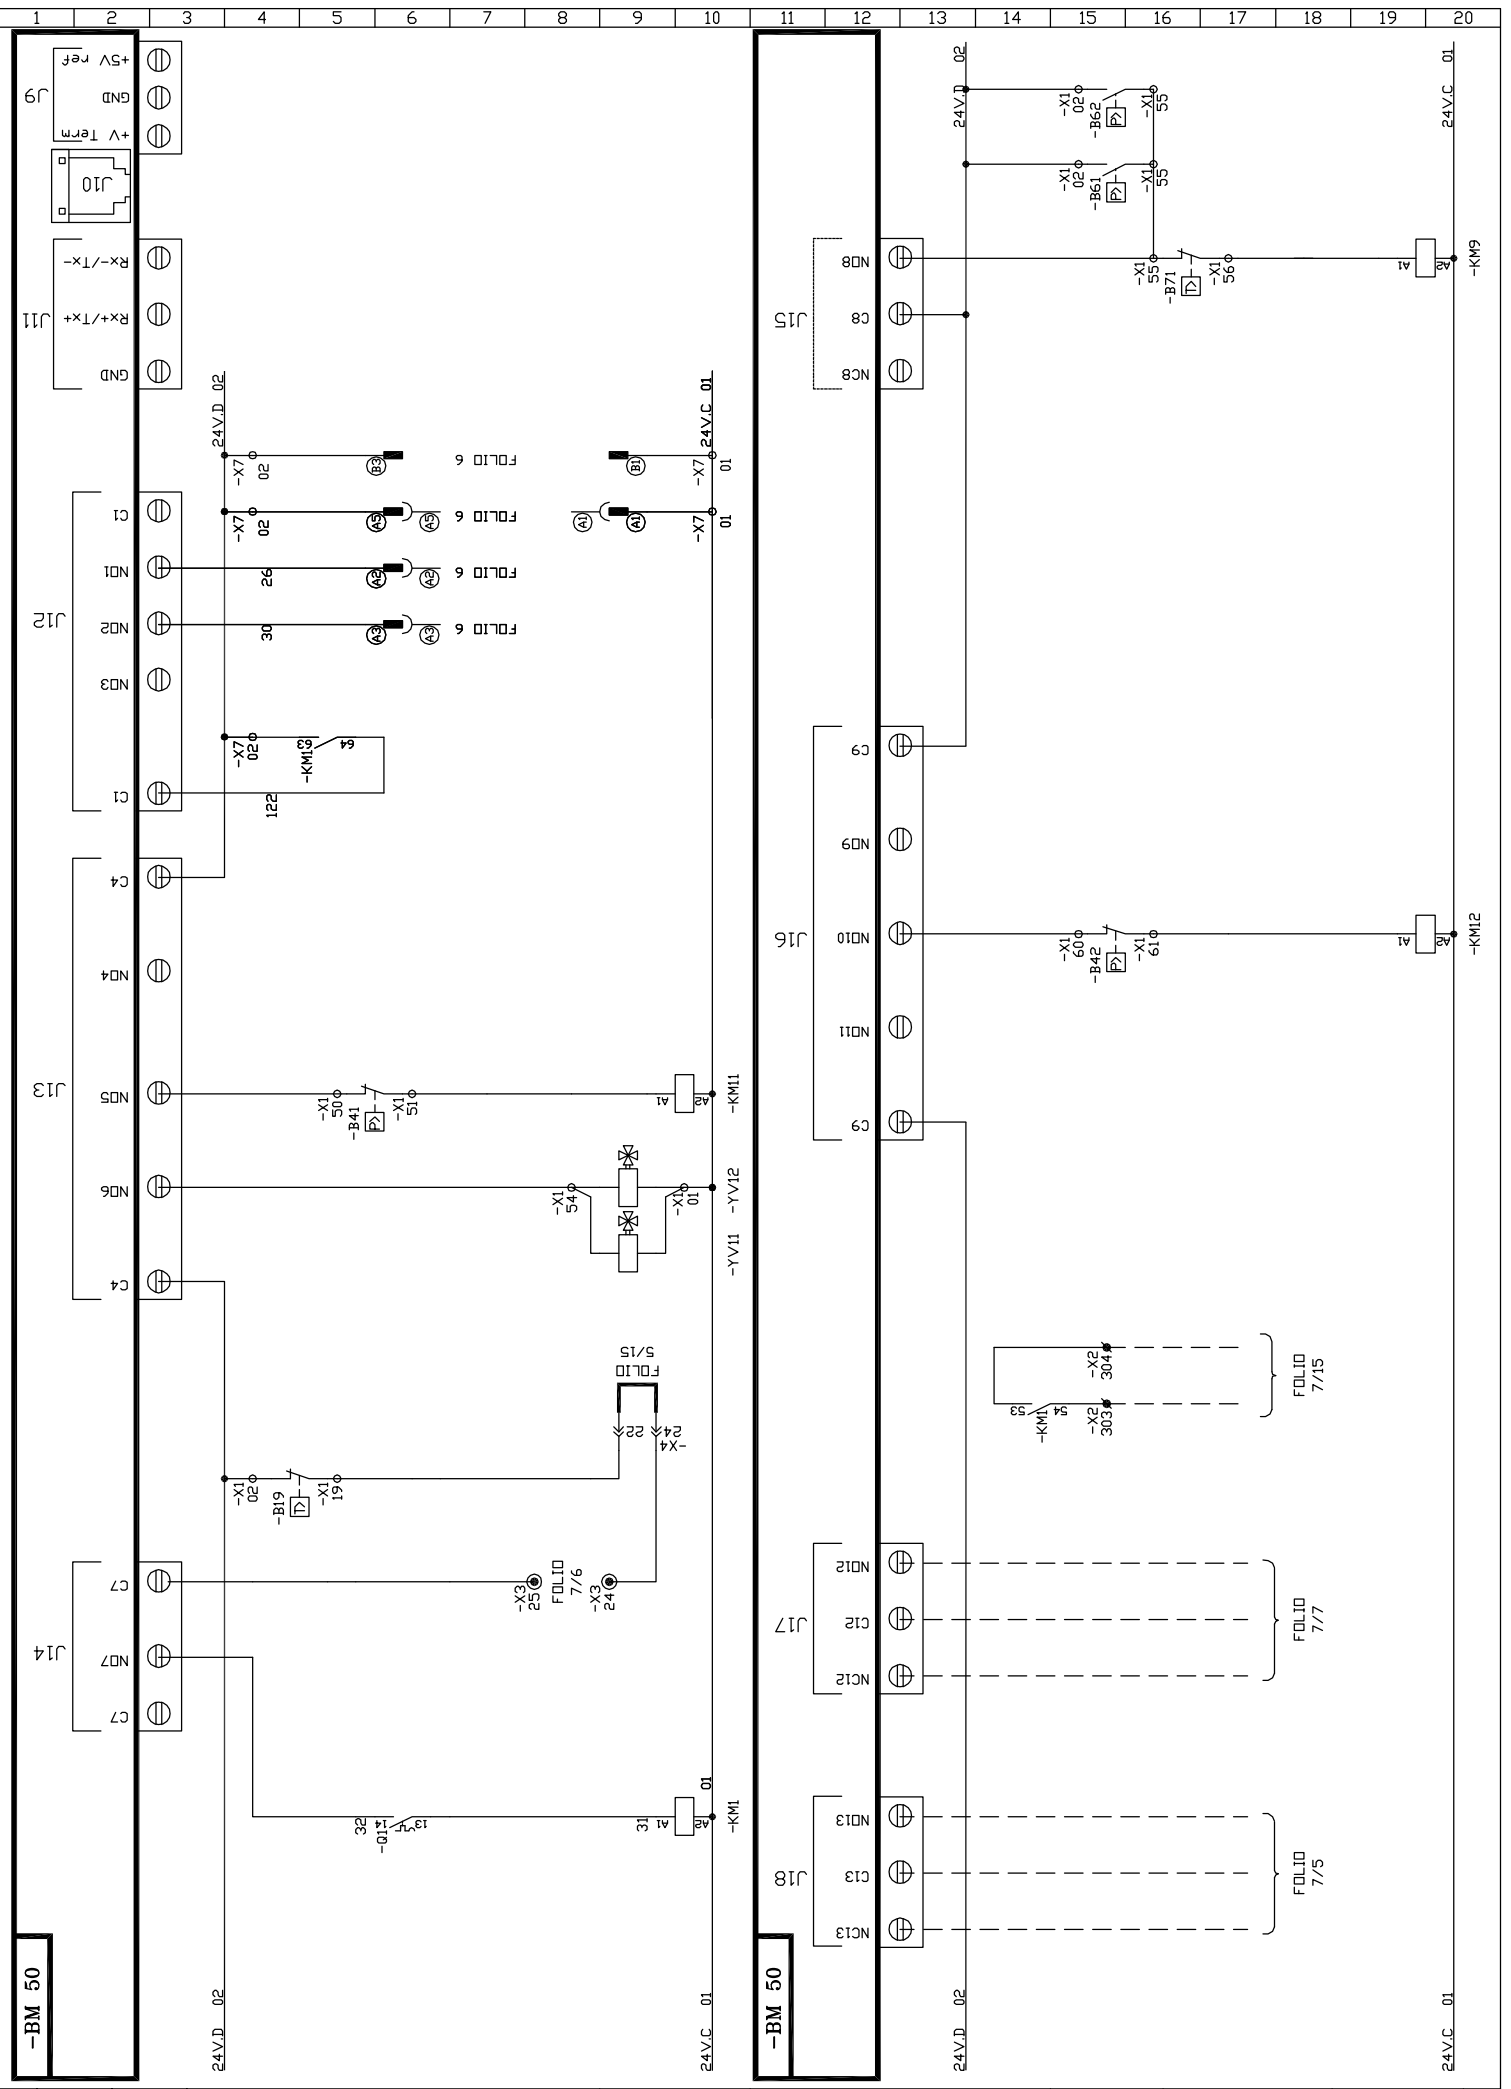

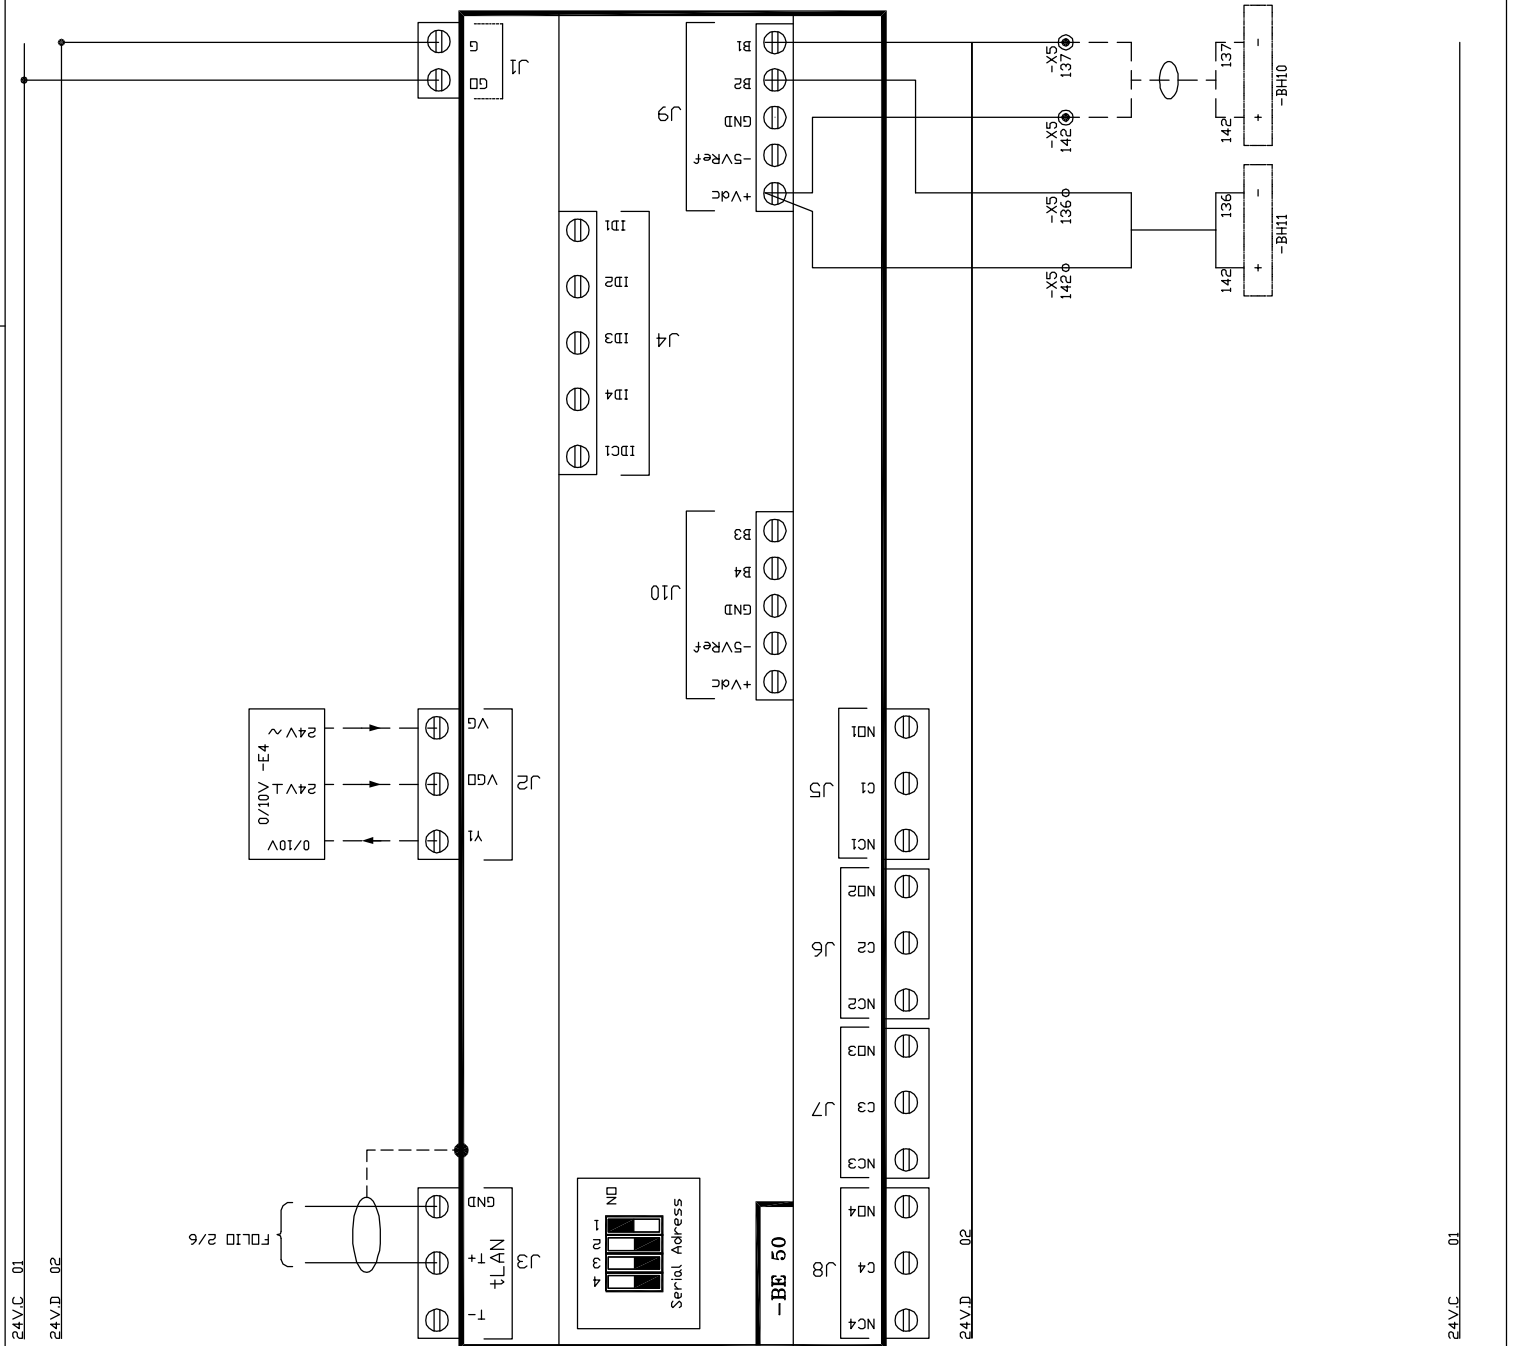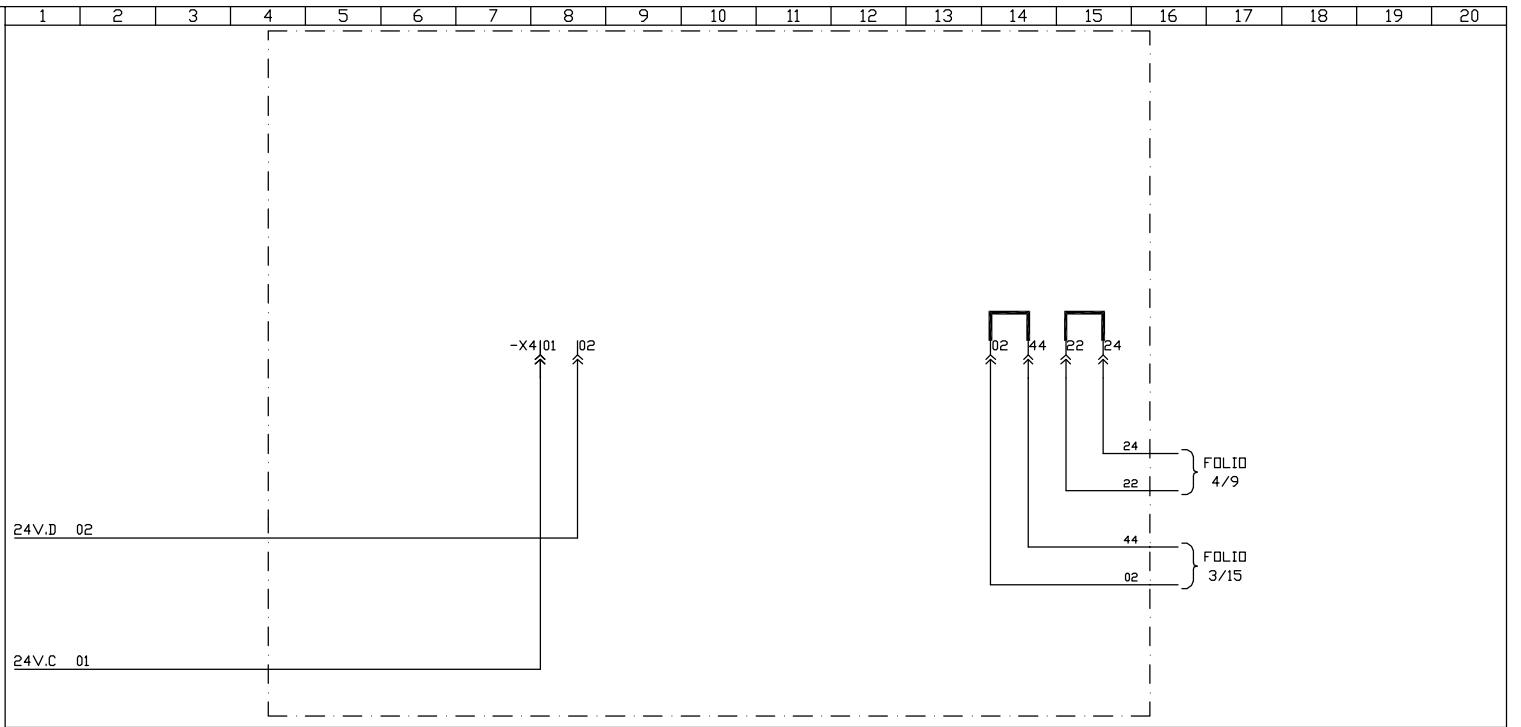


Indice	DATE	NOM	MODIFICATIONS

(1) FXK 085 N
 DAD \ BE50
 DAD \ BE50

Dessine: CTO
 Date: 21.08.06



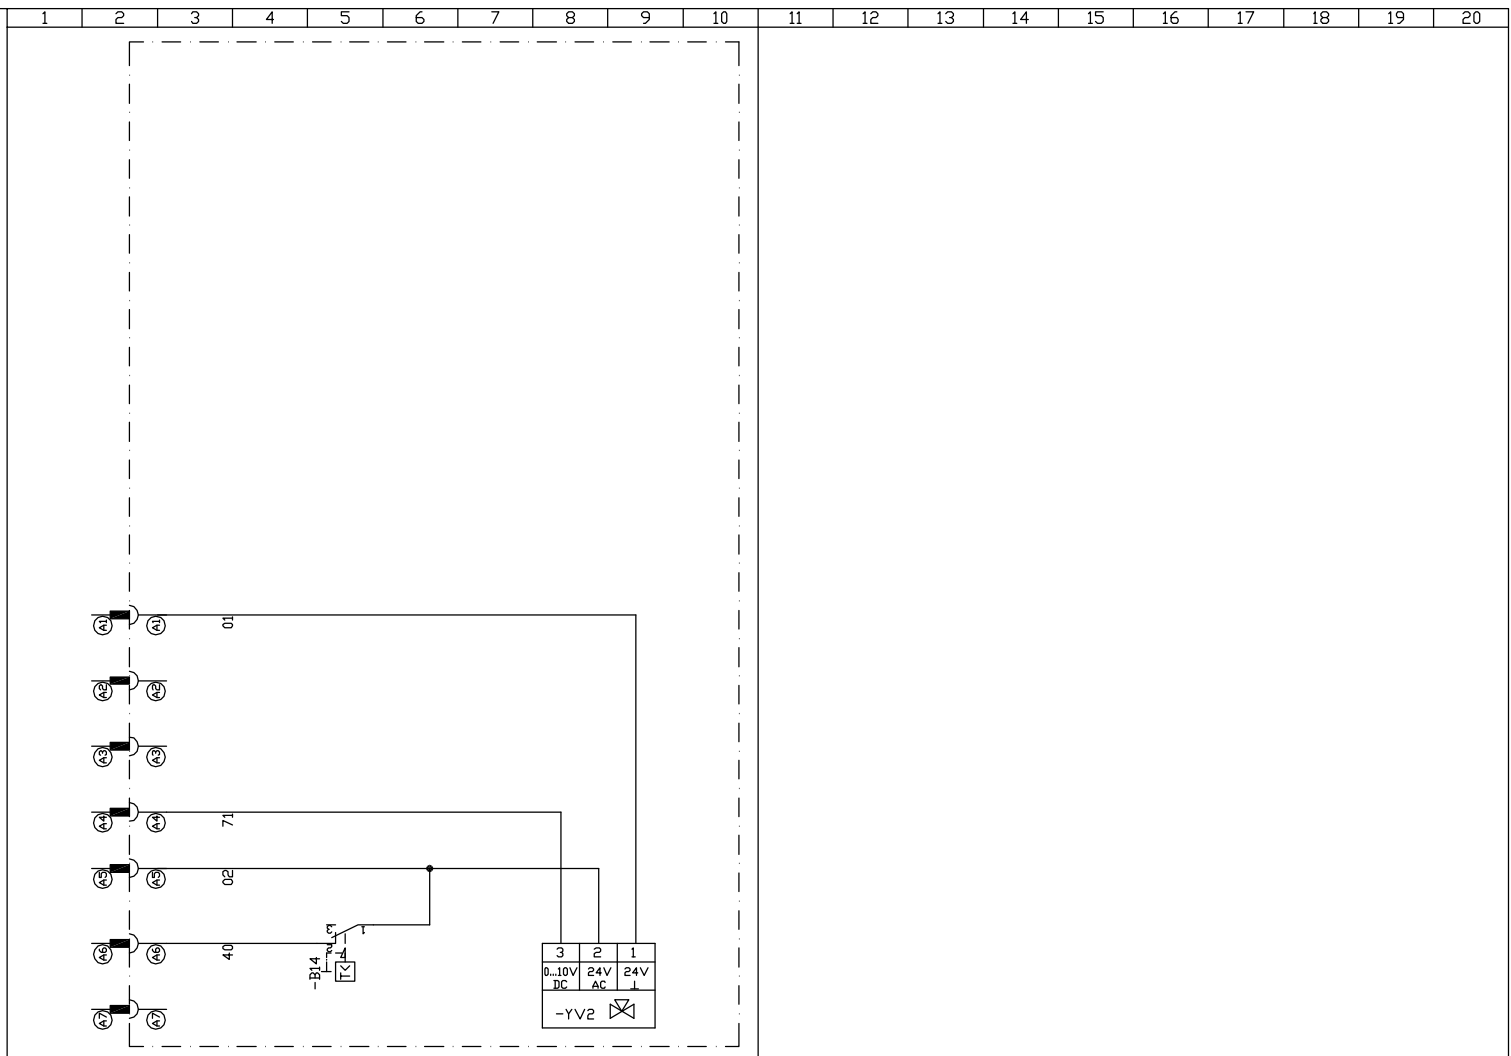



Indice	DATE	NOM	MODIFICATIONS

(1) FXK 085 N
 Kit chauffage
 GAS


Dessine:
 CTO
 Date: 21.08.06




249638 6/11

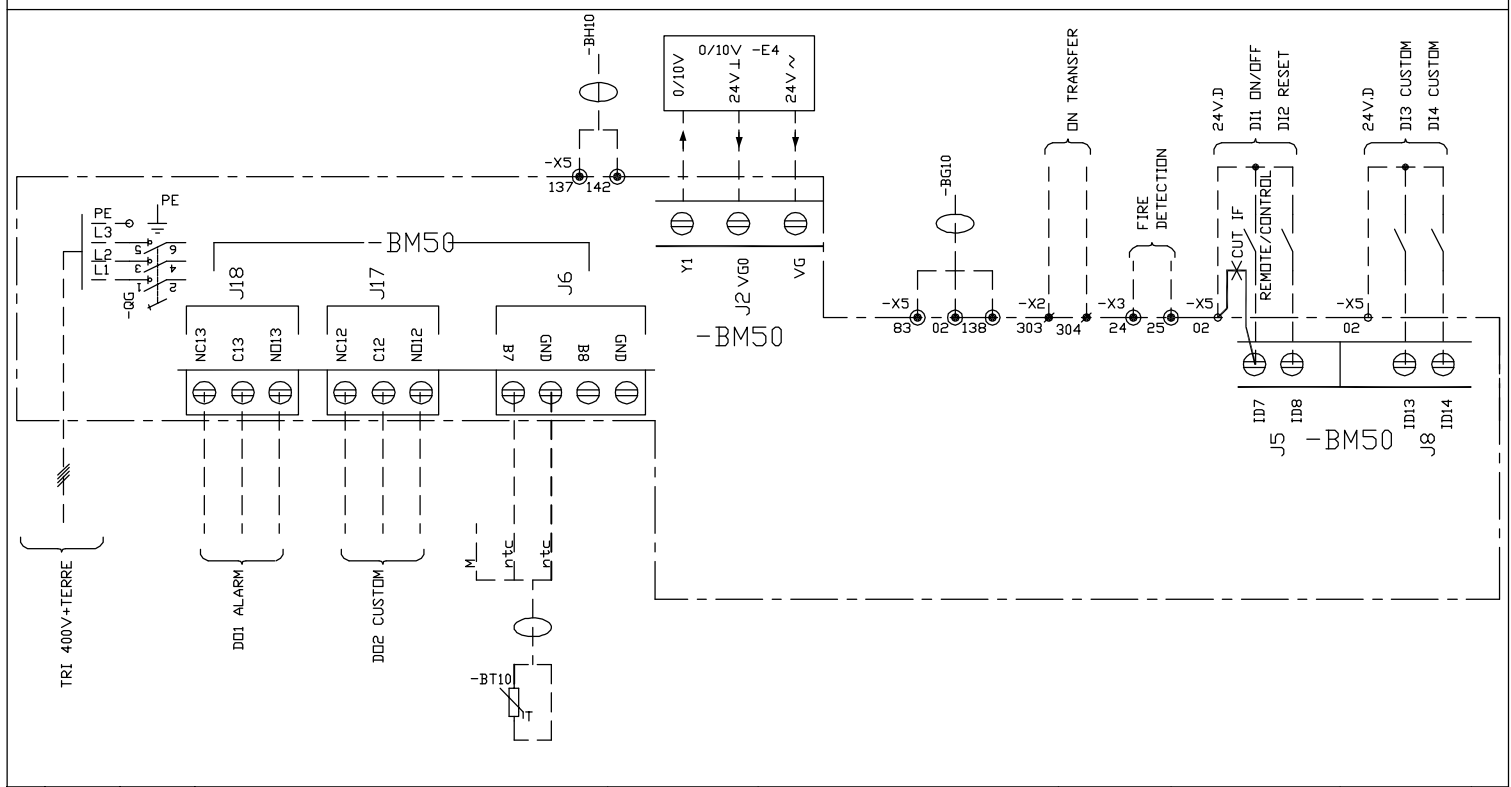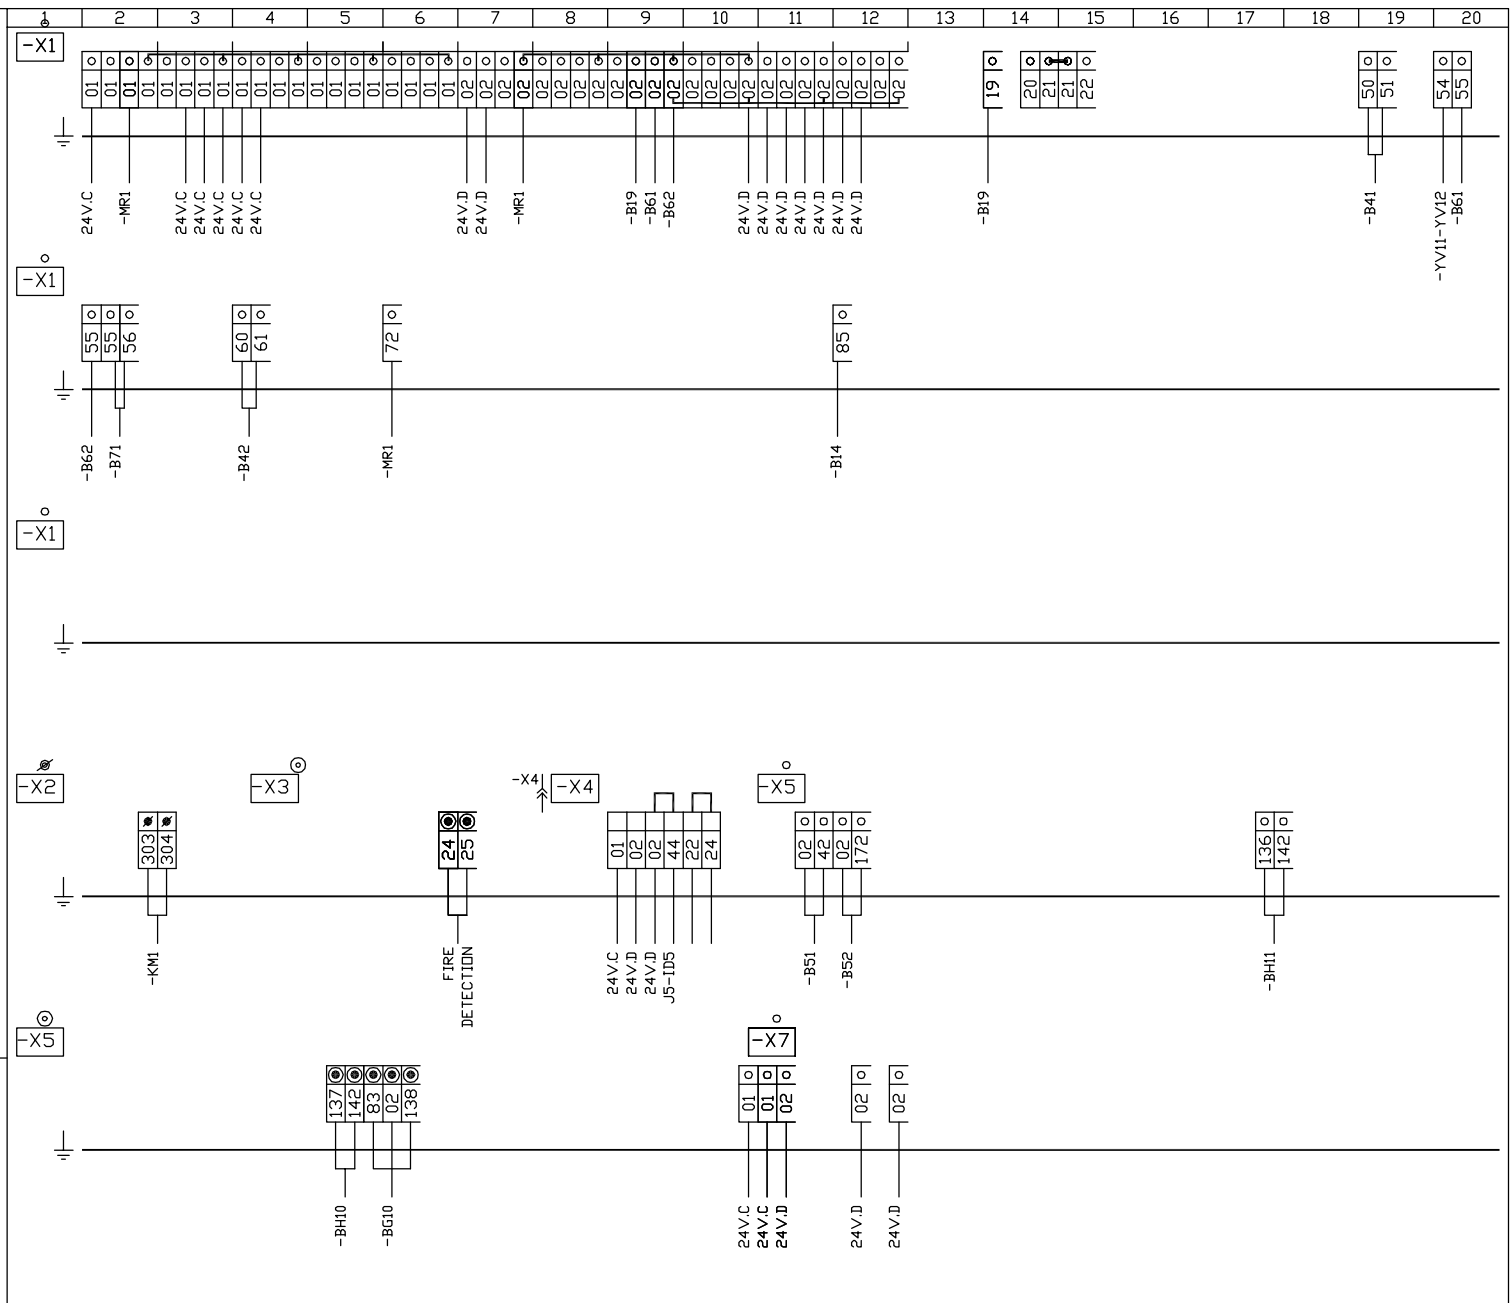




Indice	DATE	NOM	MODIFICATIONS	(1) FXK 085 N Borniers \ Raccordement Client Terminal Strip \ Customer	Dessine: CTO Date: 21.08.06		249638	7/11
--------	------	-----	---------------	--	--------------------------------	--	--------	------

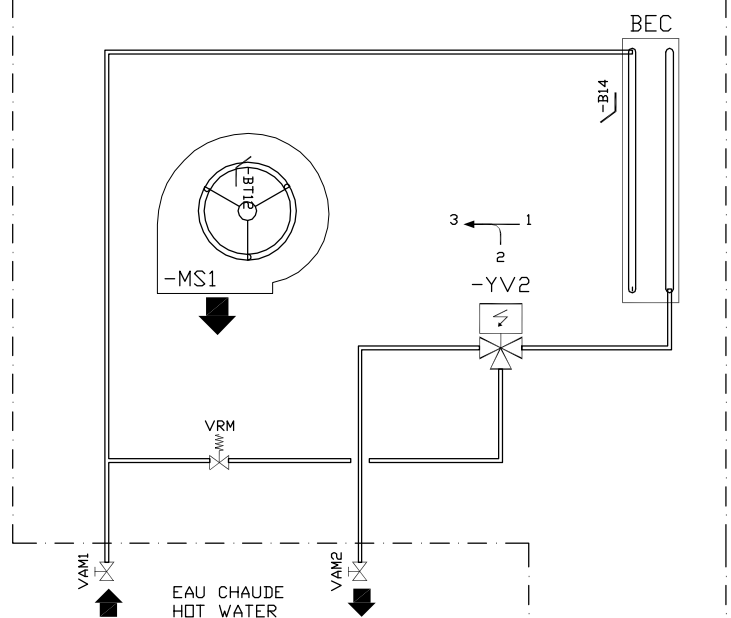


	DIAMETRE TUYAUTERIE PIPE DIAMETERS		DIAMETRE TUYAUTERIE PIPE DIAMETERS	
	1 NAPPE	2 NAPES	1 NAPPE	2 NAPES
F050	DN 20	DN 20	FX025	DN 20
F060	DN 20	DN 25	FX030	DN 20
F070	DN 20	DN 25	FX035	DN 20
F085	DN 25	DN 25	FX040	DN 20
F100	DN 25	DN 25	FX055	DN 20
F120	DN 25	DN 32	FX070	DN 20
F140	DN 25	DN 32	FX085	DN 20
F160	DN 25	DN 32	FX100	DN 25
F190	DN 25	DN 32	FX110	DN 25
			FX140	DN 25
			FX170	DN 25

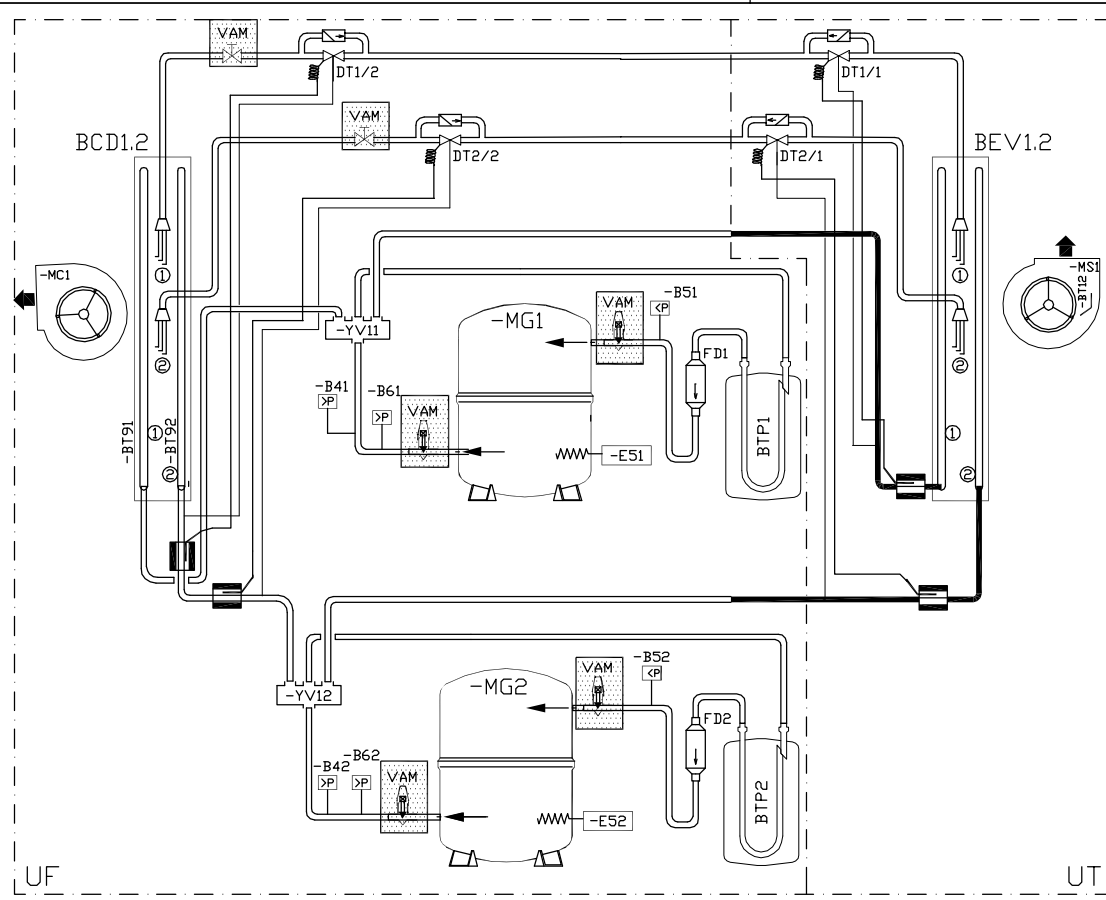

DIAMETRE TUYAUTERIES	
REFOULEMENT	7/8"
ASPIRATION	1"1/8"
LIGNE LIQUIDE	5/8"

- TUYAUTERIE CALDRIFUGEE
- TUYAUTERIE NON CALDRIFUGEE
- 

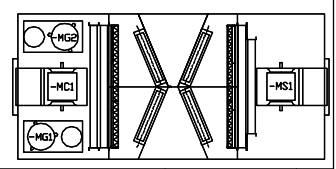 OPTION STEK
- 
 OPTION R407C



Indice	DATE	NOM	MODIFICATIONS

