
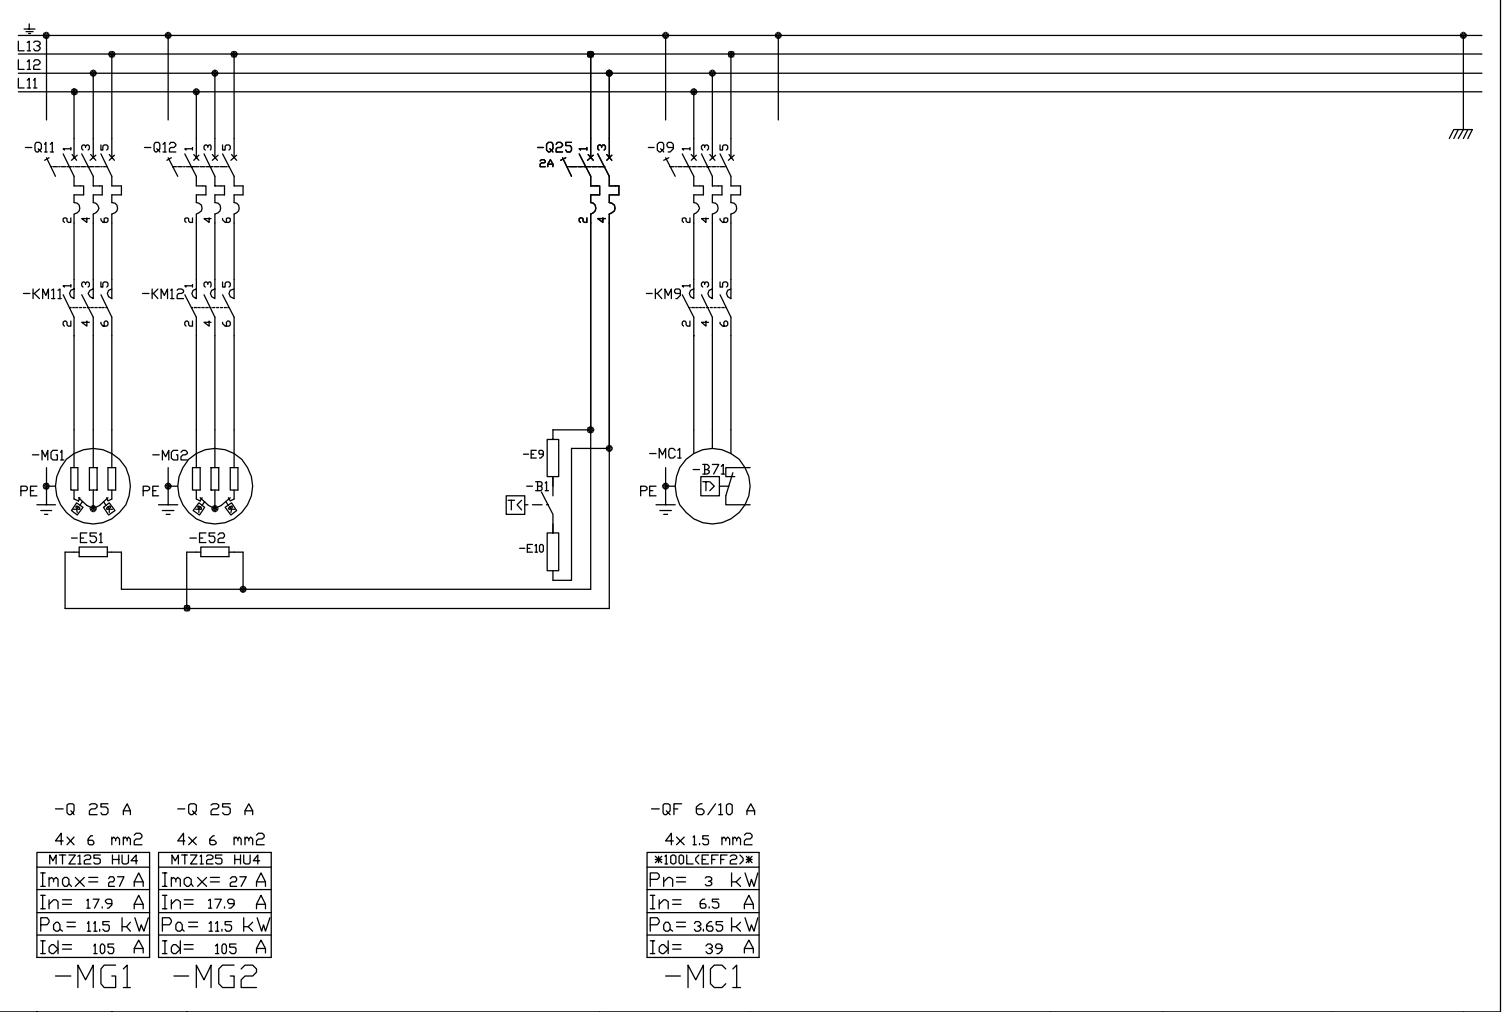
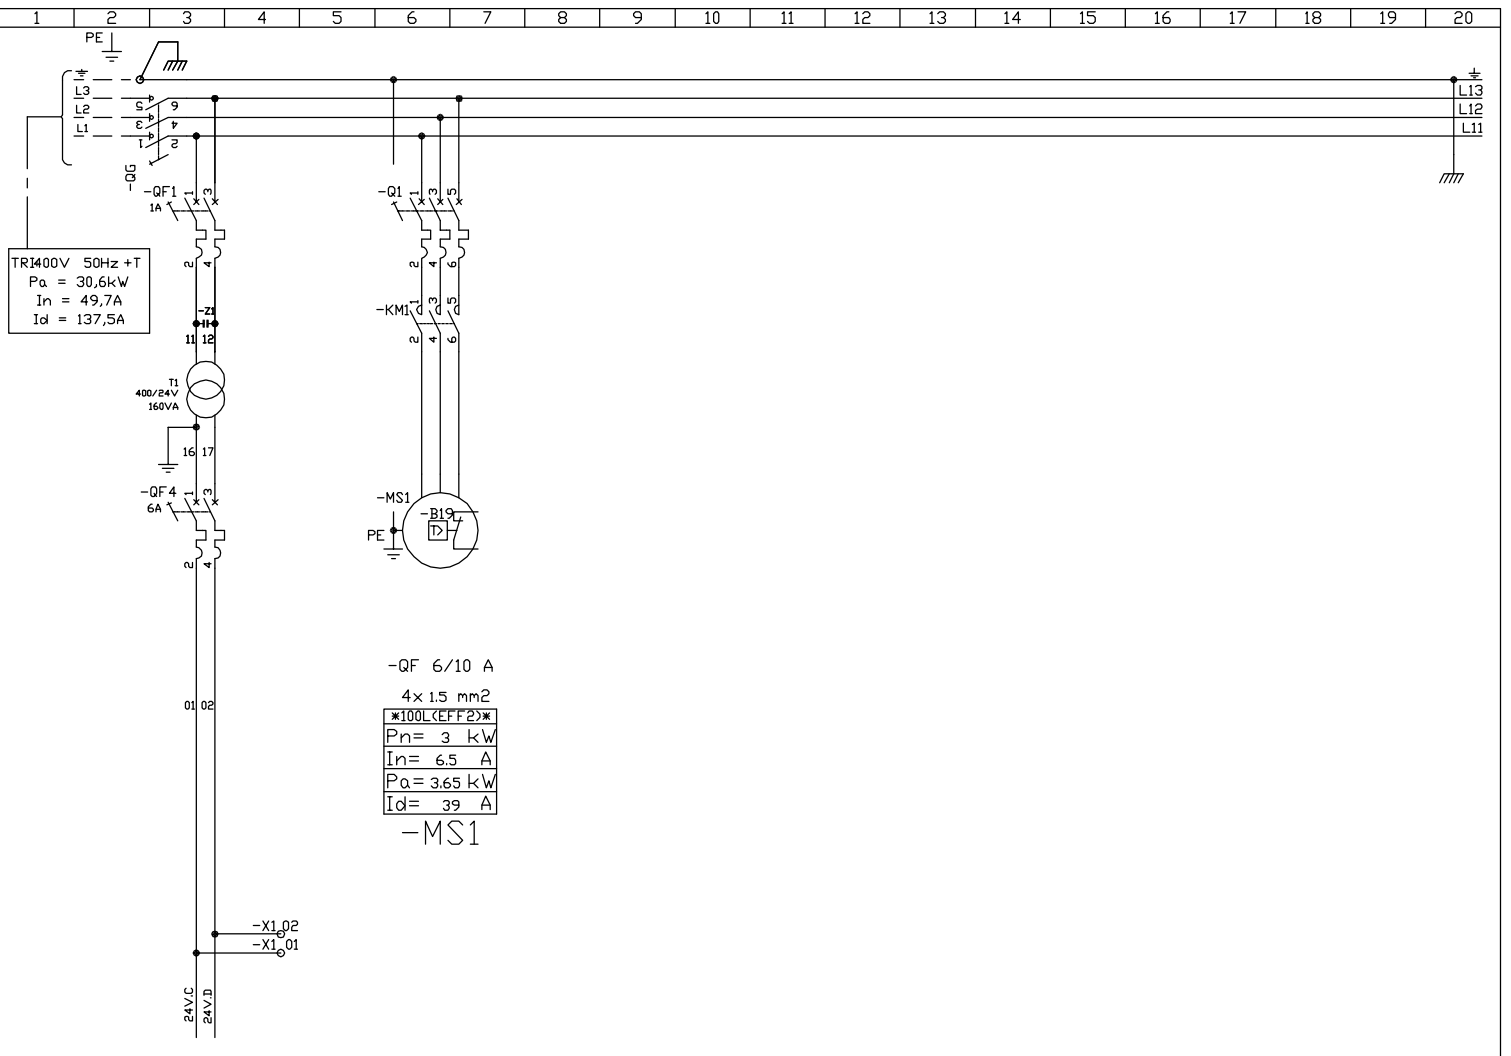
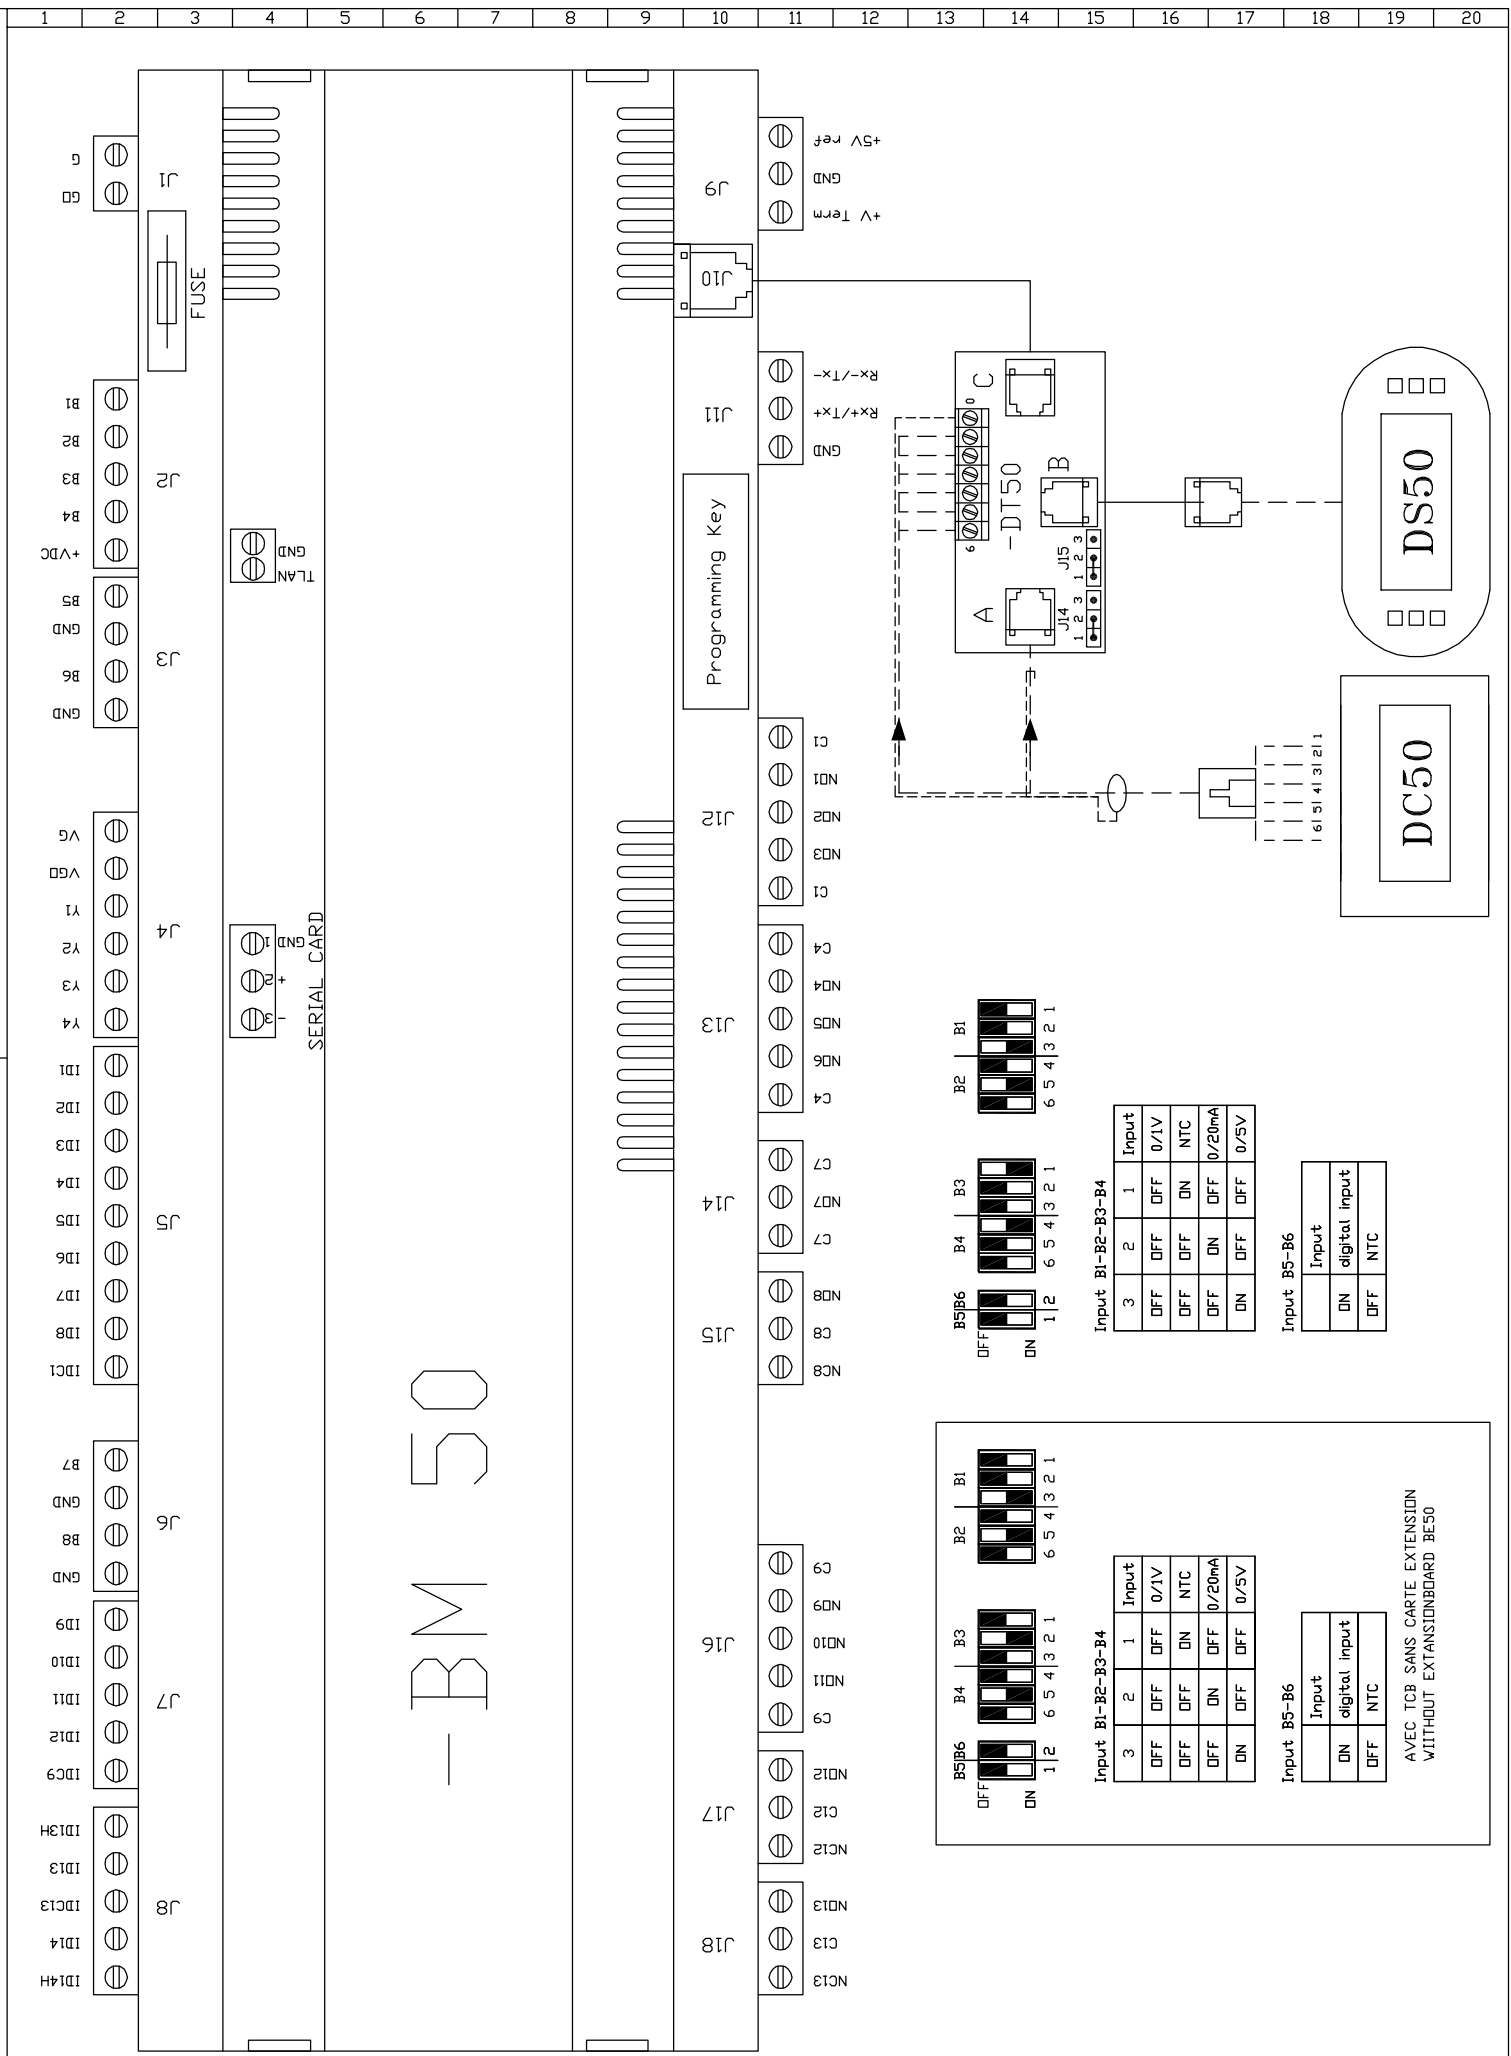




Indice	DATE	NOM	MODIFICATIONS
			
<b>DIGGS LANE</b>			
(1) FXK 070 N		Dessine: CTO	PAGE DE GARDE
<b>LENNOX AIRCONDITIONING IRELAND</b>		03.06	247048 0/11





BM 50





Input B1-B2-B3-B4

Input	1	2	3
0/1V	OFF	OFF	OFF
NTC	ON	OFF	OFF
0/20mA	OFF	ON	OFF
0/5V	OFF	OFF	ON

Input B5-B6

Input	digital input	NTC
ON	OFF	OFF




Input B1-B2-B3-B4

Input	1	2	3
0/1V	OFF	OFF	OFF
NTC	ON	OFF	OFF
0/20mA	OFF	ON	OFF
0/5V	OFF	OFF	ON

Input B5-B6

Input	digital input	NTC
ON	OFF	OFF

AVEC TCB SANS CARTE EXTENSION  
WITHOUT EXTENSIONBOARD BE50

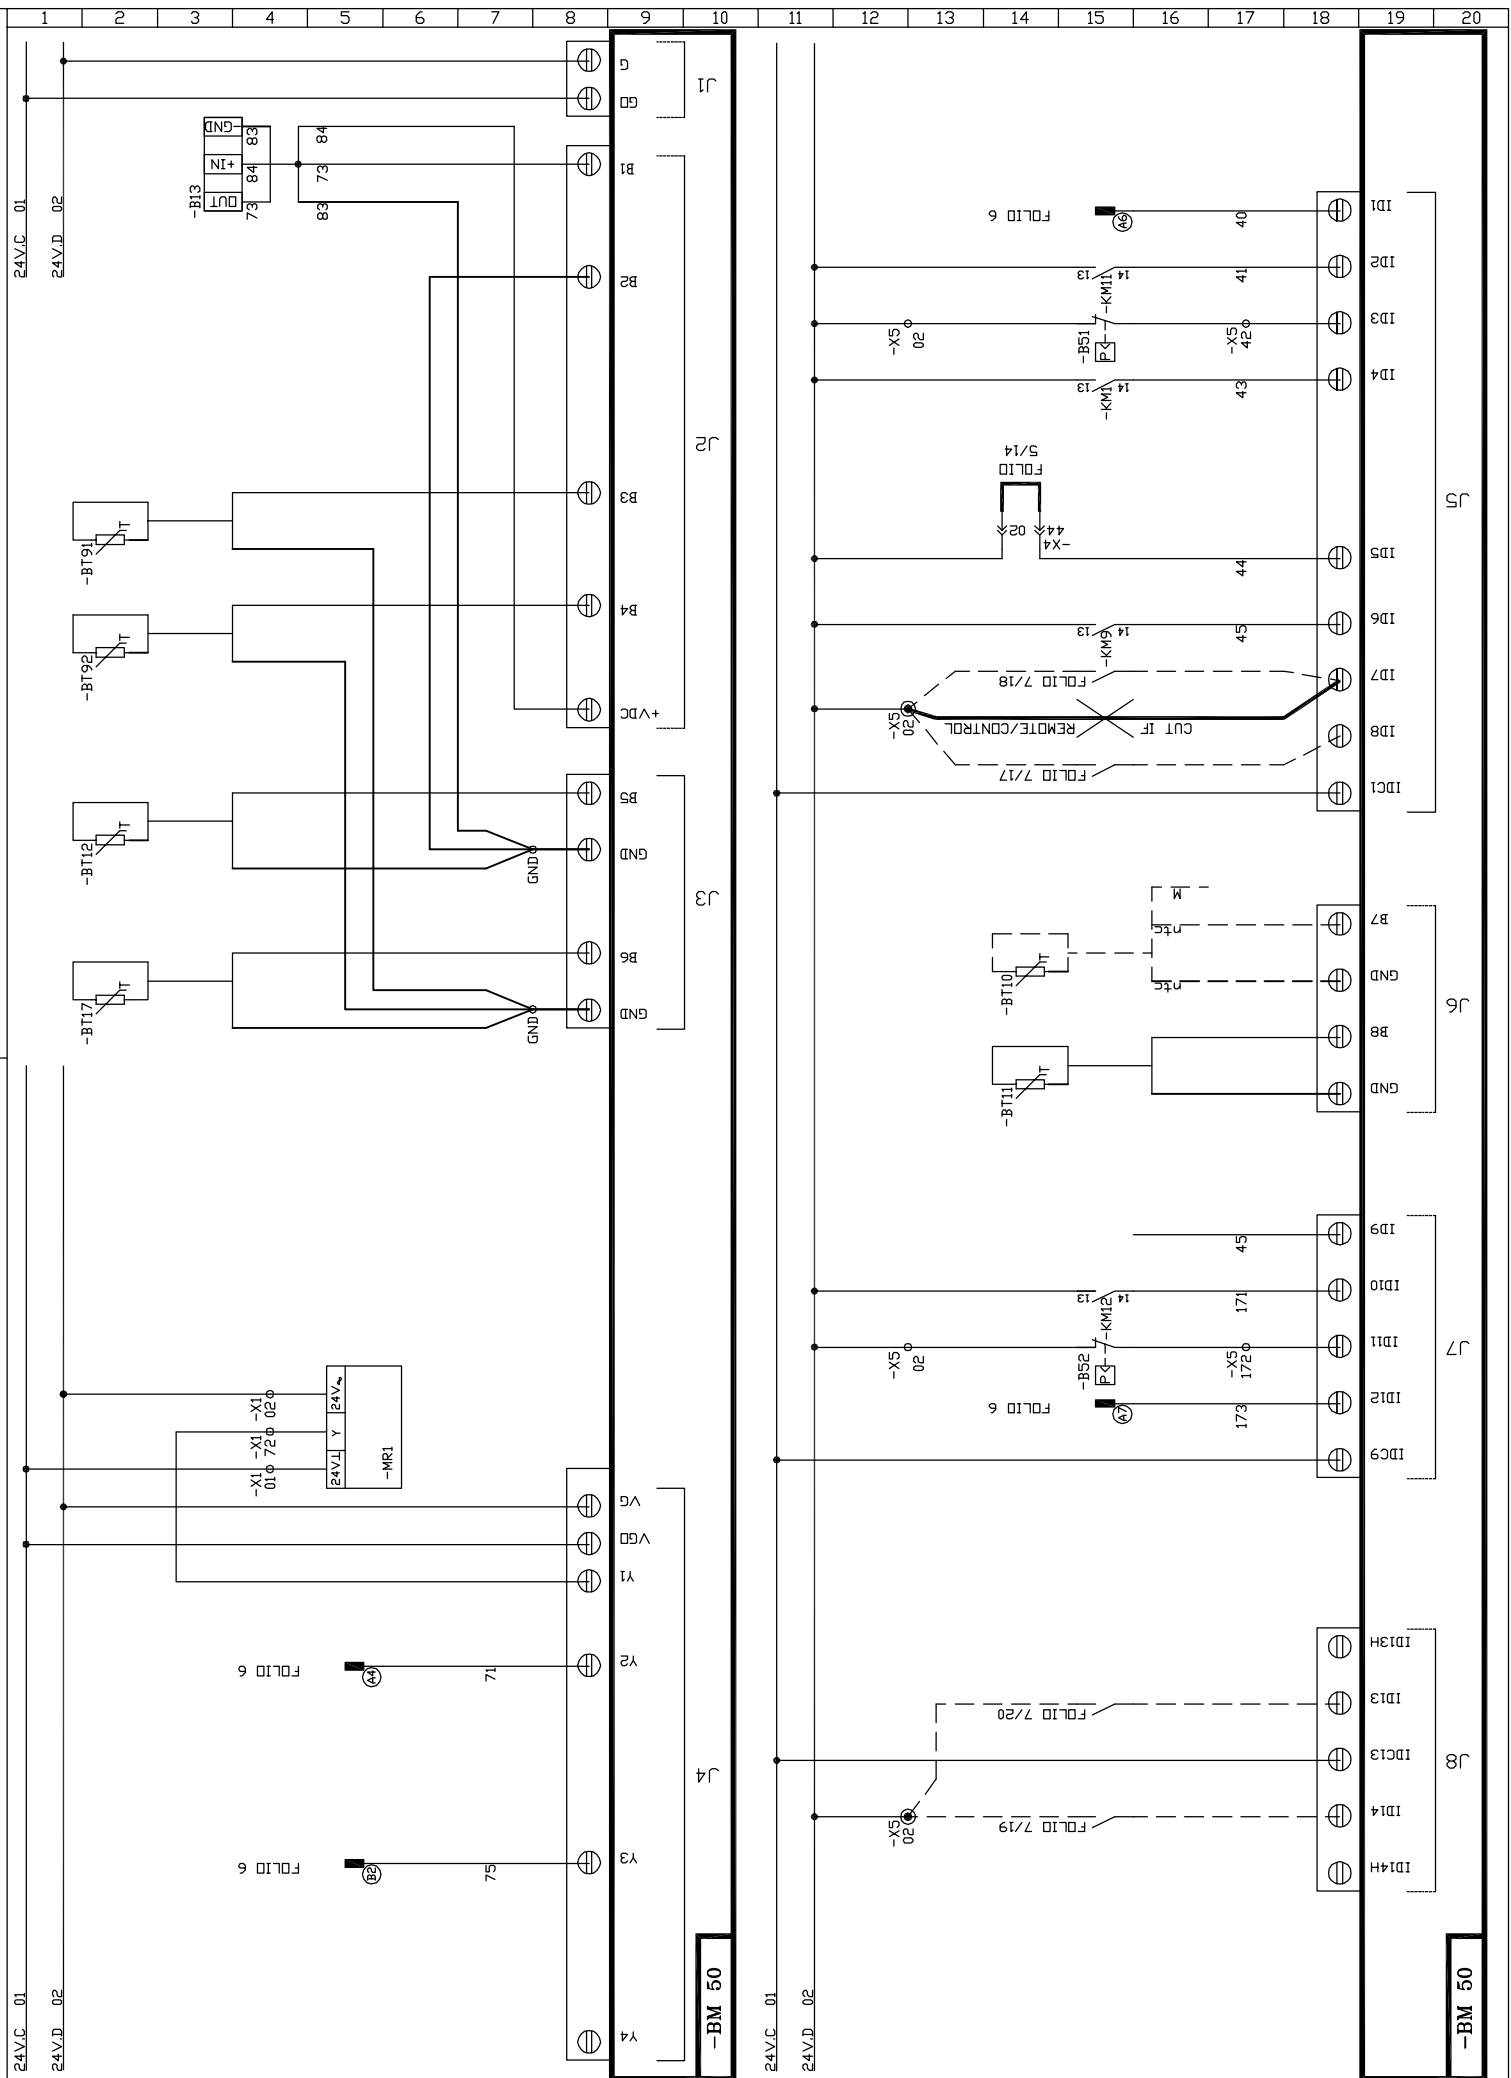


Indice	DATE	NOM	MODIFICATIONS

(1) FXK 070 N  
Entrées Automate CLIMATIC 50  
Climatic 50 Controller Input

Dessine: CTO  
Date: 02.03.06



247048 3/11

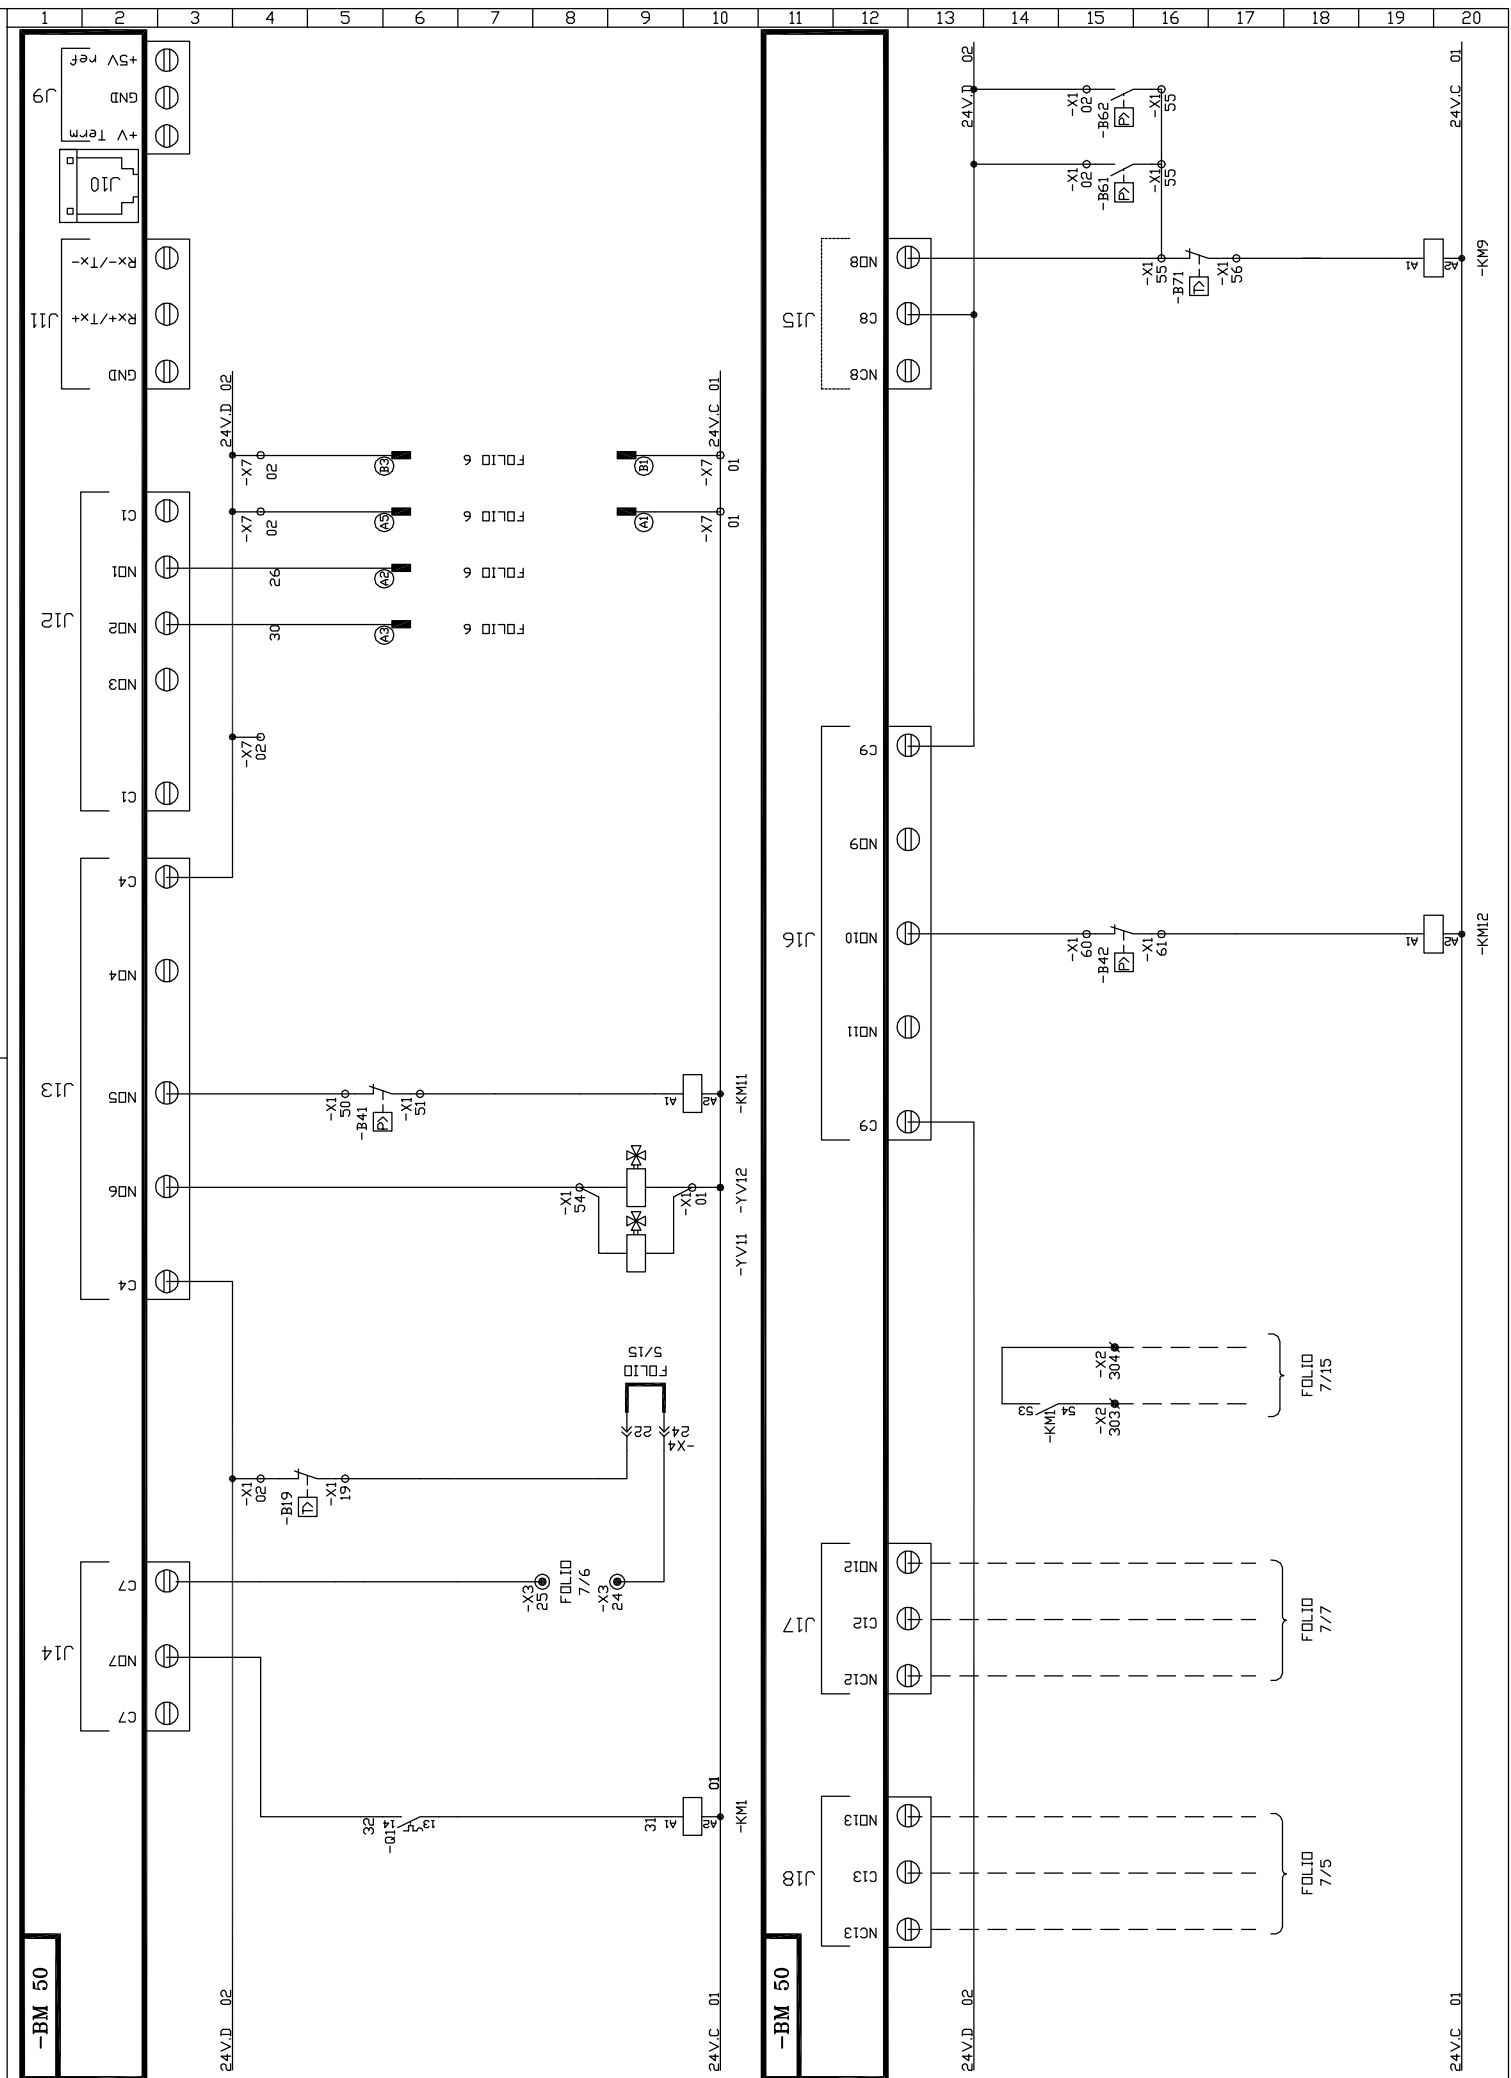


Indice	DATE	NOM	MODIFICATIONS


(1) FXK 070 N  
Sorties Automate CLIMATIC 50  
Climatic 50 Controller Outputs


Dessine: CTO  
Date: 02.03.06





247048 4/11

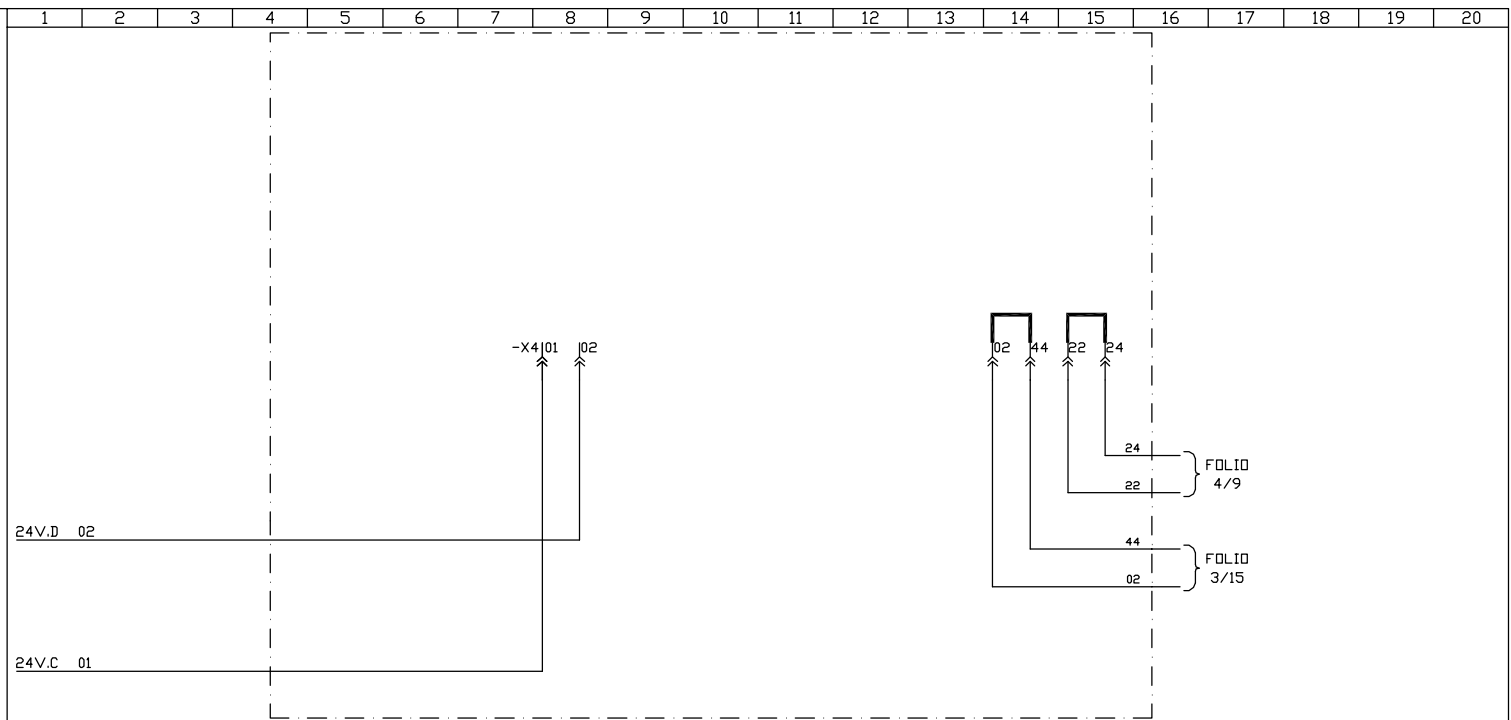




					(1) FXK 070 N Kit chauffage GAS	Dessine: CTO Date: 02.03.06	 USINE DE LONGVIC	247048 ■■■■■■■■■■	6 /11
Indice	DATE	NOM	MODIFICATIONS						

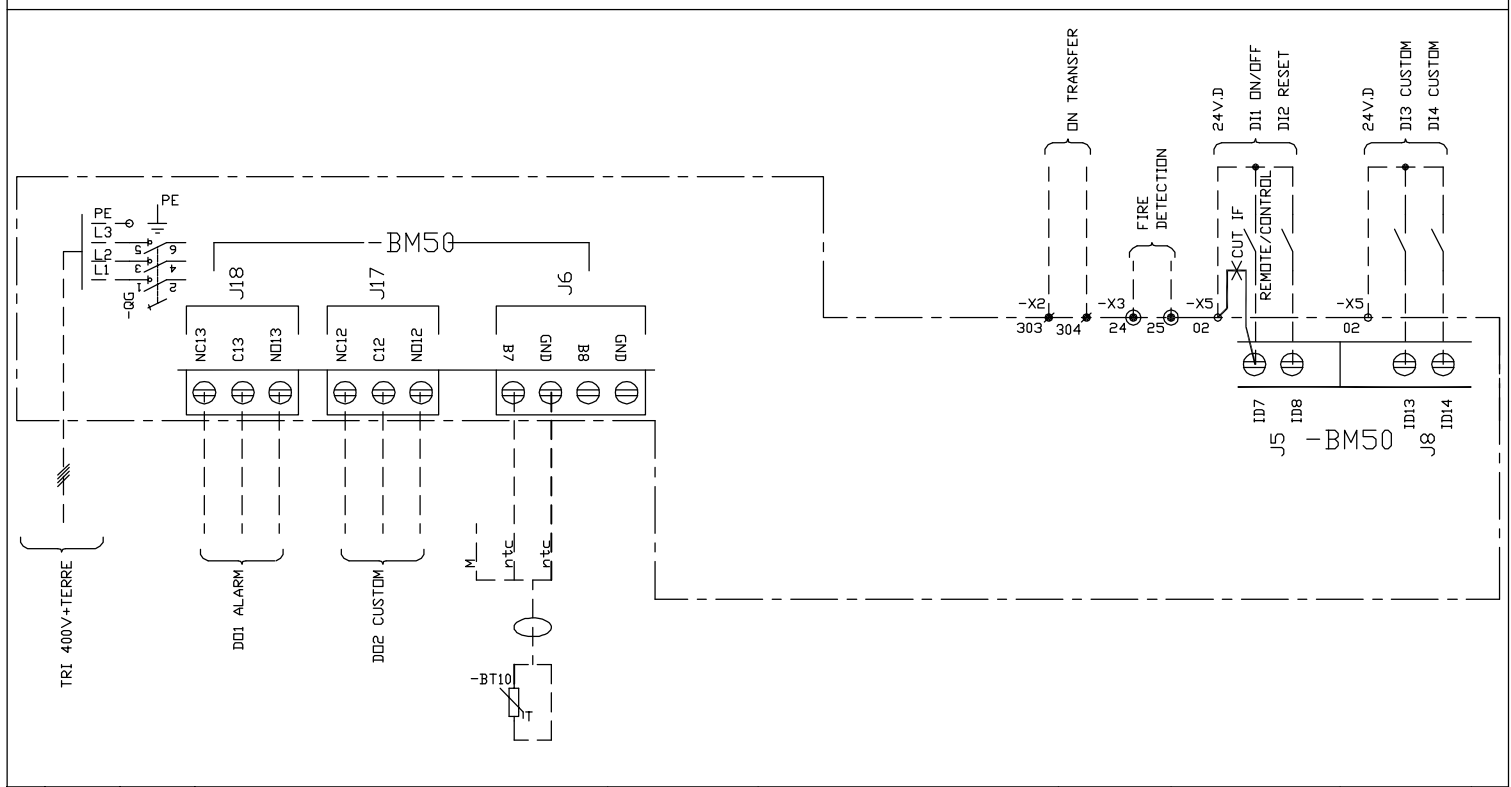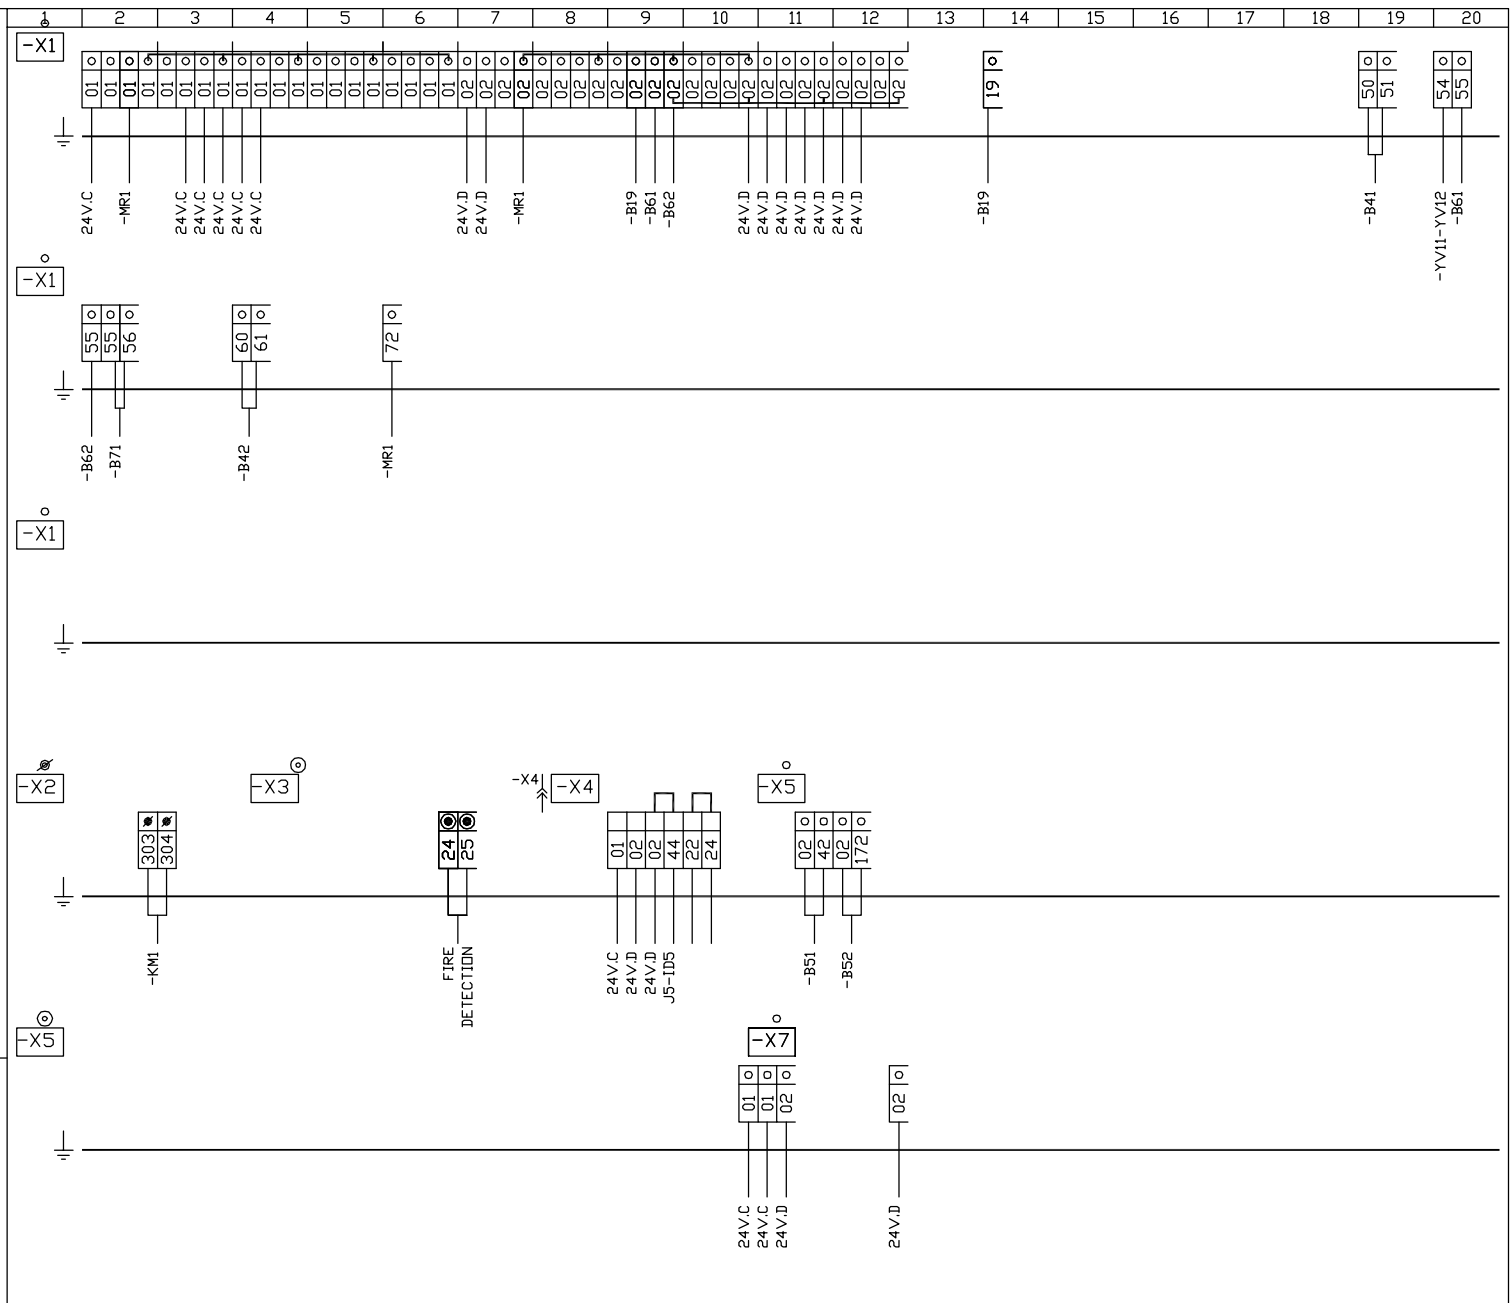







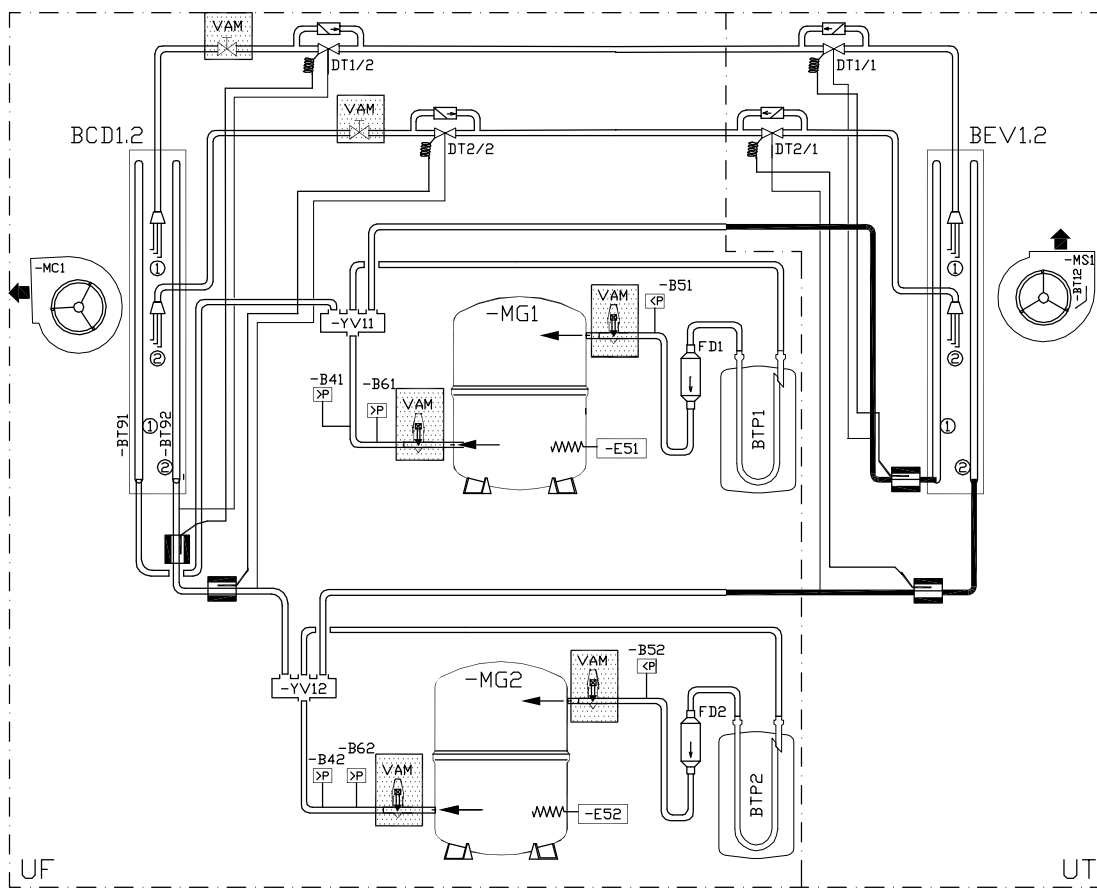

DIAMETRE TUYAUTERIES	
REFOULEMENT	7/8"
ASPIRATION	1"1/8"
LIGNE LIQUIDE	5/8"

TUYAUTERIE CALDRIFUGEE  
 TUYAUTERIE NON CALDRIFUGEE

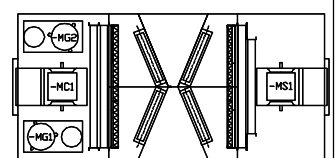

Indice	DATE	NOM	MODIFICATIONS

(1) FXK 070 N  
 Schéma Frigorifique \ Hydraulique  
 Cooling \ Hydraulic Diagram

Dessine: CTO  
 Date: 02.03.06

**LENNOX**  
 USINE DE LONGVIC

247048 9/11



